General Notes:

- 1. All landscape material to be Florida No.1
- 2. All landscaping meets FDOT clearzone and sight distance criteria.
- 3. All trees installed within 4' of a hard surface such as sidewalk, curb or building to be installed with 24" rootbarrier per detail on sheet LD-06. Rootbarrier to extend 5' in each direction, measured from center of trunk.
- 4. Quantities are given for contractor convenience only. In case of discrepancy between tags and plant list, the plant list shall prevail.

Notes:


- 1. Less than 50% of the required trees are palm trees.
- 2.80% of the required trees are native
- 3. 28% of the required trees are flowering trees
- 4. 95% of the required trees located within landscape
- Islands are shade trees.
- 5. 100% of the required trees are low water use.
- 6. 100% of the required shrubs are moderate to low water use
- 7. All sod to be St. Augustine 'Floratam', weed free and laid tight, unless otherwise noted.


PSLUSD Notes:

- 1. No landscaping shall be planted in a manner that would adversely affect utility easements.
- 2. Landscaping shall be in compliance with Chapter 153 of the City of Port St. Lucie Code of Ordinances, PSLUSD technical specifications and policies.
- 3. All landscaping within City utility easements shall comply with PSLUSD technical specifications, policies, and codes.
 4. All landscaping shall meet the latest PSLUSD Landscape Policy and shall not be
- 4. All landscaping shall meet the latest PSLUSD Landscape Policy and shall not be placed in a manner that would create conflicts with the intended operation and maintenance of any existing utility.
- 5. Trees shall not be planted within ten (10) feet of any PSLUSD underground infrastructure.
- 6. No landscaping other than sod grasses shall be located within 5' of a PSLUSD appurtenance such as a water meter assembly, backflow device, fire hydrant or sewer cleanout, etc.

Landscape Irrigation Notes:

- All areas to receive 100% irrigation coverage
- All zones to be automatically controlled.Clocks to have automatic "Rain sensors".
- Water source may be potable or well and shall be determined at time of building permit application

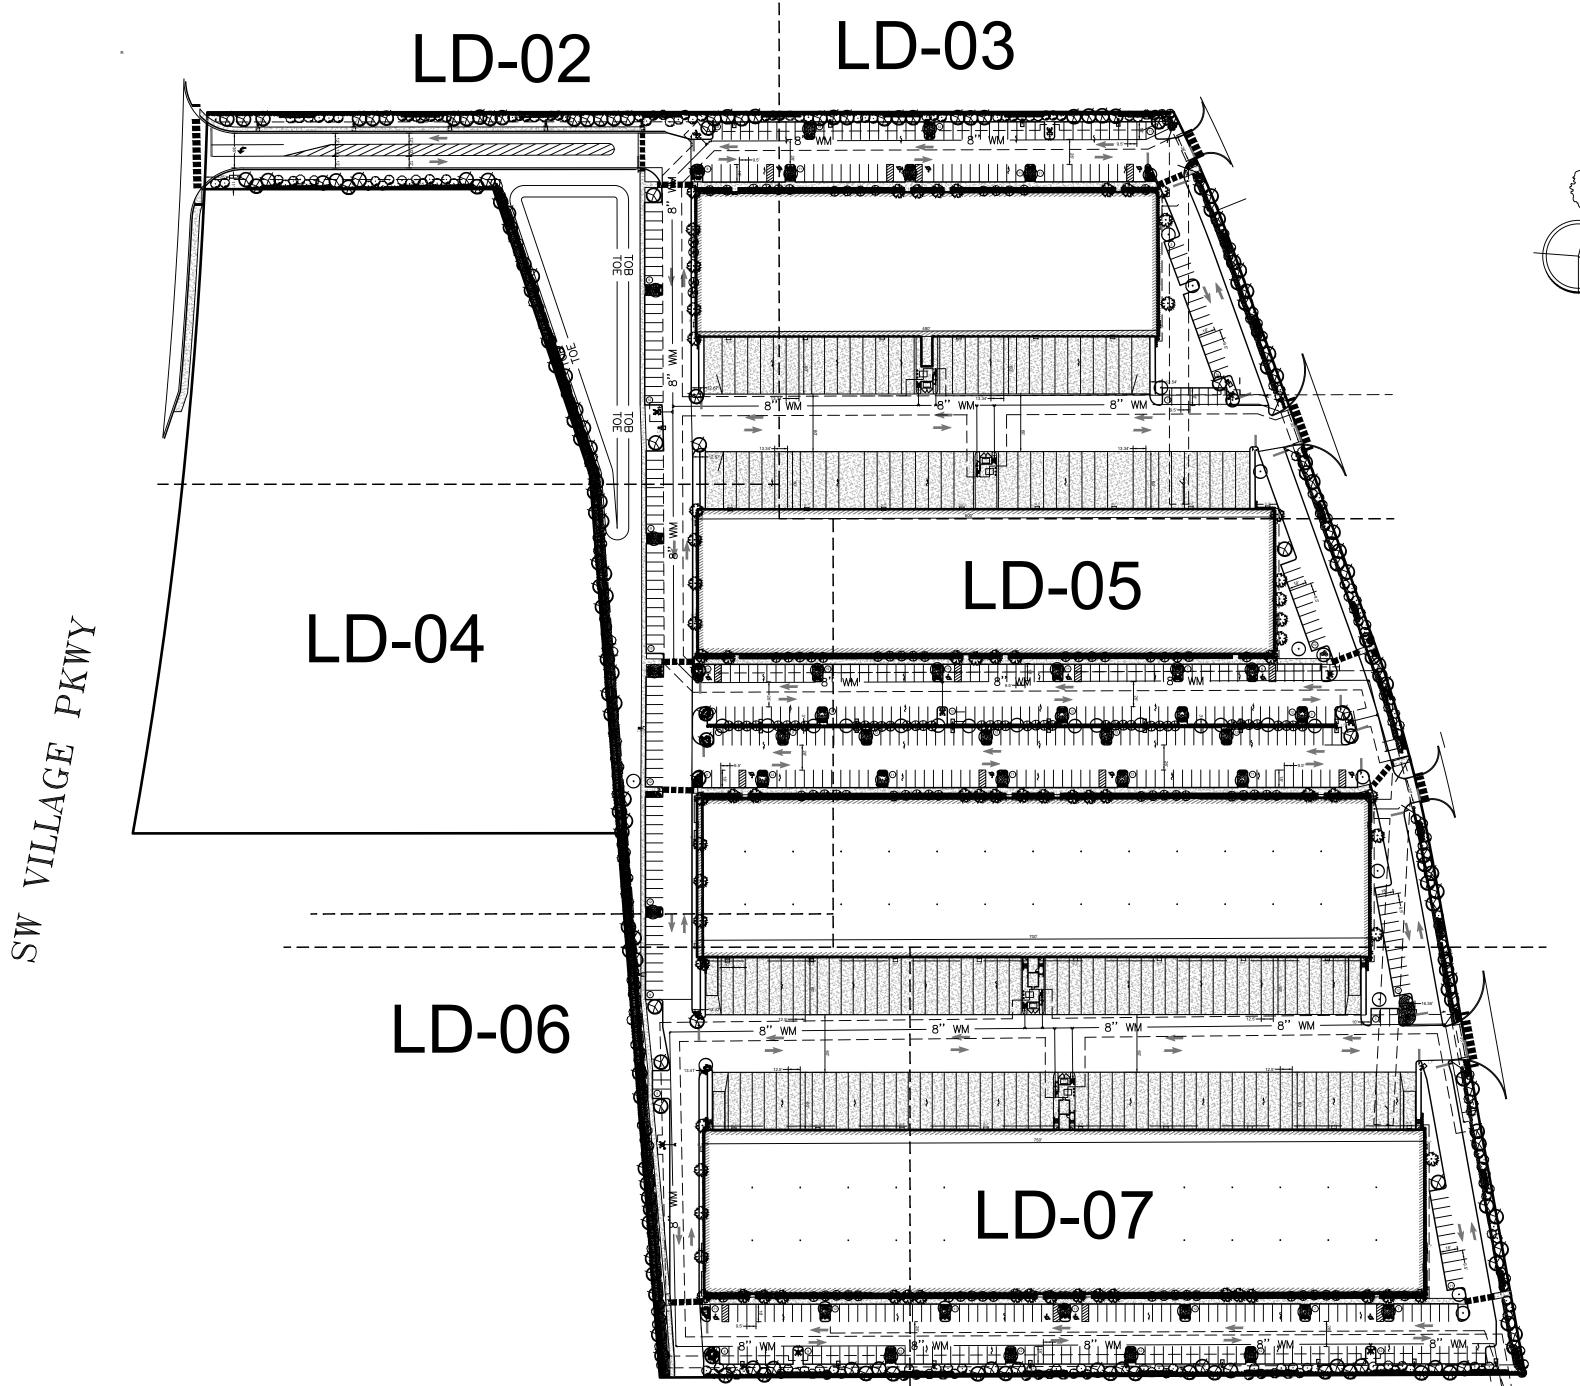


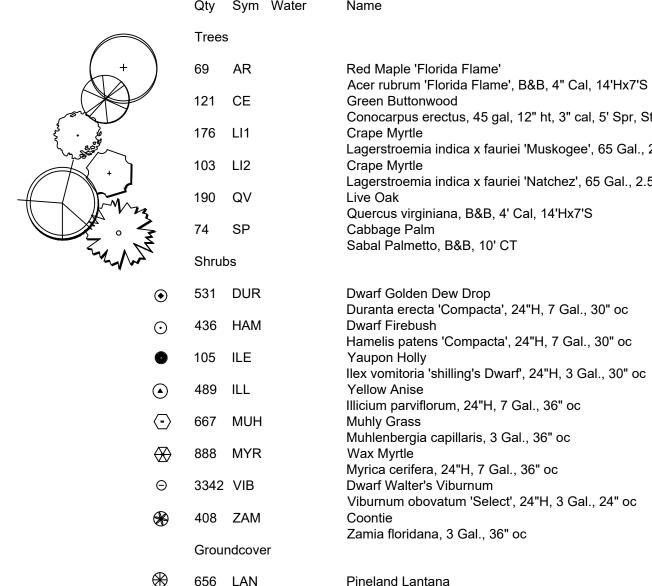

● 1352 LIR

Lantana depressa, 1 Gal.. 36" oc

Liriope muscari, 1 Gal., 18" oc



				Land	scape Data	a: Roadw	av Buffer	S									
					•		a, 20c.	J									
		Tre	es: 1/25 LF, 14' Ht, 2.5"	Cal		Understory 12'Ht, 2	: Tradition .5" Cal				:	Shrubs: Do	ouble Row,	2' o.c.			
		Required	Provided	l	Required		Provided		Required				Prov	rided			
Length			QV			LI1	LI2	Total		DUR	ILE	ILL	мин	MYR	VIB	ZAM	Total
1257		50	50		67	35	32	67	503					482	301		783
1163		47	47		78	54	24	78	1163			668			511	80	1259
	Total	97	97		145	89	56	145	1666	0	0	668	0	482	812	80	2042
	-				1			-		, ,		1			I	1	
Roadway Buffer Tr	ees Req.	241															
Roadway Buffer Tr	ees Prov.	242															
		,		Lands	scape Data	ı: Perime	ter Buffer	^S									
		Tre	es: 1/30 LF, 14' Ht, 2.5"	Cal								Shr	ubs: 2' o.c.				
		Required	Provided		Required		Provided		Required	Provided							
ıffer	Length		QV	Total		LI1	LI2	Total		DUR	ILE	ILL	мин	MYR	VIB	ZAM	Total
DRTH	1006	34	42	42	67	48	19	67	503					345	158		503
UTH	841	28	28	28	56	36	21	57	421					267	159		426
AY BUFFER	301	10	10	10	20	14	6	20	151					76	75		151
	Total	38	38	- I	76	50	27	77	571	0	0	0	0	343	234	0	577
Perimeter Buffer T	rees Req.	30															
Perimeter Buffer Tr	ees Prov.	30															
uff DR DU AY	1257 1163 coadway Buffer Tr coadway Buffer Tr coadway Buffer Tr Th	1257 1163 Total coadway Buffer Trees Req. coadway Buffer Trees Prov. fer Length RTH 1006 UTH 841 Y BUFFER 301	Length 50 1257 50 1163 47 Total 97 Coadway Buffer Trees Req. 241 Doadway Buffer Trees Prov. Required Required STH 1006 34 JTH 841 28 Y BUFFER 301 10 Total 38 Perimeter Buffer Trees Req. 30	Length QV 1257 50 50 1163 47 47 Total 97 97 Toadway Buffer Trees Req. 241 Coadway Buffer Trees Prov. 242 Trees: 1/30 LF, 14' Ht, 2.5" Required Provided Fer Length QV RTH 1006 34 42 JTH 841 28 28 Y BUFFER 301 10 10 Total 38 38 erimeter Buffer Trees Req. 30	Length	Length	Length QV	Length	Length QV	Length QV	Length	Length QV	Length QV	Length QV	Length	Length QV	Length QV S


Tota	I Perimeter Trees Prov		30																
							Landso	cape Data: I	nterior										
			Façade: 1 tree per 25 LF 10' CT or 14' Ht				Parking Islands				Shrubs: 2' o.c.								
		Required		Pro	vided		Required		Provided		Require d				Provided				
Buffer	Length		CE	LI1	SP	Total		AR	QV			DUR	VIB	LAN	LIR		T	Γotal	OVER
Bldg. 1	755	30	19		14**	33				Total	378	46	333	109	155		i	643	266
Bldg. 2	877	35	19		16	35				lotai	439	44	394	109	310			857	419
Bldg. 3	1000	40	20		20	40					500	53	447	108	428		1	1036	536
Bldg. 4	1065	43	22		24*	46					533	56	475	121	459		1	1111	579
Islands	81			<u></u>			81	55	22	77									
Median	688	41		41		41	20	20		20			302	154					
	Total	189	80	41	74	195	101	75	22	97	1849	199	1951				3	3647	1799
Total Int	erior Trees Req.	290																	
Total Inte	erior Trees Prov.	292	296																
Overa	all Trees Req.	562																	
Overa	III Trees Prov.	564	799																
Overa	* 3 parkin II Shrubs Req. 1 parkin	g lot trees rel g lot tree relo	ocated to ocated to f	acade											DSI	USD File	# 5360D		





andscape


Dragonfly


PSLUSD File # 5360D 3.24.23
City of Port St. Lucie Project No P22-143

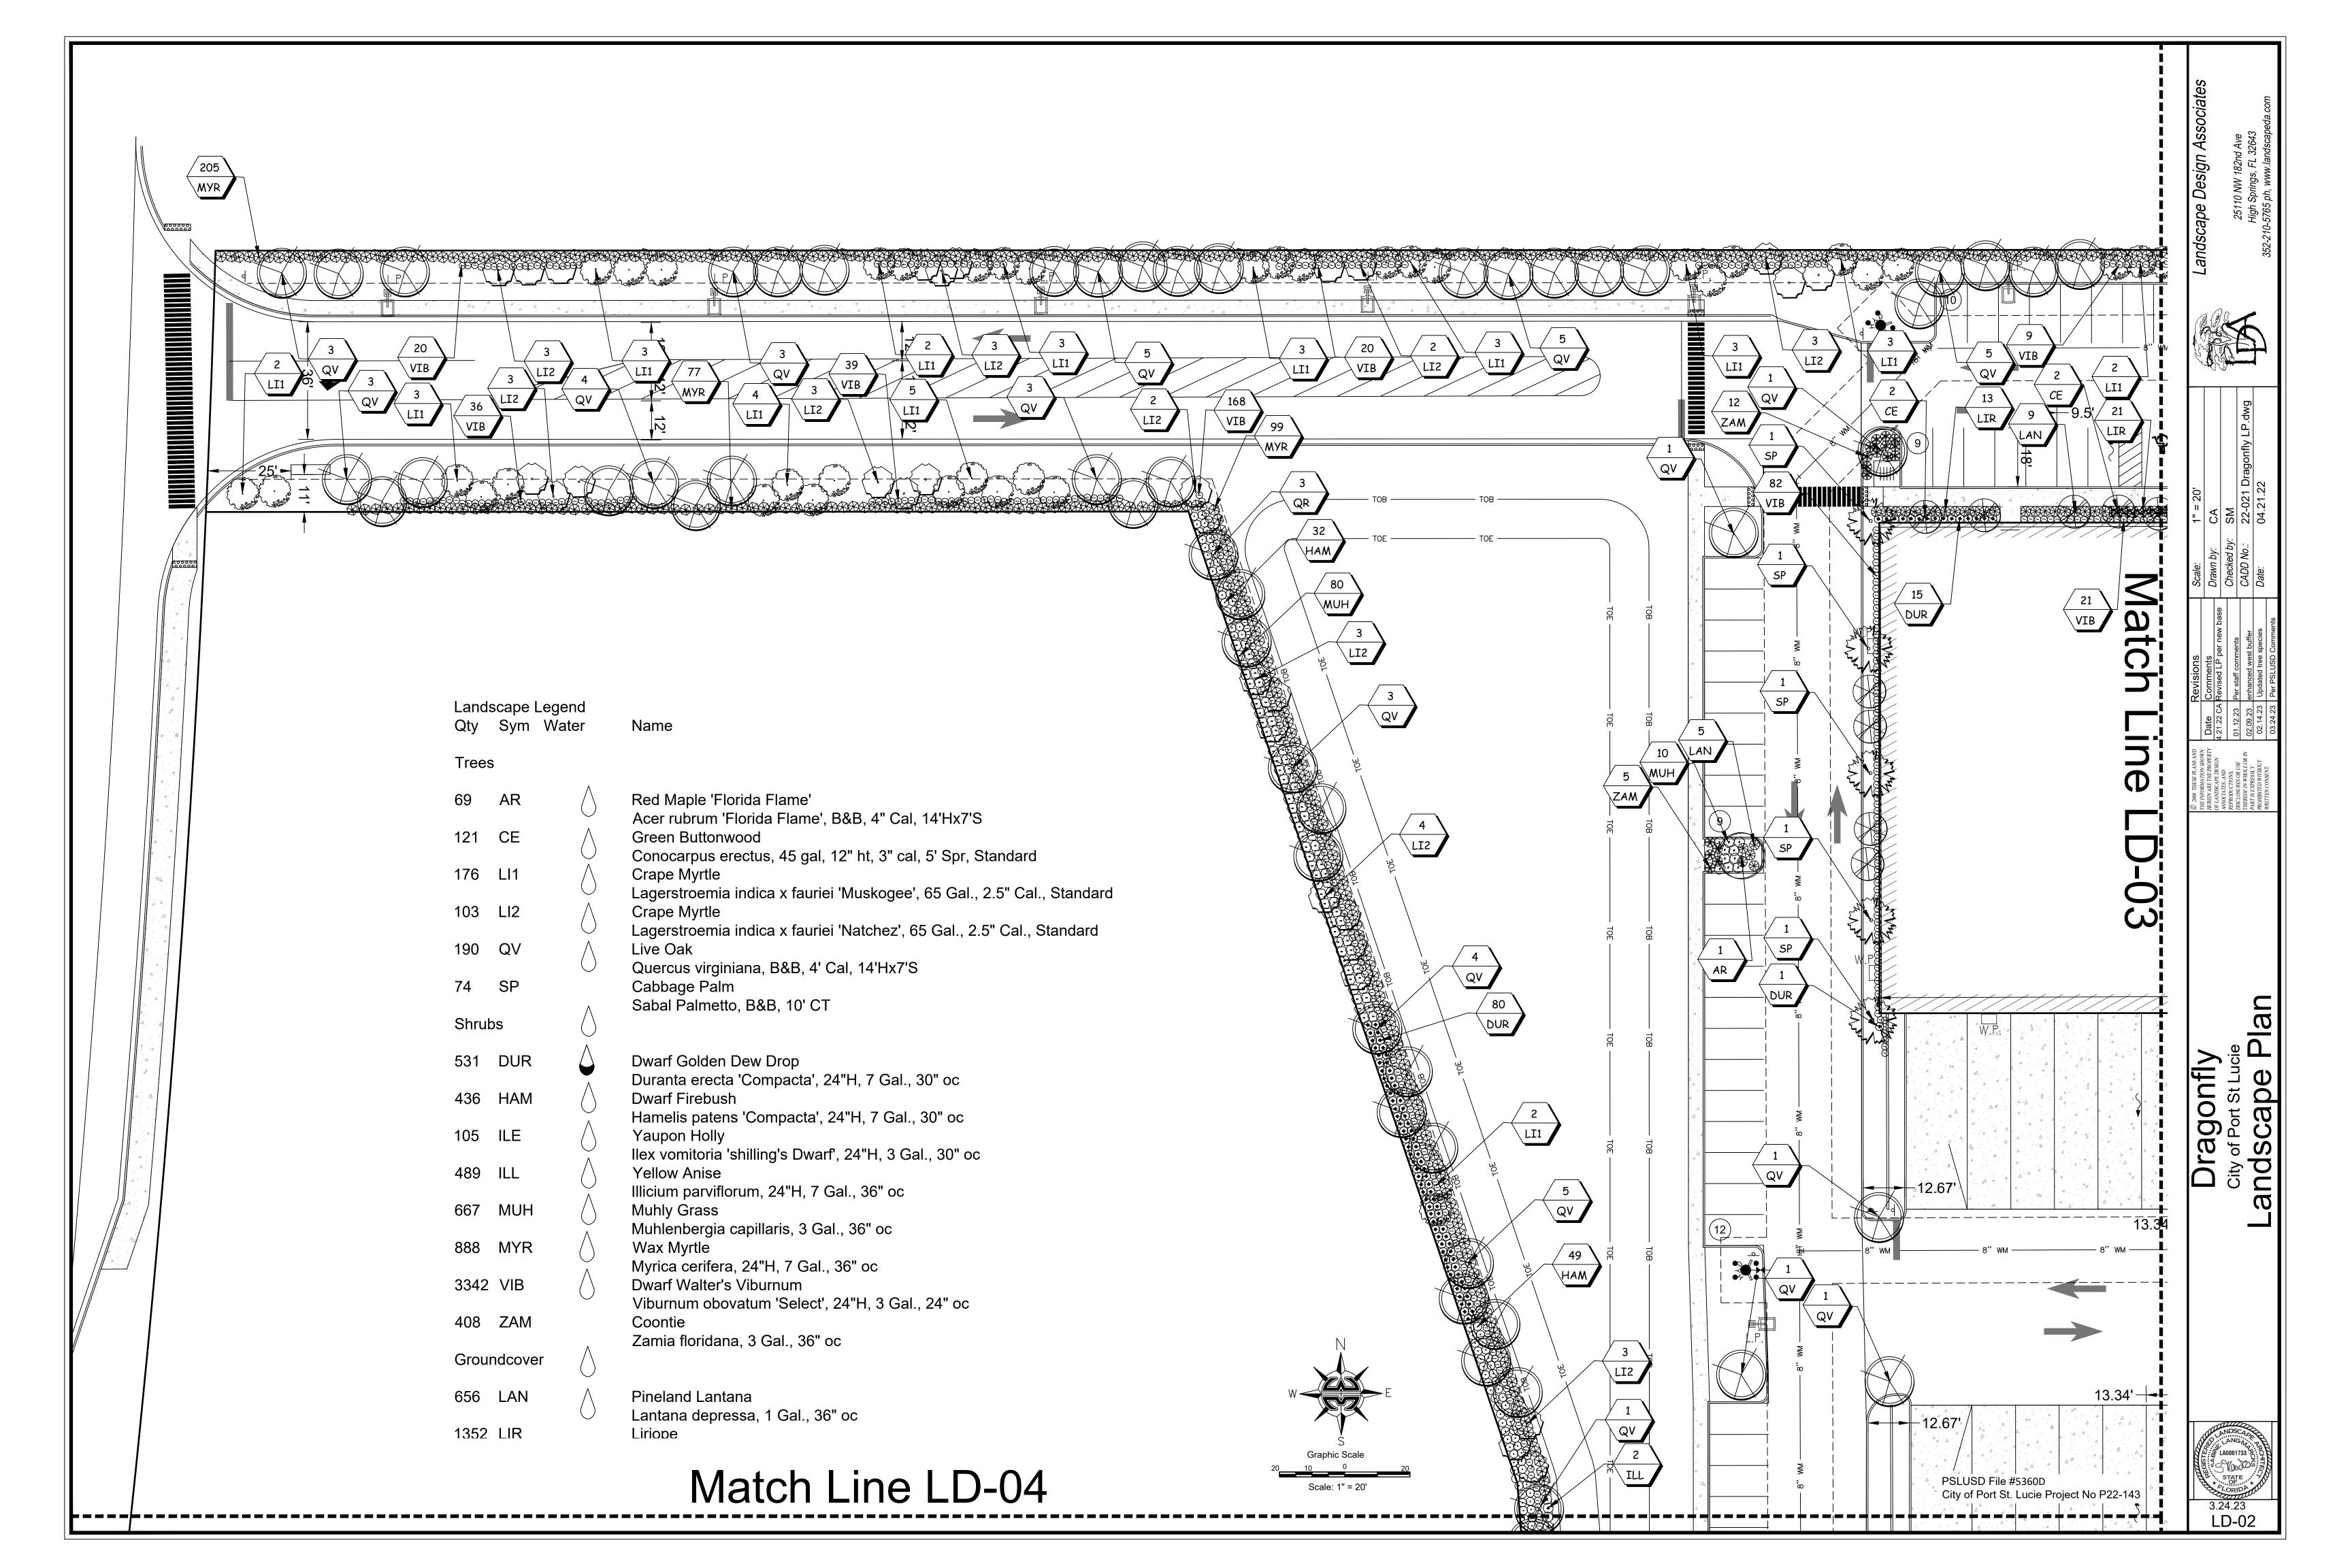


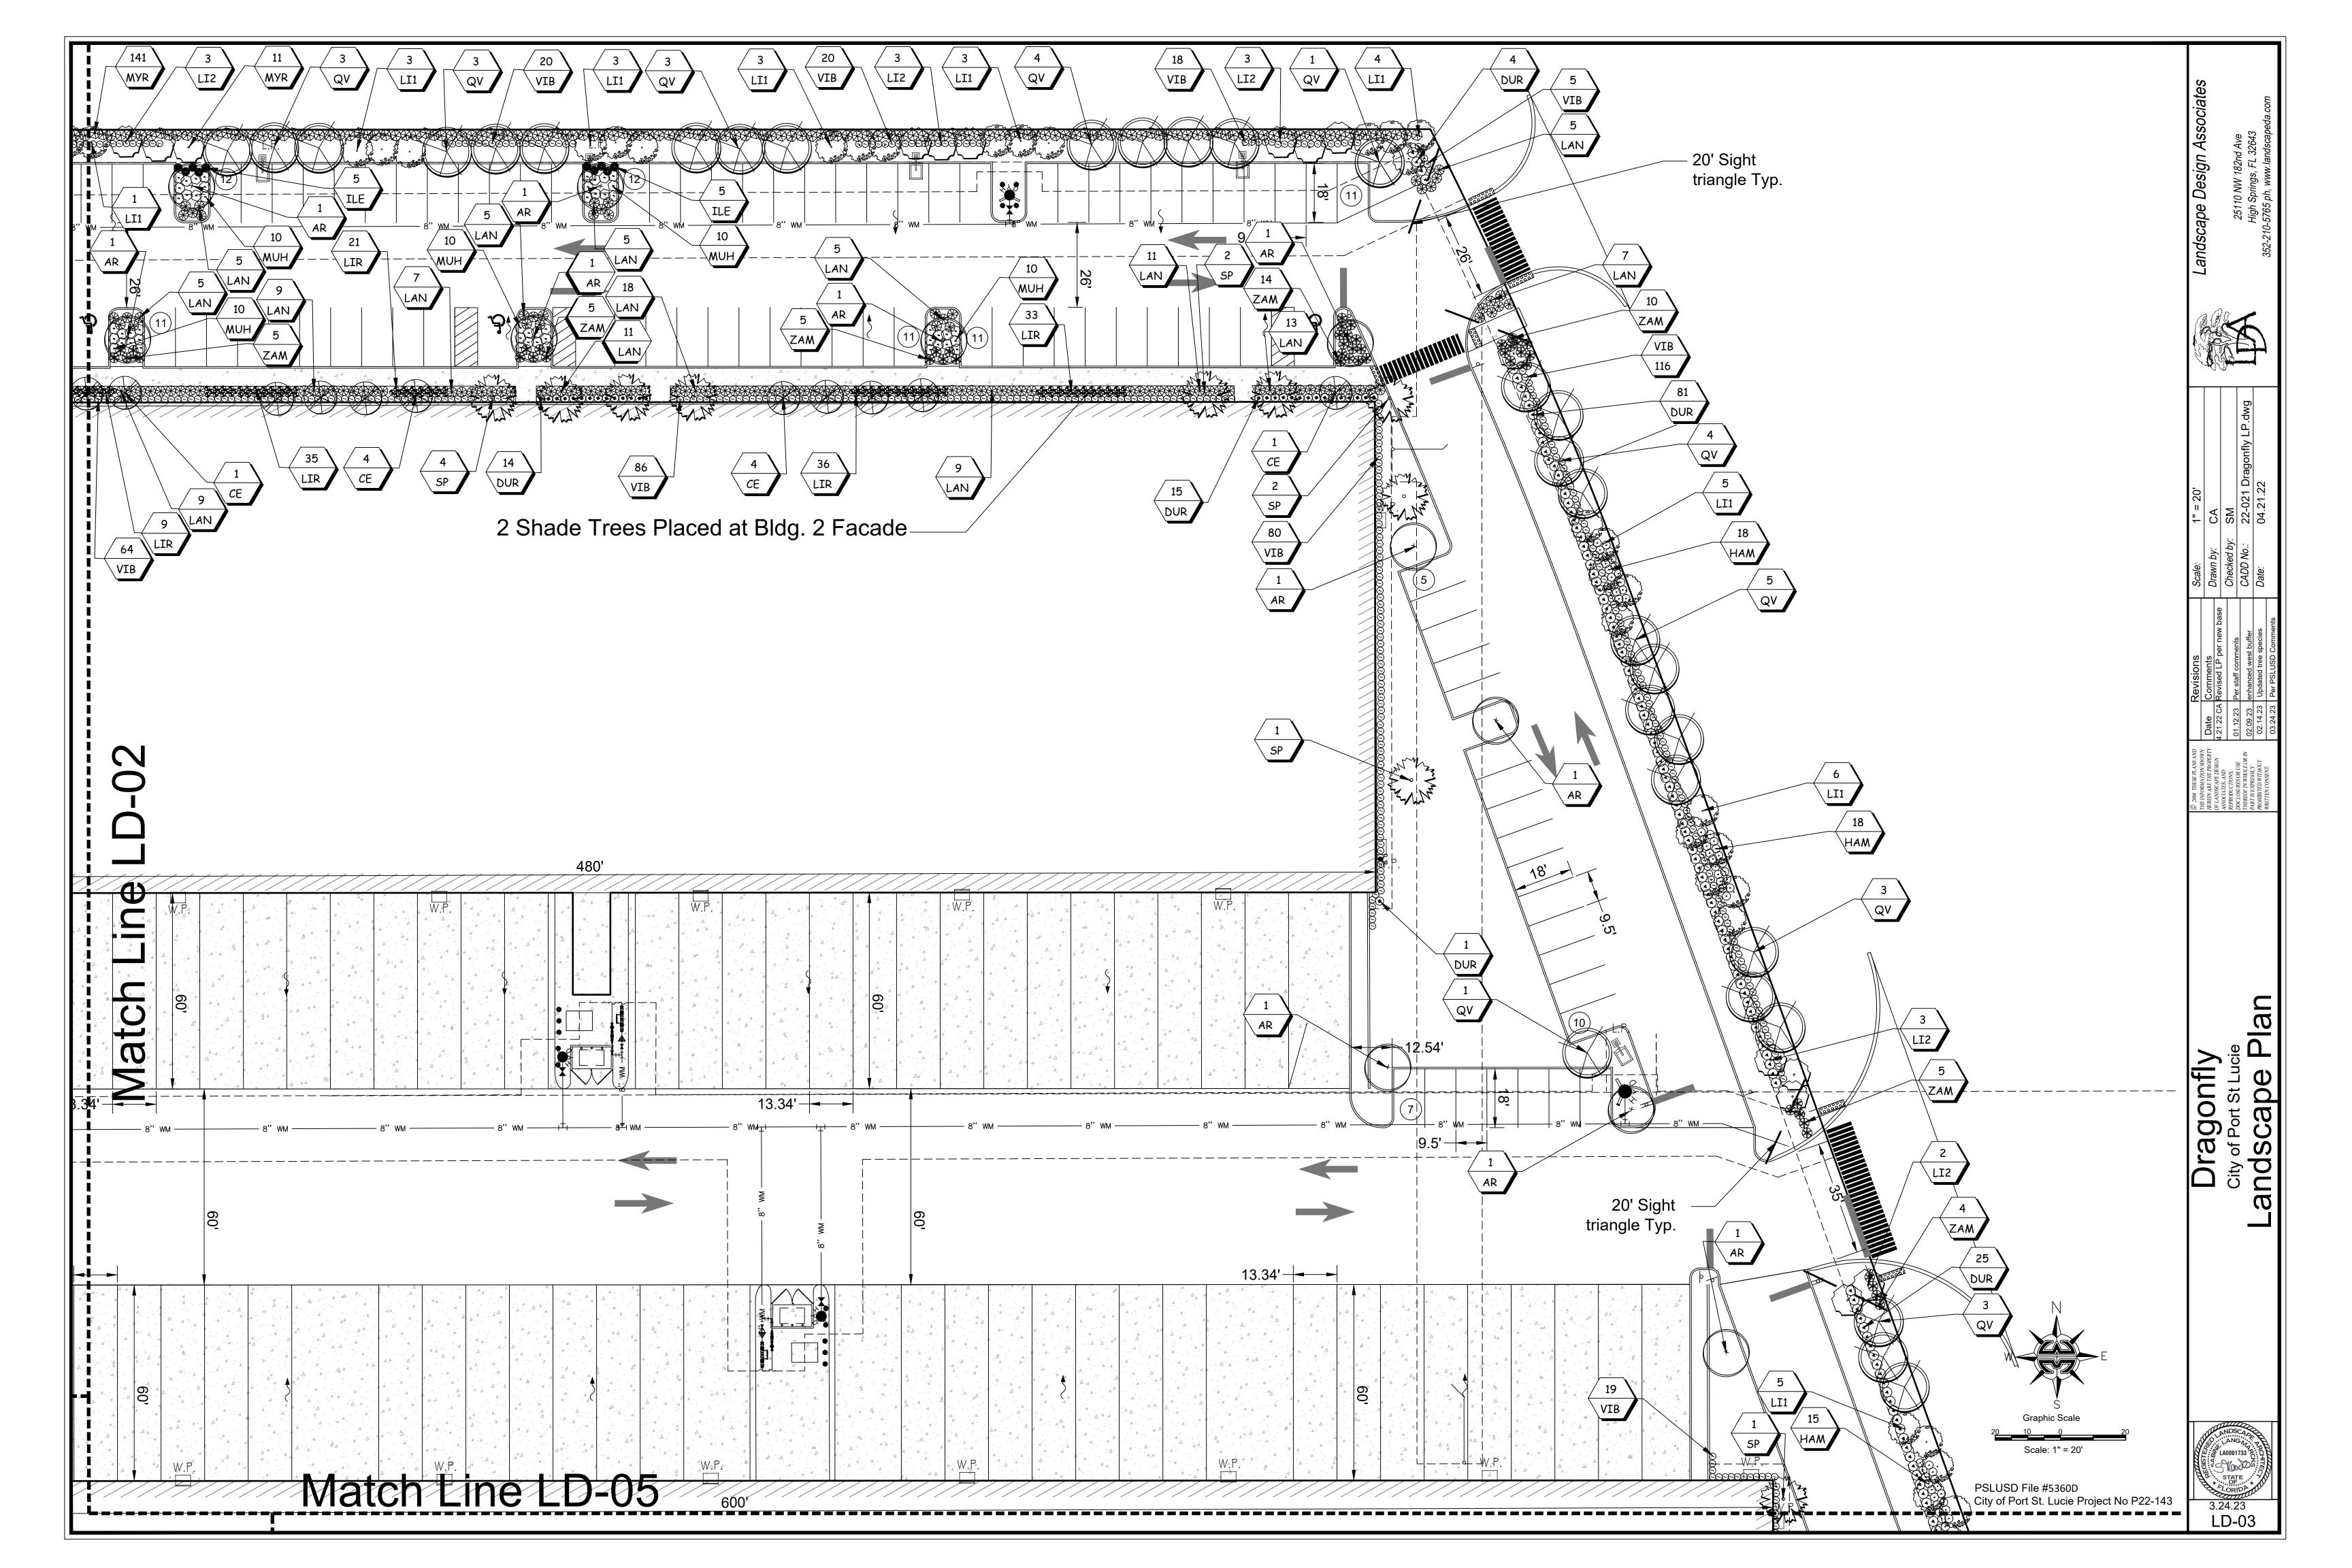

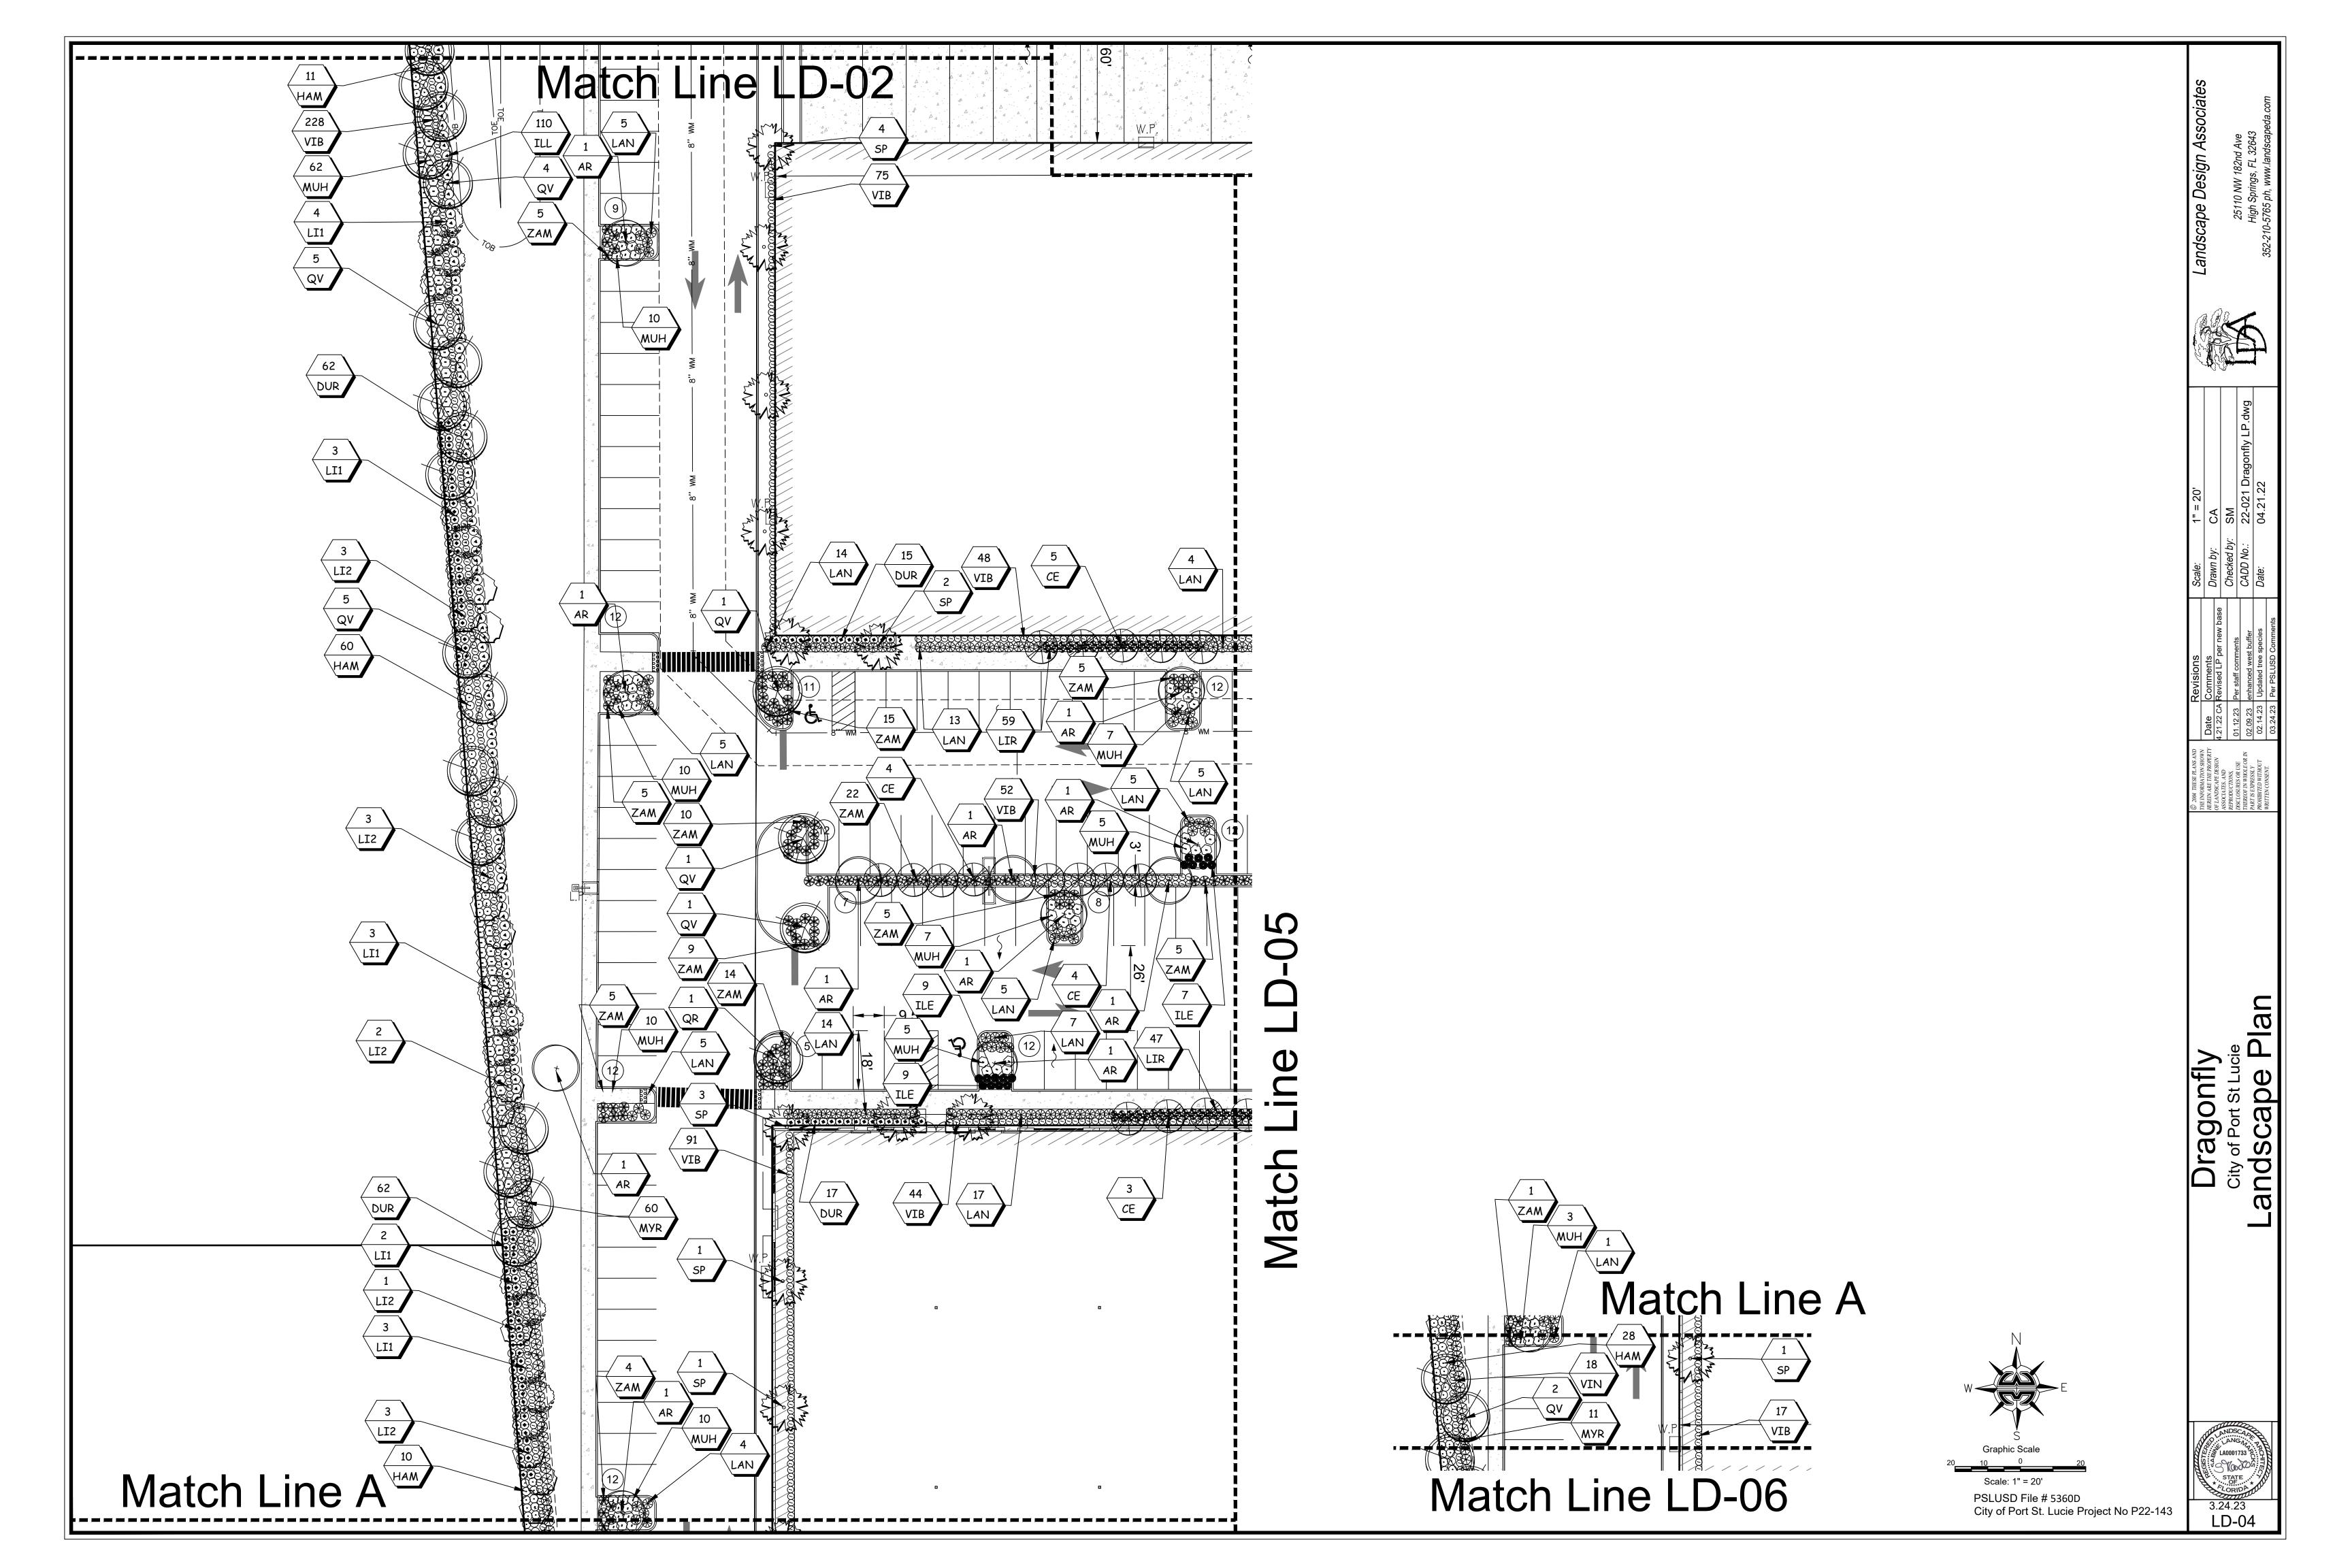

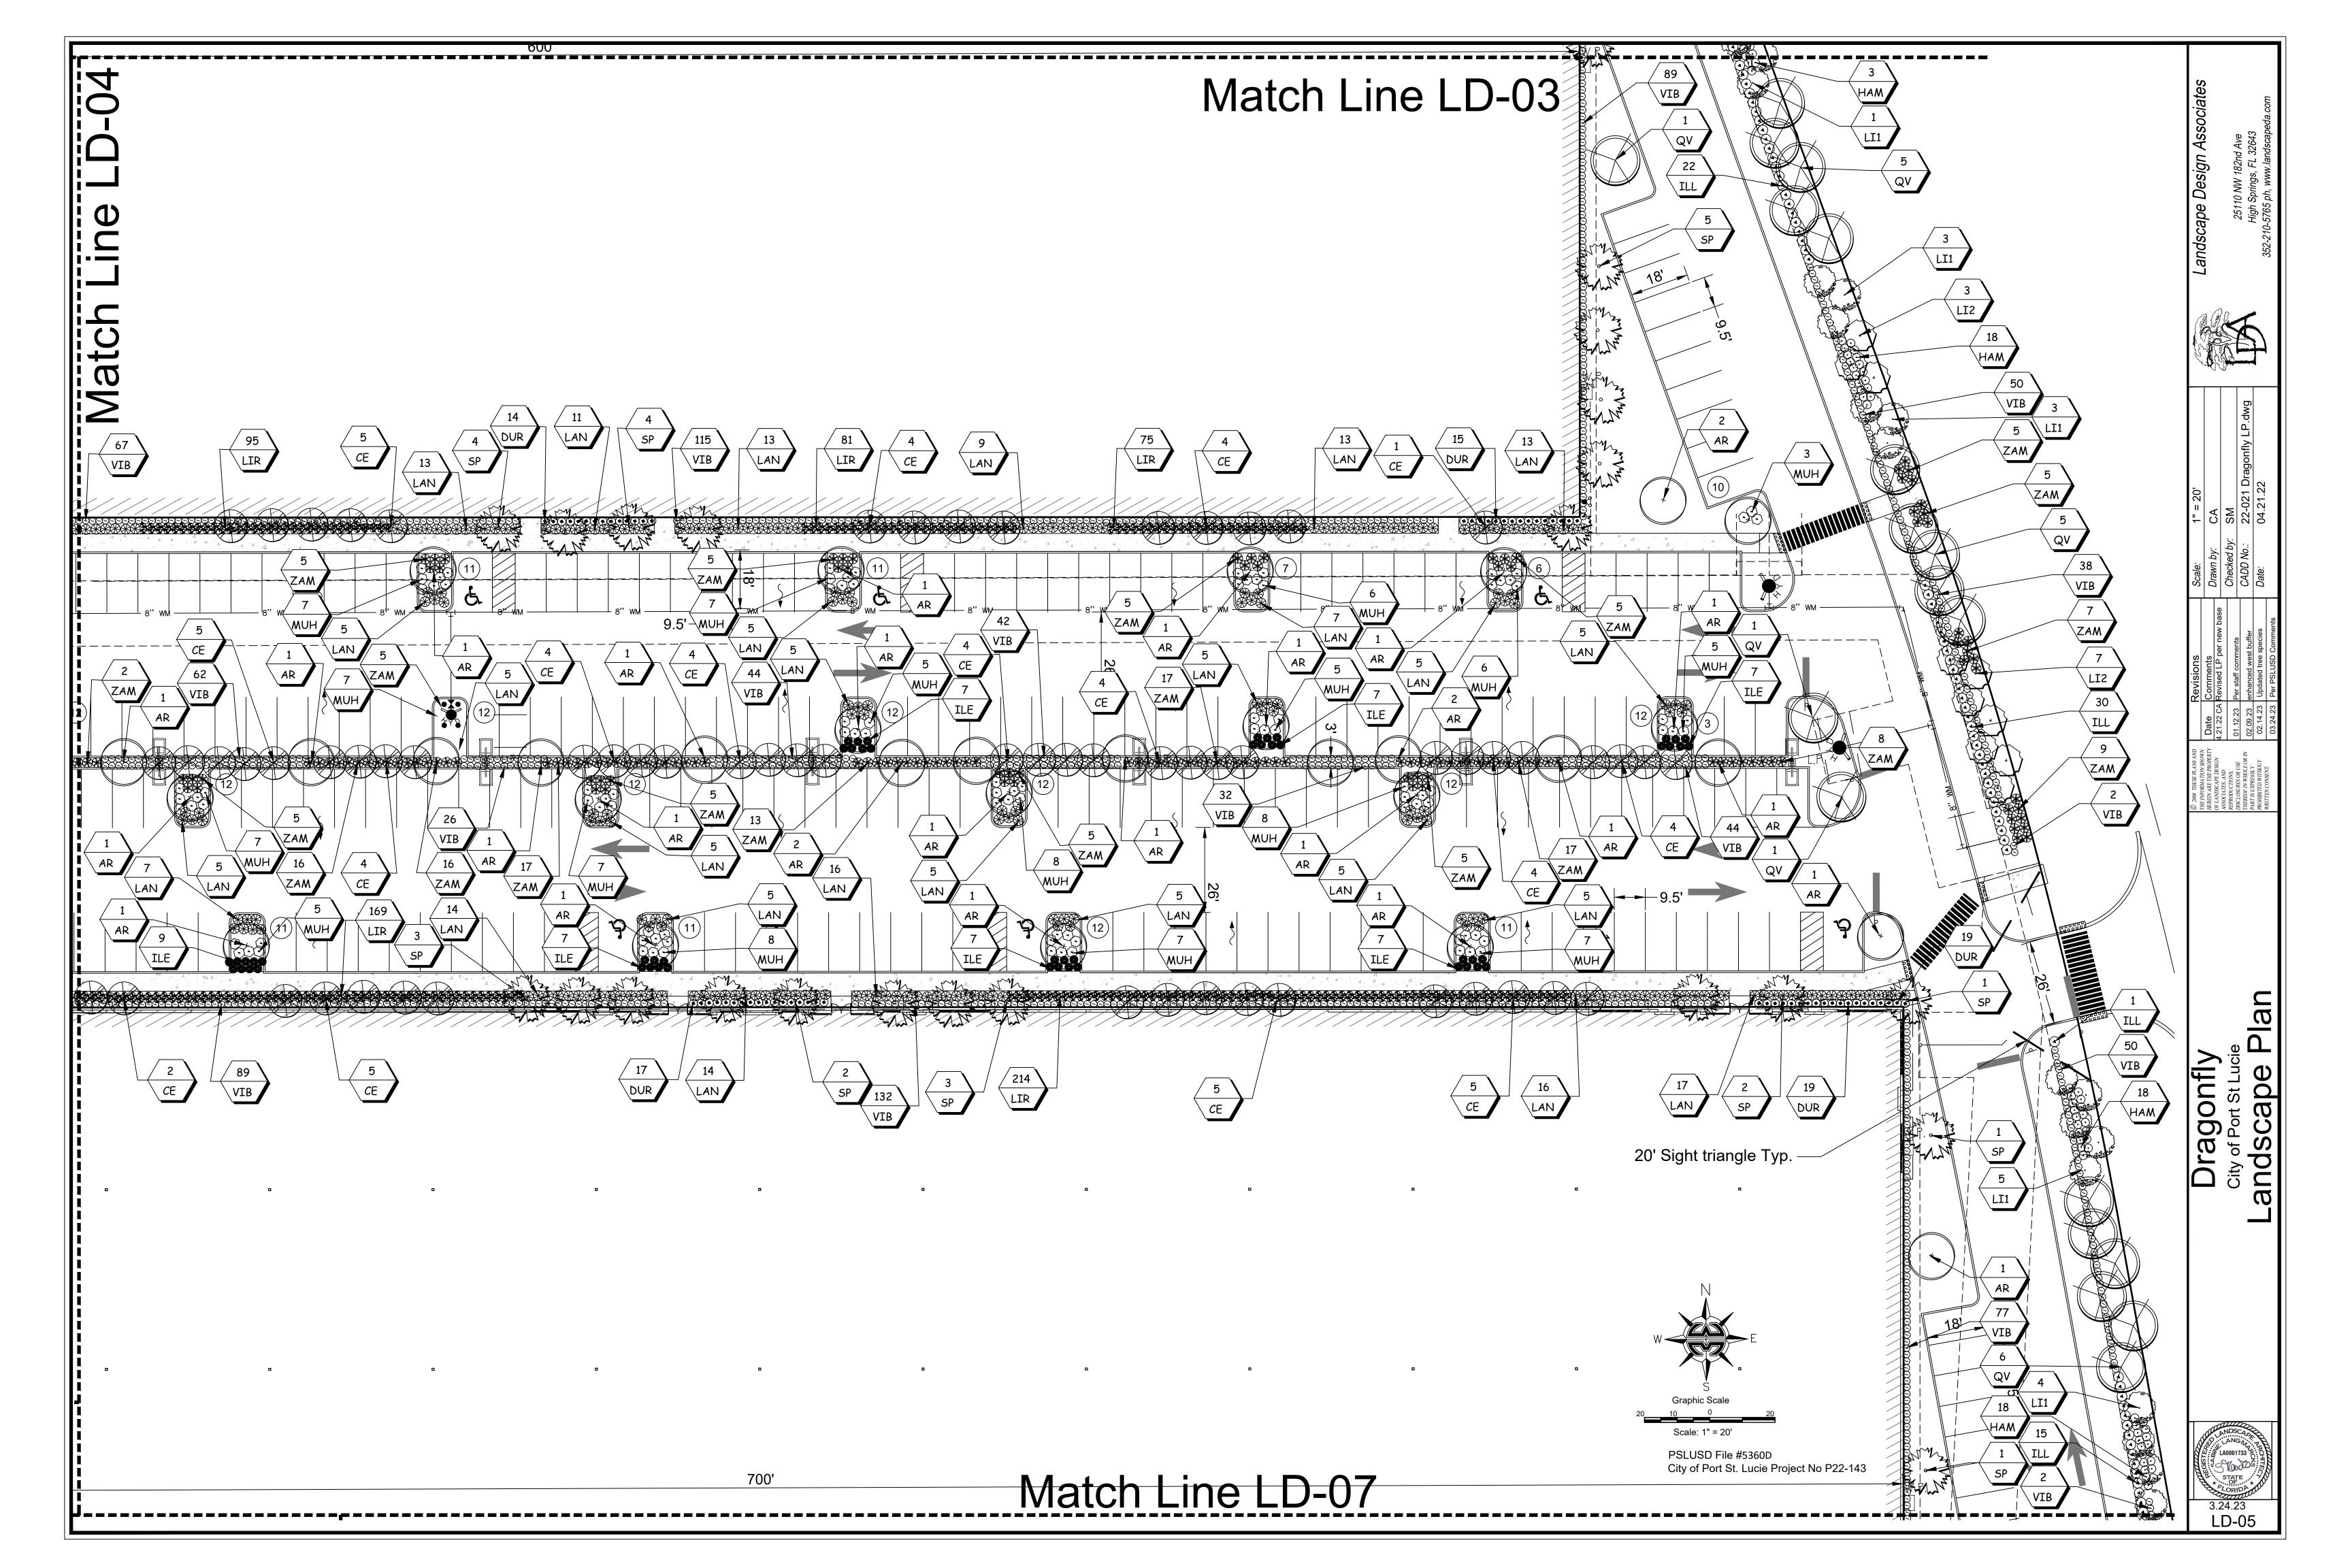

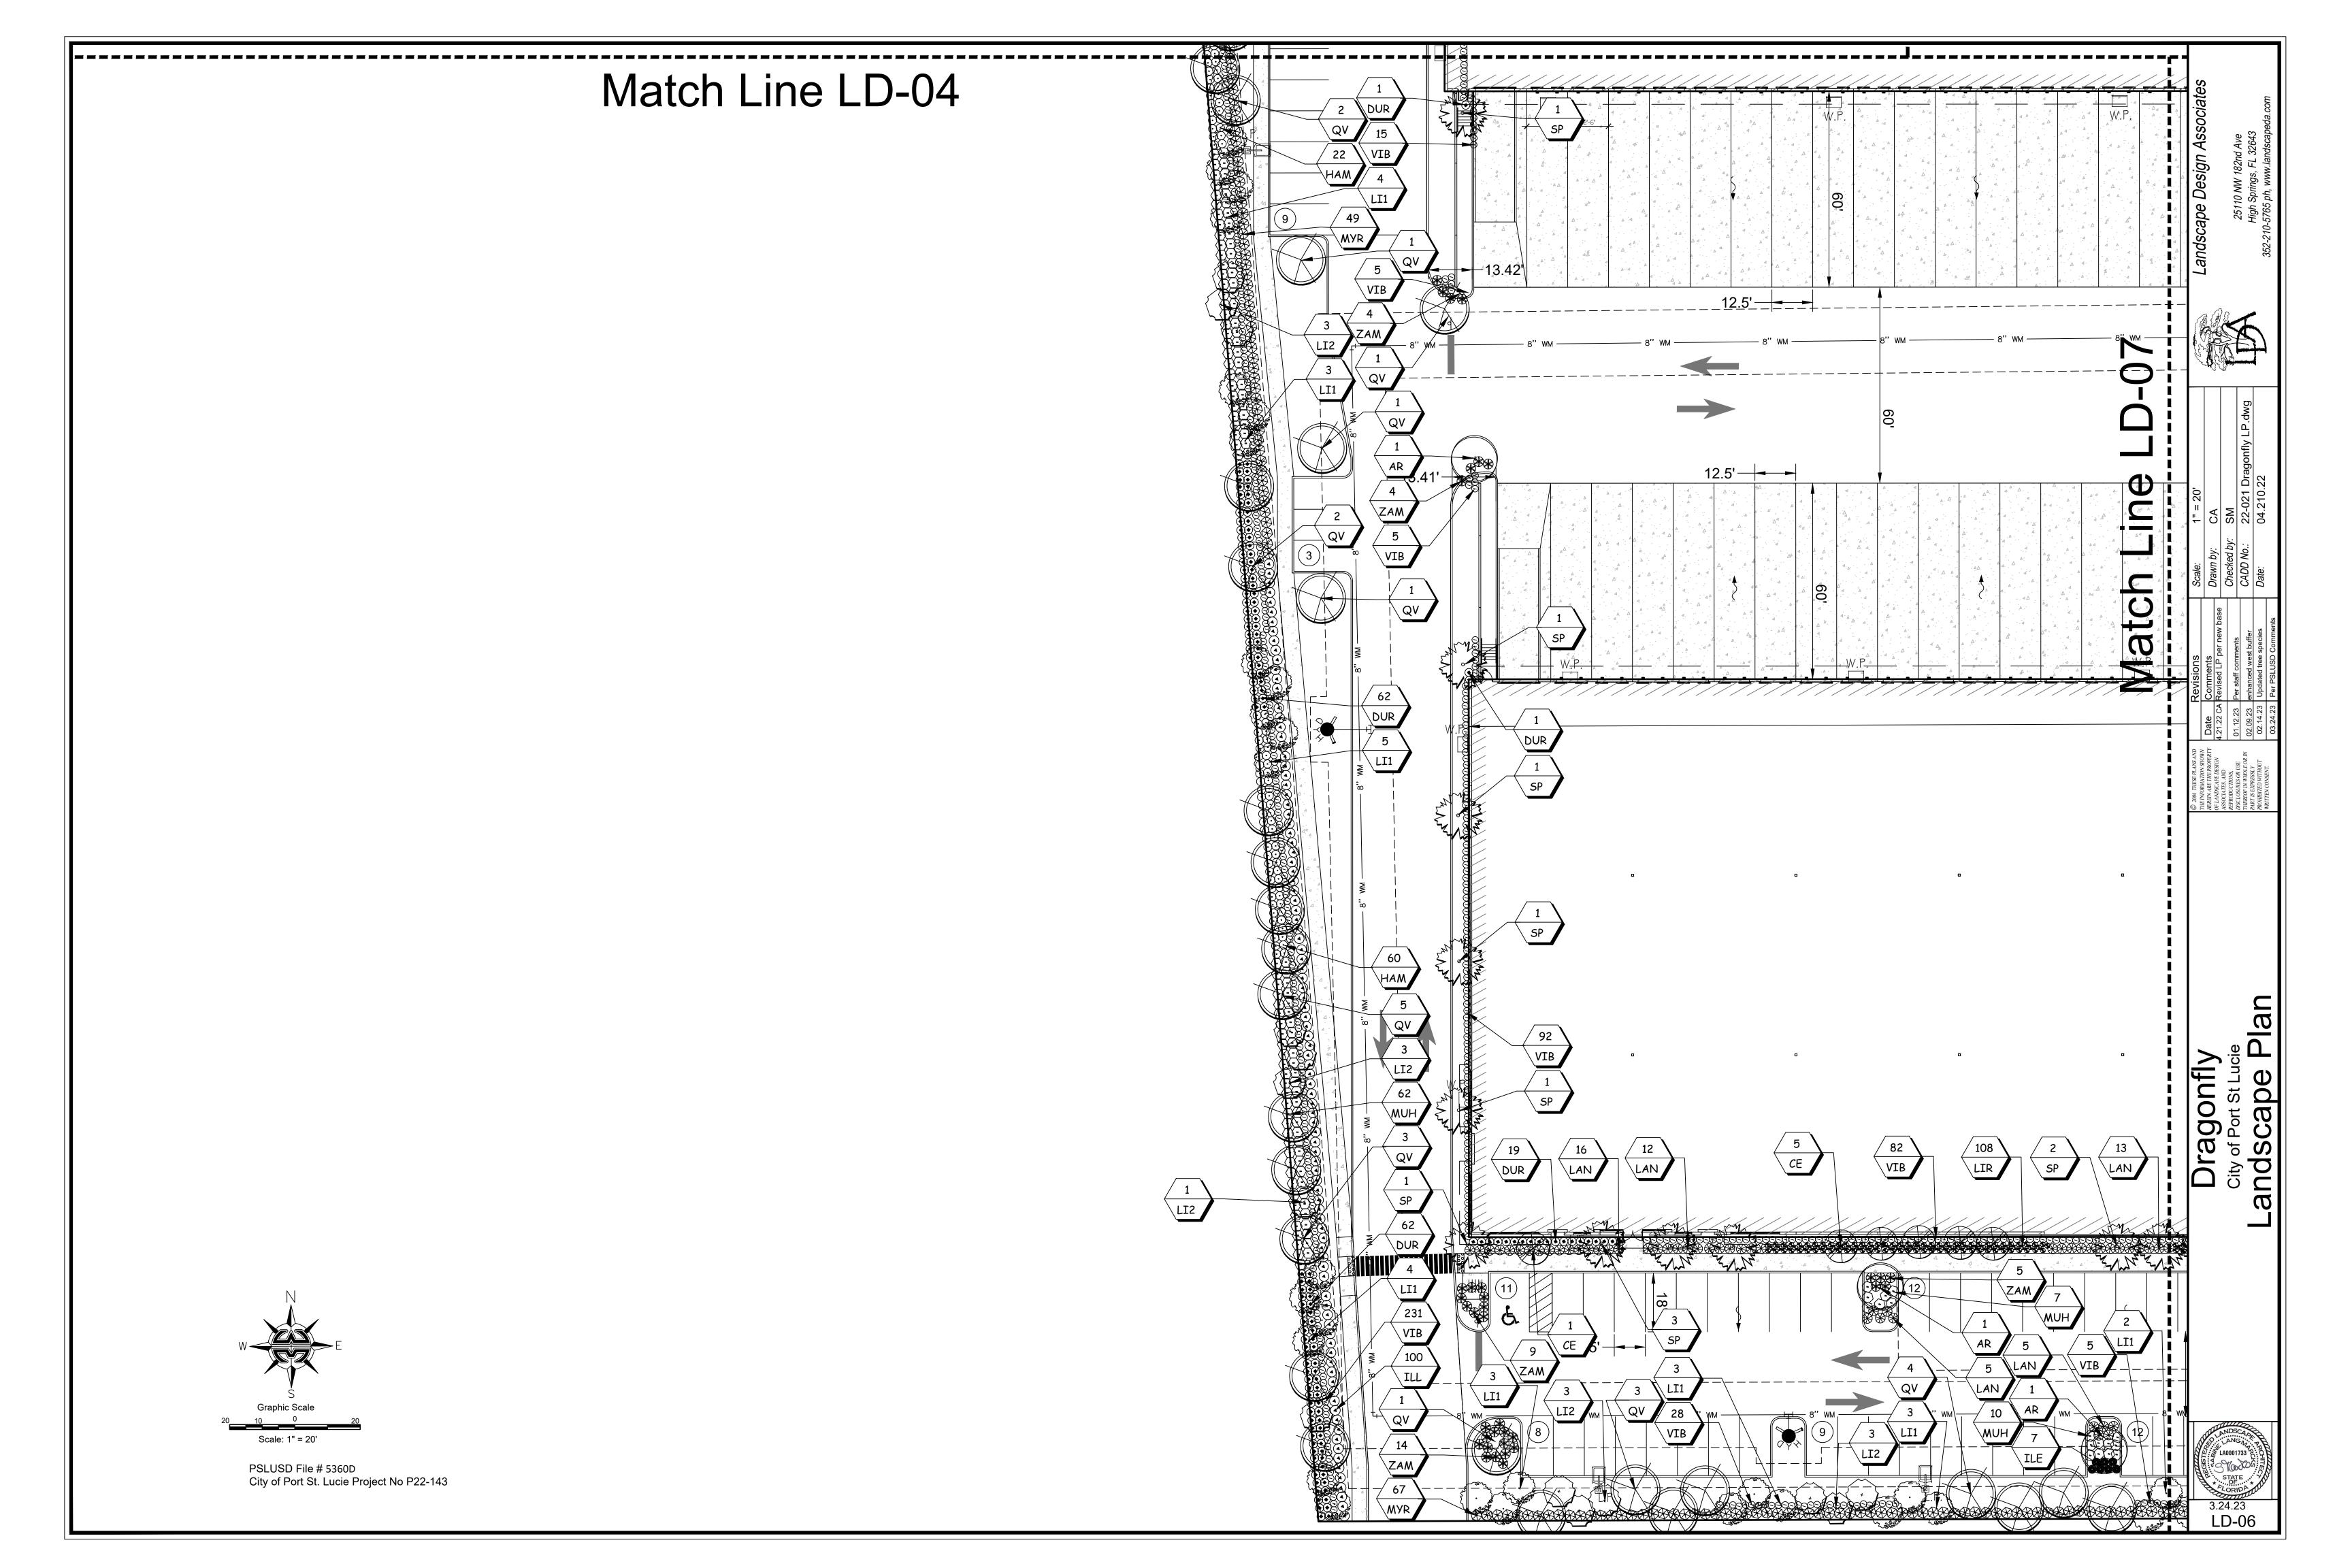

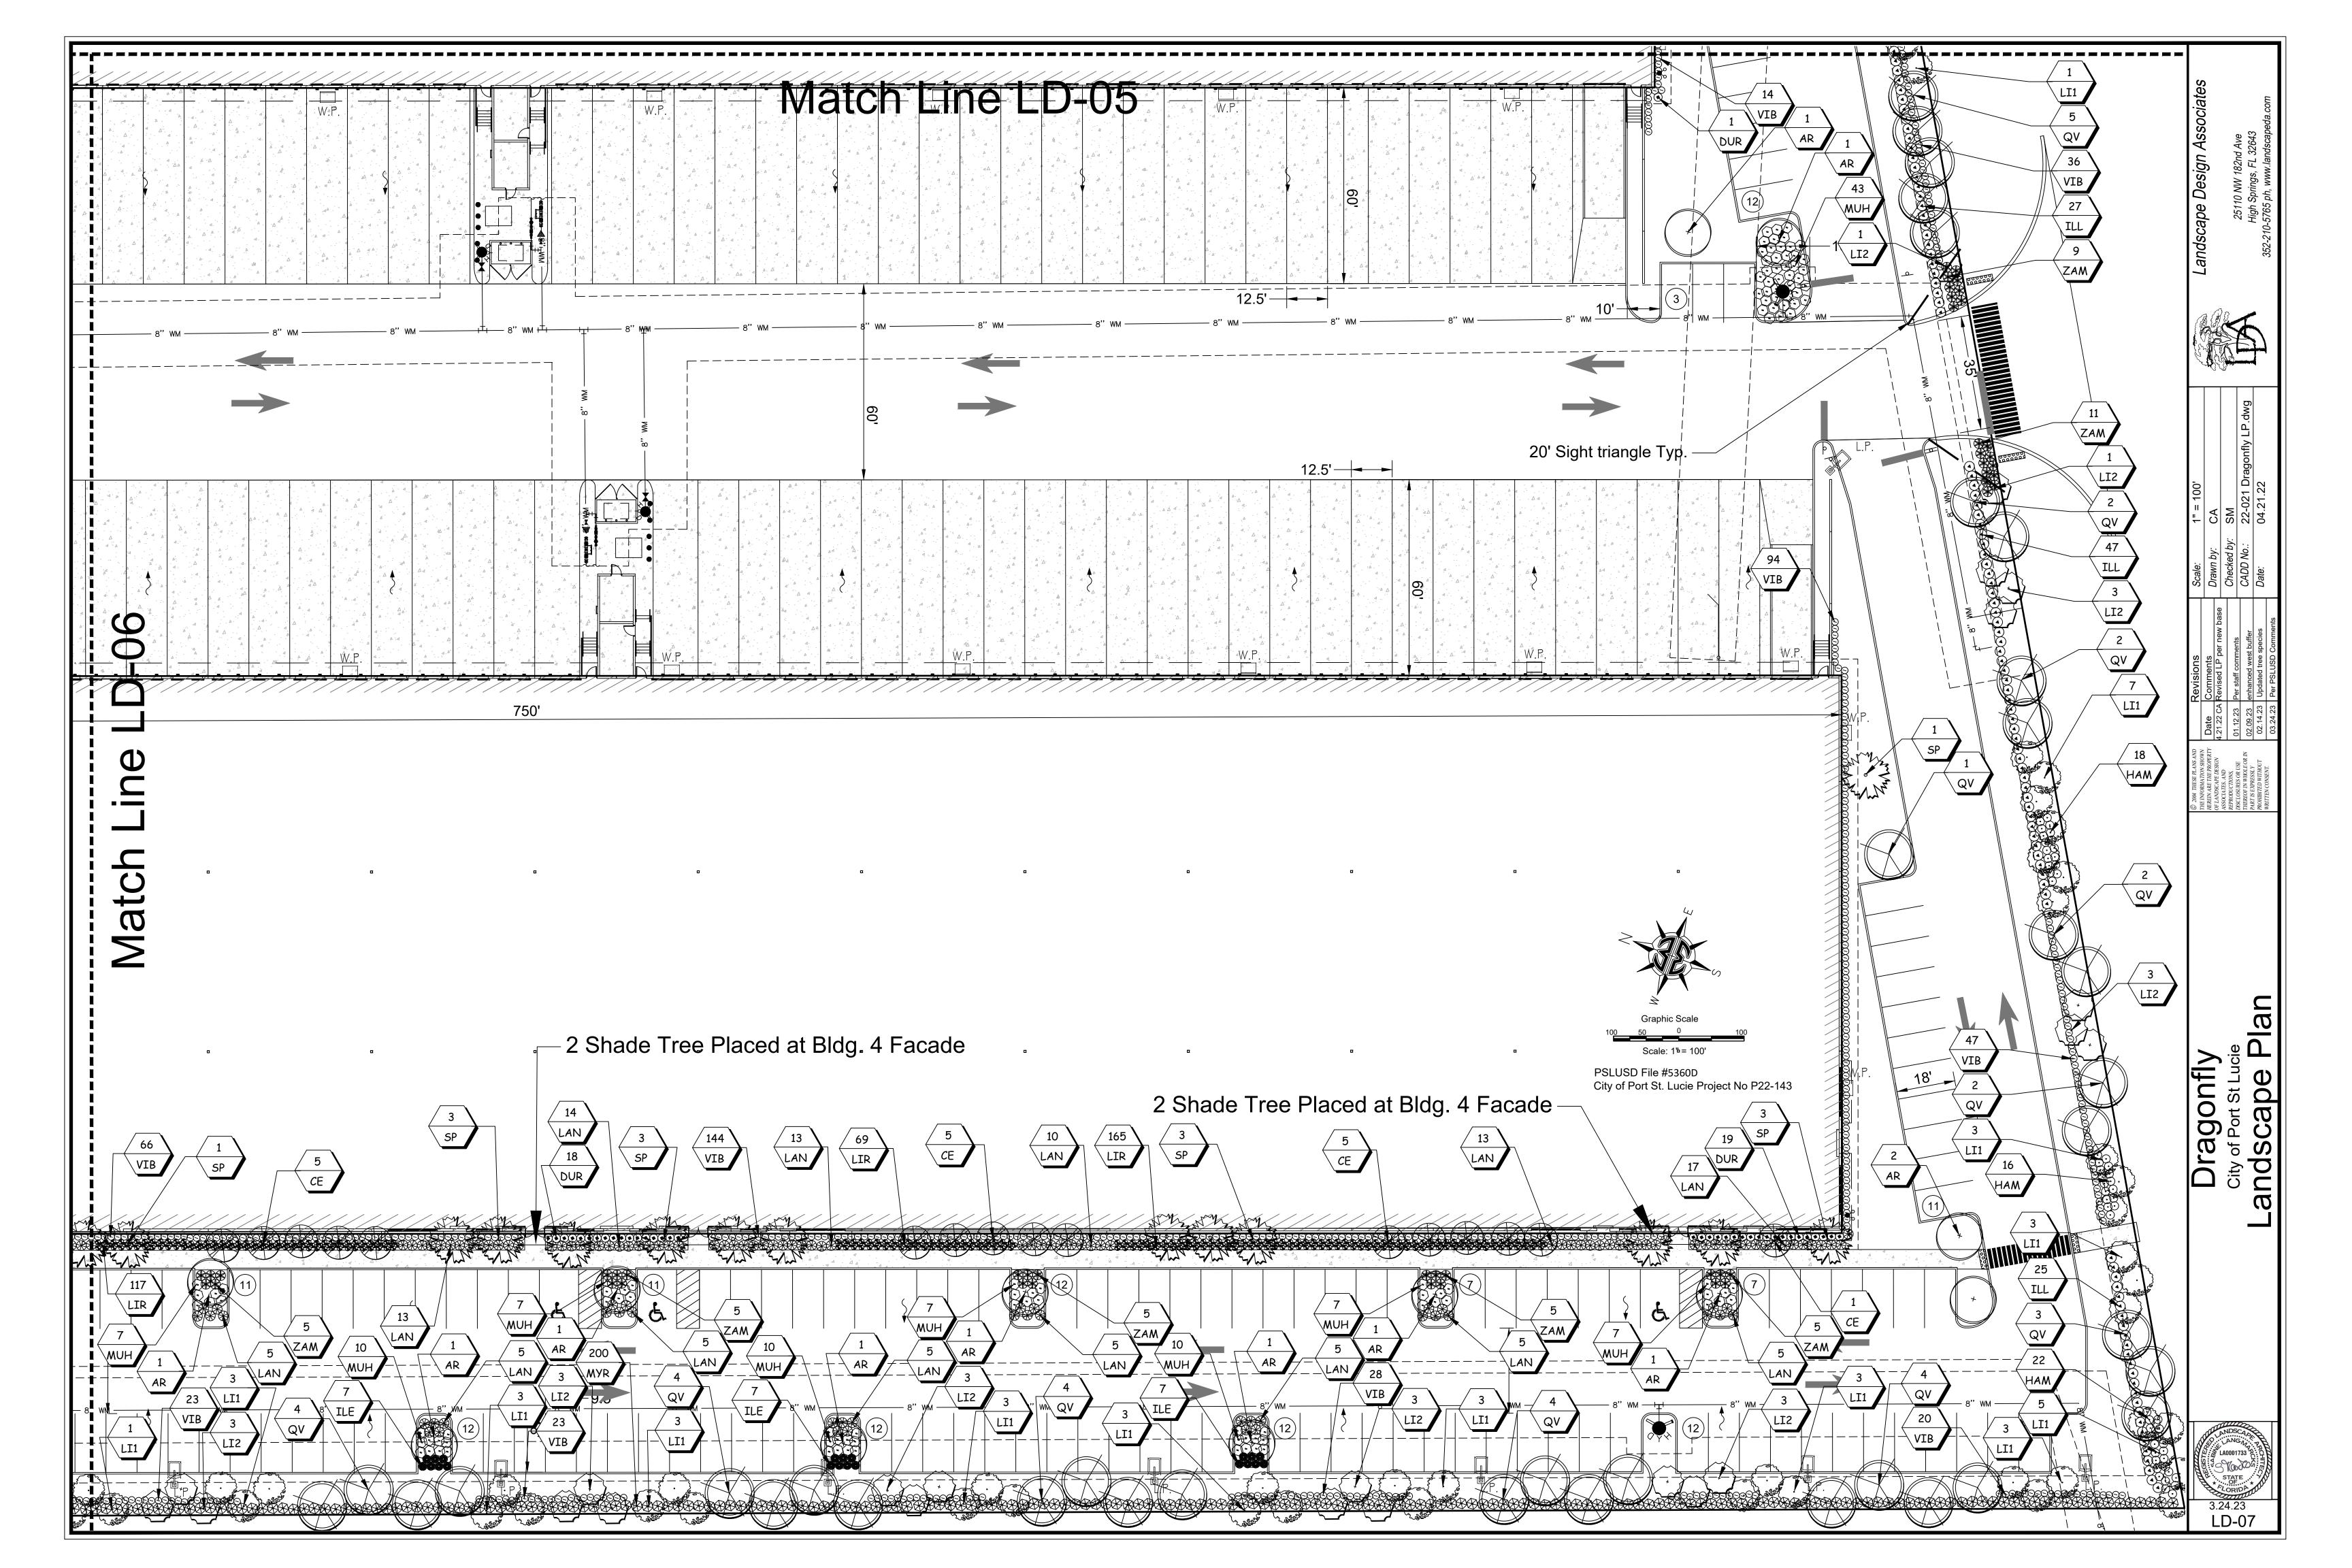

FERTILIZER

FERTILIZERS SHALL BE SLOW RELEASE, UNIFROM IN COMPOSITION, DRY AND FREE FLOWING. THE FERTILIZER SHALL BE DELIVERED TO THE SITE IN THE ORIGINAL UNOPENED BAGS, EACH BEARING THE MANUFACTURERS STATEMENT OF ANALYSIS, AND SHALL MEET THE FOLLOWING REQUIREMENTS: SIX (6) PERCENT NITROGEN, SIX (6) PERCENT PHOSPHOROUS, AND SIX (6) PERCENT POTASSIUM, FERTILIZER SHALL BE APPLIED TO ALL SHRUBS (1/3 LB PER 3 GAL POT, 1/4 LB PER 1 GAL POT) AND GROUNDCOVER. THE SOD STARTER FERTILIZER MIXTURE SHALL BE A 5-10-10 ANALYSIS. A 14-14-14 FERTILIZER ANALYSIS IS REQUIRED ON ALL TREES AND SHRUBS OVER 5' IN HEIGHT (1/2 LB PER 5' OF SPREAD). AGRIFORM TABLETS WITH TWENTY (20) PERCENT NITROGEN, TEN (10) PERCENT PHOSPHOROUS, FIVE (5) PERCENT POTASSIUM IN 21 GRAM SIZES SHALL BE APPLIED ALONG WITH THE FERTILIZER PROCESS (1 WITH 1 GAL PLANTS. 2 WITH 3 GAL PLANTS AND 2 TABLETS PER 1" OF TREE TRUNK CALIPER). MAGNESIUM SULFATE SHALL BE APPLIED TO ALL PALMS AT INSTALLATION AT A RATE OF 1/2 LB PER INCH OF TRUNK CALIPER. MANGANESE SHALL BE APPLIED AT THE SAME RATE.

MULCH

MULCH MATERIAL SHALL BE COLORED 'A' GRADE CERTIFIED RE-CYCLED MULCH AND MOISTENED AT THE TIME OF APPLICATION TO PREVENT WIND DISPLACEMENT. MULCH SHALL BE APPLIED TO A MINIMUM OF 3" DEPTH IN PLANTING BEDS. MULCH SHALL NOT BE PLACED WITHIN 6" OF TREE OR PALM TRUNKS.

THE SOD SHALL BE CERTIFIED TO MEET FLORIDA STATE PLANT BOARD SPECIFICATIONS, ABSOLUTELY TRUE TO VARIETAL TYPE, AND FREE FROM WEEDS, FUNGUS, INSECTS AND DISEASE OF ANY KIND.

SUBSTITUTIONS

NO SUBSTITUTION OF PLANT MATERIAL TYPES OR SIZES WILL BE ALLOWED WITHOUT WRITTEN AUTHORIZATION FROM THE LANDSCAPE ARCHITECT OF RECORD. CONTAINER GROWN MATERIAL WILL NOT BE ACCEPTED AS A SUBSTITUTE FOR B & B MATERIAL UNLESS PREVIOUSLY APPROVED.

INTENDED SUBSTITUTIONS SHALL BE SPELLED OUT IN BID.

MEASUREMENTS

SHADE TREES: HEIGHT SHALL BE MEASURED FROM GROUND TO THE AVERAGE BRANCH HEIGHT OF CANOPY. SPREAD SHALL BE MEASURED TO THE END OF BRANCHING EQUALLY AROUND THE CROWN FROM THE CENTER OF THE TRUNK. MEASUREMENTS ARE NOT TO INCLUDE ANY TERMINAL GROWTH. SINGLE TRUNK TREES SHALL BE FREE OF "V" CROTCHES THAT COULD BE POINTS OF WEAK LIMB STRUCTURE OR DISEASE INFESTATION.

SHRUBS: HEIGHT SHALL BE MEASURED FROM THE GROUND TO THE AVERAGE POINT WHERE MATURE PLANT GROWTH STOPS. SPREAD SHALL BE MEASURED TO THE END OF BRANCHING EQUALLY AROUND THE SHRUB MASS. MEASUREMENT AREA NOT TO INCLUDE ANY TERMINAL

PALMS: CLEAR TRUNK SHALL BE MEASURED FROM THE GROUND AT THE TIME OF INSTALLATION TO THE POINT WHERE THE MATURE AGED TRUNK JOINS THE IMMATURE OR GREEN PORTION OF THE TRUNK OR HEAD.

GREY WOOD (G.W.) - SHALL BE MEASURED FROM THE GROUND AT THE TIME OF INSTALLATION TO TOP OF THE HARDENED TRUNK.

OVERALL HEIGHT (O.A.) - SHALL BE MEASURED FROM THE GROUND AT THE TIME OF INSTALLATION TO THE AVERAGE FROND HEIGHT.

PALMS WITH MARRED OR BURNED TRUNKS WILL NOT BE

ACCEPTED.

To be installed according

to manufacturer's

PLANTING SOIL AND BACKFILL

TOPSOIL SHALL CONSIST OF A STABILIZED MIXTURE OF GROUND YARD TRIMMINGS AND POSSIBLY BIOSOLIDS PROCESSED ACCORDING TO STATE OF FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION GUIDELINES FOR THE PROCESSING AND DISTRIBUTION OF SEWAGE SLUDGE COMPOST. RECYCLED TOPSOIL SHALL ONLY BE OBTAINED FROM A STATE PERMITTED RECYCLING FACILITY WHICH IS ALSO D.O.T. CERTIFIED AND STORES PRODUCT ON A PAD WITH A CURRENT NEMATODE CERTIFICATION FROM FLORIDA DEPARTMENT OF AGRICULTURE. RECYCLED TOPSOIL SHALL HAVE THE FOLLOWING CHARACTERISTICS:

- WEED FREE - MOISTURE CONTENT 50% BY WEIGHT MAXIMUM
- WATER HOLDING CAPACITY 200% BY WEIGHT MINIMUM
 CARBON TO NITROGEN RATIO LESS THAN 25 TO 1
 ORGANIC MATTER CONTENT 40% BY DRY WEIGHT MINIMUM
 SOLUBLE SALTS LESS THAN 3 MMHOS/CM
- PH RANGE 7.0 7.9 - MINIMUM NUTRIENT LEVELS AS FOLLOWS:

- MINIMUM NUTRIENT LEVELS AS FOLLOWS:
MACRO NUTRIENTS: NITROGEN (N) - 1% MINIMUM, WATER INSOLUBLE
NITROGEN 90% MINIMUM, PHOSPHORUS (P) - 0.5% MINIMUM, POTASSIUM (K)
- 0.2% MINIMUM AND OTHER MACRO AND MICRO NUTRIENTS. THE RECYCLED
TOPSOIL SHALL CONTAIN LEVELS OF THOSE MICRO NUTRIENTS NECESSARY
FOR PLANT GROWTH. THESE INCLUDE CALCIUM, MAGNESIUM, SULFUR,
BORON, COPPER, IRON, MANGANESE AND MOLYBDENUM. TOPSOIL NOT
MEETING THESE REQUIREMENTS WILL NOT BE ACCEPTED.

BACKFILL:

ALL NEW AND TRANSPLANTED PLANT MATERIAL (INCLUDING NEW SOD) SHALL BE PLANTED ONLY AFTER PREPARATION OF EXISTING SOIL AS FOLLOWS: SPREAD A LAYER OF 3" DEPTH OF RECYCLED TOPSOIL (AS DEFINED ABOVE) OVER THE ENTIRE PLANTING AREA. THE TOPSOIL SHALL THEN BE UNIFORMLY DISKED, TILLED OR AERIFIED INTO THE EXISTING SOIL TO A DEPTH OF 12" UNDERNEATH SHRUBS AND GROUNDCOVERS, 6" UNDERNEATH SOD AND TO A DEPTH OF 36" FOR THE TREE PITS, WITH THE FOLLOWING EXCEPTION: NO ROTOTILLING OR DISKING SHALL OCCUR CLOSER TO THE TRUNKS OF ESTABLISHED PLANTS THAN ONE HALF (1/2) THE DISTANCE OF THE CANOPY FURTHER OUT FROM THE DRIP LINE OF THE EXISTING PLANT CANOPY. ALL PLANTS, INCLUDING HEDGES AND GROUND COVER SHALL BE PLANTED IN INDIVIDUALLY DUG HOLES AND THE MATERIAL DUG FROM THE HOLES SHALL THEN BE FURTHER MIXED WITH THE PREPARED SITE SOIL PRIOR TO BACKFILLING OF THE PLANTING HOLES AROUND THE ROOT BALLS. NO ADDITIONAL BACKFILL SOIL SHALL BE USED. AN EXCEPTION ARE PLANTING PITS FOR CABBAGE PALMS, WHICH SHALL BE BACKFILLED WITH CLEAN NATIVE SAND ONLY.

REMOVE EXCESS MATERIAL TO PROVIDE PROPER FINISHED GRADE.

PLANT MATERIALS TREES, PALMS, SHRUBS, GROUND COVERS:

PLANT SPECIES AND SIZES SHALL CONFORM TO THOSE INDICATED IN THE DRAWINGS. NOMENCLATURE SHALL CONFORM TO STANDARDIZED PLANT NAMES, 1942 EDITION. ALL NURSERY STOCK SHALL BE IN ACCORDANCE WITH GRADES AND STANDARDS FOR NURSERY PLANTS, PARTS I & II, LATEST EDITION PUBLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND

CONSUMER SERVICES, UNLESS SPECIFIED OTHERWISE, ALL PLANTS SHALL BE

NORMAL FOR THE VARIETY AND FLORIDA GRADE NUMBER 1 OR BETTER AS

DETERMINED BY THE FLORIDA DIVISION OF PLANT INDUSTRY.

SPECIMEN MEANS AN EXCEPTIONALLY HEAVY, SYMMETRICAL. TIGHTLY KNIT PLANT, SO TRAINED OR FAVORED IN ITS DEVELOPMENT THAT FIRST APPEARANCE IS UNQUESTIONABLE AND IT IS OUTSTANDINGLY SUPERIOR IN FORM, NUMBER OF BRANCHES, COMPACTNESS AND SYMMETRY.

ALL PLANTS SHALL BE FRESHLY DUG, SOUND, HEALTHY, VIGOROUS, WELL BRANCHED AND FREE OF DISEASE AND INSECT EGGS AND LARVAE AND SHALL HAVE ADEQUATE ROOT SYSTEMS. TREES FOR PLANTING ROWS SHALL BE UNIFORM IN SIZE AND SHAPE. ALL MATERIALS SHALL BE SUBJECT TO APPROVAL BY THE LANDSCAPE ARCHITECT, WHERE REQUIREMENTS ARE OMITTED FROM THE PLANT LIST. PLANTS SHALL BE PRUNED PRIOR TO DELIVERY ONLY UPON THE APPROVAL OF THE LANDSCAPE ARCHITECT.

ALL CONTAINER GROWN MATERIAL SHALL BE HEALTHY, VIGOROUS, WELL ROOTED PLANTS AND ESTABLISHED IN THE CONTAINER IN WHICH THEY ARE SOLD. THE PLANTS SHALL HAVE TOPS OF GOOD QUALITY AND BE IN HEALTHY GROWING CONDITION. AN ESTABLISHED CONTAINER GROWN PLANT SHALL BE TRANSPLANTED INTO A CONTAINER AND GROWN IN THAT CONTAINER SUFFICIENTLY LONG ENOUGH FOR THE NEW FIBROUS ROOTS TO HAVE DEVELOPED SO THAT THE ROOT MASS WILL RETAIN ITS SHAPE AND HOLD TOGETHER WHEN REMOVED FROM THE CONTAINER.

Diamater of Hole is to be 3x larger than


diamater of root ball

GENERAL NOTES:

- THE CONTRACTOR SHALL PERSONALLY ACQUAINT HIM/HER SELF WITH THE EXISTING SITE CONDITIONS AND THE EXTENT AND SCOPE OF WORK REQUIRED.
- 2. THE PLANT LIST INDICATES THE NAMES, SIZES AND SPACING OF SPECIFIC PLANT MATERIALS. QUANTITIES HAVE BEEN PROVIDED TO THE CONTRACTOR AS A CONVENIENCE, THE CONTRACTOR IS RESPONSIBLE FOR HIS/HER OWN QUANTITY COUNT. IN CASE OF DISCREPANCIES BETWEEN THE DRAWINGS AND PLANT LIST, THE QUANTITIES ON THE PLANT LIST SHALL PREVAIL.
- 3. NO SUBSTITUTES ON VARIETIES LISTED WILL BE ALLOWED WITHOUT WRITTEN APPROVAL FROM LANDSCAPE ARCHITECT.

 4. PLANTS SHALL BE WATERED AS NECESSARY OR WITHIN 24 HOURS AFTER NOTIFICATION BY THE LANDSCAPE ARCHITECT.
- 5. THE LOCATIONS OF PLANTS, AS SHOWN IN THESE PLANS, ARE APPROXIMATE. THE FINAL LOCATIONS MAY BE ADJUSTED TO ACCOMMODATE UNFORESEEN FIELD CONDITIONS. MAJOR ADJUSTMENTS TO THE LAYOUT ARE TO BE APPROVED BY THE LANDSCAPE ARCHITECT OF RECORD.
- ALL PLASTIC FABRIC SHALL BE REMOVED FROM PLANT MATERIAL AT TIME OF INSTALLATION.
 ALL TREES MUST BE STAKED AS SHOWN ON THE LANDSCAPE DETAIL SHEET WITHIN 24 HRS OF PLANTING. STAKES TO REMAIN FOR A MINIMUM OF 12 MONTH BUT NO LONGER THAN 18 MONTH. CONTRACTOR RESPONSIBLE FOR MAINTENANCE AND REMOVAL OF THE STAKES.
- 8. ALL TREES MUST BE PRUNED AS PER LANDSCAPE ARCHITECT DIRECTION.
- 9. ALL SOD EDGES SHALL BE TRIMMED AS PER THE LANDSCAPE ARCHITECTS DIRECTION.
 10. ALL SHRUBS, TREES, GROUNDCOVERS, AND SOD AREAS SHALL HAVE IMPROVED SOIL AS PER PLANTING SOIL NOTES.
- WILDFLOWER AREAS SHALL BE NATIVE TOPSOIL ONLY.

 11. DO NOT ALLOW AIR POCKETS TO FROM WHEN BACKFILLING.
- 12. SOAK PLANTS IMMEDIATELY WITH WATER FOLLOWING PLANTING.
- 13. MAINTAIN THE ORIGINAL GRADE OF THE TREE BASE.
- 14. DO NOT BREAK ROOTBALL, SHAVE ROOTBALL OF TREES PER DETAIL BELOW.
- ALL PLANTS SHALL BE HARDY UNDER CLIMATIC CONDITIONS SIMILAR TO THOSE ON LOCALITY OF THE PROJECT.
 THE LANDSCAPE CONTRACTOR SHALL WATER, MULCH, WEED, PRUNE,, AND OTHERWISE MAINTAIN ALL PLANTS, INCLUDING SOD, UNTIL COMPLETION OF THE CONTRACT OR ACCEPTANCE BY THE LANDSCAPE ARCHITECT. SETTLED PLANTS SHALL BE RESET TO PROPER GRADE, PLANTING SAUCERS RESTORED, AND DEFECTIVE WORK CORRECTED.
- 17. THE LANDSCAPE CONTRACTOR SHALL AT ALL TIMES KEEP THE PREMISES FREE FROM ACCUMULATION OF WASTE MATERIALS OR DEBRIS CAUSED BY THE CREWS DURING THE PERFORMANCE OF THE WORK. UPON COMPLETION OF THE WORK, THE CONTRACTOR SHALL PROMPTLY REMOVE ALL WASTE MATERIALS, DEBRIS, UNUSED PLANT MATERIAL, EMPTY PLANT CONTAINERS AND ALL EQUIPMENT FROM THE PROJECT SITE.
- 18. UPON COMPLETION OF THE WORK, THE LANDSCAPE CONTRACTOR SHALL NOTIFY THE LANDSCAPE ARCHITECT AND REQUEST A FINAL INSPECTION. ANY ITEMS THAT ARE JUDGED INCOMPLETE OR UNACCEPTABLE BY THE LANDSCAPE ARCHITECT OR REPRESENTATIVE SHALL BE PROMPTLY CORRECTED BY THE LANDSCAPE CONTRACTOR.
- 19. THE LANDSCAPE CONTRACTOR SHALL GUARANTEE ALL PLANT MATERIAL FOR A PERIOD OF ONE (1) YEAR FROM THE DATE OF FINAL ACCEPTANCE IN WRITING FROM THE LANDSCAPE ARCHITECT. AT THE TIME OF FINAL ACCEPTANCE THE ONE (1) YEAR PERIOD SHALL COMMENCE. ANY MATERIALS WHICH HAVE DIED DURING THIS PERIOD SHALL BE PROMPTLY REPLACED WITH SPECIMENS THAT MEET THE MINIMUM REQUIREMENTS CALLED FOR IN THE DRAWINGS. THE LANDSCAPE CONTRACTOR SHALL NOT BE HELD RESPONSIBLE FOR THE DEATH OR DAMAGE RESULTING FROM LIGHTNING, VANDALISM, AUTOMOBILES OR FROM NEGLIGENCE BY THE OWNER. CONTRACTOR SHALL BE RESPONSIBLE FOR WATERING AND OTHERWISE MAINTAINING PLANTS DURING THE GUARANTEE PERIOD UNLESS A WRITTEN AGREEMENT WITH THE LANDSCAPE ARCHITECT PROVIDES FOR A DIFFERENT ARRANGEMENT.
- 20. ALL LABOR AND MATERIAL FOR SOIL AMENDMENTS AND FERTILIZER THAT IS REQUIRED TO INSURE THE SUCCESSFUL ESTABLISHMENT AND SURVIVAL OF THE PROPOSED VEGETATION AS WELL AS ALL COST FOR THE REMOVAL OF UNSUITABLE OR EXCESS BACKFILL MATERIAL SHALL BE INCLUDED IN THE CONTRACTORS BID TO PERFORM THE WORK PRESENTED IN THIS PLAN SET.
- 21. NO LANDSCAPING ADDED UNDER THIS PROJECT SHALL BE LOCATED SUCH THAT SAID LANDSCAPING OBSCURES MOTORIST'S VISIBILITY OF ANY EXISTING SIGN(S).
- 22. 100% OF REQUIRED SHRUBS ARE DROUGHT TOLERANT.

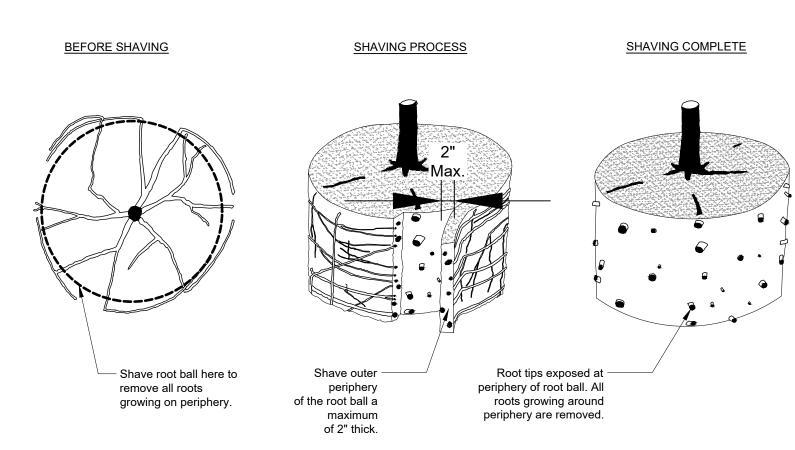

1- Shaving to be conducted using a sharp blade or hand saw eliminating no more than needed to remove all roots on the periphery of root ball.


2- Shaving can be performed just prior to planting or after placing in the hole.

URBAN TREE FOUNDATION® 2014
OPEN SOURCE FREE TO USE

ROOT BALL SHAVING CONTAINER DETAIL

Watering Schedule									
Item Water Month No. of Applications									
Palms	20 gal	1	12						
Large Trees	30 gal	2	12						
Small Trees	20 gal	3	8						
Large Shrubs	10 gal	4	8						
Small Shrubs	5 gal	5	5						
Groundcover	5 gal								
Total Applications			45						

Planting Edge at Sod Detail

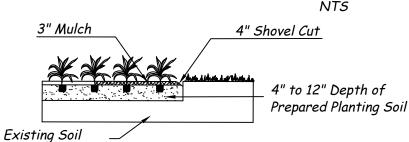

Gravel Strip Detail 3" River Rock Landscpe Fabric

ABBREVIATIONS:

Existing compacted Soil

C.T.- CLEAR TRUNK
Ht.- HEIGHT
O.C.- ON CENTER
Spr.- SPREAD

SECTION VIEW

Groundcover plants to be triangularly spaced.

Mulch.

Pavement.

PLAN

Notes:

1- See planting legend for groundcover species, size, and spacing dimension.
2- Small roots (¼" or less) that grow around, up, or down the root ball periphery are considered a normal condition in container production and are acceptable however they should be eliminated at the time of planting. Roots on the peripherty can be removed at the time of planting. (See root ball shaving container detail).

3- Settle soil around root ball of each groundcover prior to mulching.

GnU	UNDCOVER	OPEN SOURCE FREE TO USE
Shrub		
	022000	Root ball.
4" layer of mulch. – No more than 1" of mulch on top of root ball. (See specifications for mulch).		4" high x 8" wide round - topped soil berm above root ball surface shall be constructed around the root ball. Berm shall begin at root ball periphery.
Finished grade		Prior to mulching, lightly tamp soil around the root ball in 6" lifts to brace shrub. Do not over compact. When the planting hole has been backfilled, pour water around the root ball to settle the
Modified soil. – Depth varies. (See		soil.
specifications for soil modification).		- Existing soil.
Root ball rests on – existing or recompacted soil.	SECTION VIEW	

Notes:
1- Shrubs shall be of quality prescribed in the root observations detail and specifications.

2- See specifications for further requirements related to this detail.

SHRUB - MODIFIED SOIL

URBAN TREE FOUNDATION © 2014 OPEN SOURCE FREE TO USE

Central leader. (See crown observations detail) Top of root ball shall be flush with finished grade. Trunk caliper shall meet ANSI Z60 current edition for root ball size. Prior to mulching, lightly tamp soil around the root ball in 6" lifts to Root ball modified as brace tree. Do not over compact. When the planting hole has been backfilled, pour water around the root ball to settle the soil. Round-topped soil berm 4" high x 8" wide 4" layer of mulch. above root ball surface No more than 1" of mulch on shall be constructed around top of root ball. (See the root ball. Berm shall specifications for mulch). begin at root ball periphery. Finished grade.

TREE w/ BERM (EXISTING SOIL MODIFIED)

SECTION VIEW

Modified soil. Depth

Existing soil.

varies. (See soil preparation

Bottom of root ball rests or

existing or recompacted

URBAN TREE FOUNDATION © 2014 OPEN SOURCE FREE TO USE

further requirements related to

1- Trees shall be of quality

prescribed in crown

specifications.

this detail.

observations and root

observations details and

2- See specifications for

PSLUSD File # 5360D City of Port St. Lucie Project No P22-143 ANDSCASION AND LANGING STATE OF CORIDA 3.24.23

LD-08

Dragonfly


cap

nds

Palm Planting Detail Tree Stakes are to be removed between 6-12 Cut fronds and months by the Owner. bud to increase survival of tree Place (3) 2 x 4's, equally around tree Secure w/ steel wire strapping Apply Burlap only where— Apply burlap only where Place (3) 2 x 4's, equally wood is in contact w/ tree, around tree to minimize staining trunk w/ tree, to minimize Secure w/ Steel Wire Strapping staining trunk. of Rootball Construct saucer Mulch 3" thick. – 3" Deep Mulch, after watering in, 24" radius Construct Saucer Backfill mix to retain water - 2 x 4 Stake Root Barrier. See plan for location if applicable.

be 50% larger than

diameter of root ball Backfill Mix

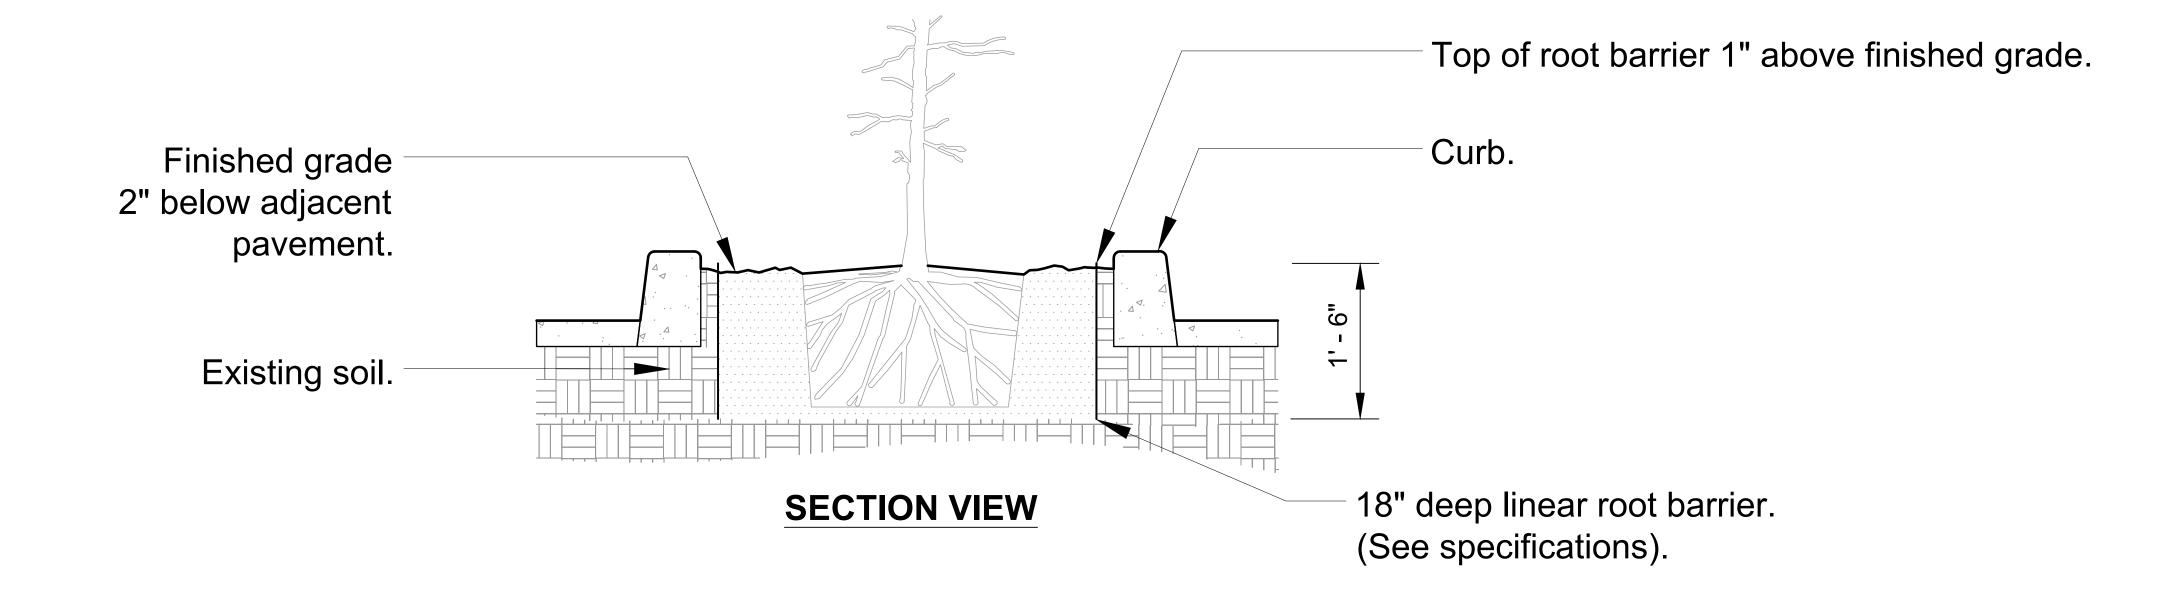

Notes:

- 1- Root barriers shall be installed per manufacturer's specifications and recommendations.
- 2- Root barriers shall be installed when root ball is located within 6' of pavement.

ROOT BARRIERS - PARKING LOT ISLANDS

URBAN TREE FOUNDATION © 2014 OPEN SOURCE FREE TO USE



The change		*	4
		1	

	5	SM	 22-021 Dragonfly LP.dwg	04.21.22
Drawn hv.	DIAMIL Dy.	 Checked by: SM	CADD No.:	Date:
	hase			

