Landscape Architectural Construction Documents for:

Veranda Falls Arcadia

A Multifamily Community Port St. Lucie, Florida

Owner:

Third Lake Development

1600 E. 8th Avenue, Suite A132 Tampa, Florida 33605 Tel (727) 349-9100 Contact: Moriah Kosch, Director

Landscape Architect:

Libra Design Group, Inc.

P.O. Box 547368

Orlando, FL 32854-7368 Contact: Jason Davis (c) 321.945.0172

(e) jdavis@libradesigngroup.com

Architect:

Geheber Lewis Associates

1325 Logan Circle NW
Atlanta, GA 30318
Contact: Jose Garza De La Cruz
(o) 404.228.1958 x 136
(e) craig@cbaarchitects.com

Civil Engineer:

Culpepper & Terpening, Inc.

2980 South 25th St. Fort Pierce, FL 34981


Contact: Dennis Murphy, Principal Planner

(o) 407.410.8624

(e) dmurphy@ct-eng.com


INDEX OF SHEETS

TITLE SHEET # GN-01 GENERAL NOTES, ABBREVIATIONS & SYMBOL LEGEND HP-01 - HP-04 LAYOUT, GRADING AND HARDSCAPE PLANS HP-05 GRADING PLAN (POOL AREA) HP-06 HARDSCAPE PLAN (POOL AREA) HD-00 HARDSCAPOE SCHEDULE HD-01 - HD-03 HARDSCAPE DETAILS LA-01 - LA-08 LANDSCAPE PLANS LANDSCAPE PLAN (POOL AREA) LA-07 LD-01 LANDSCAPE DETAILS & SCHEDULE IR-01 - IR-04 IRRIGATION PLANS ID-01 IRRIGATION DETAILS & SCHEDULE

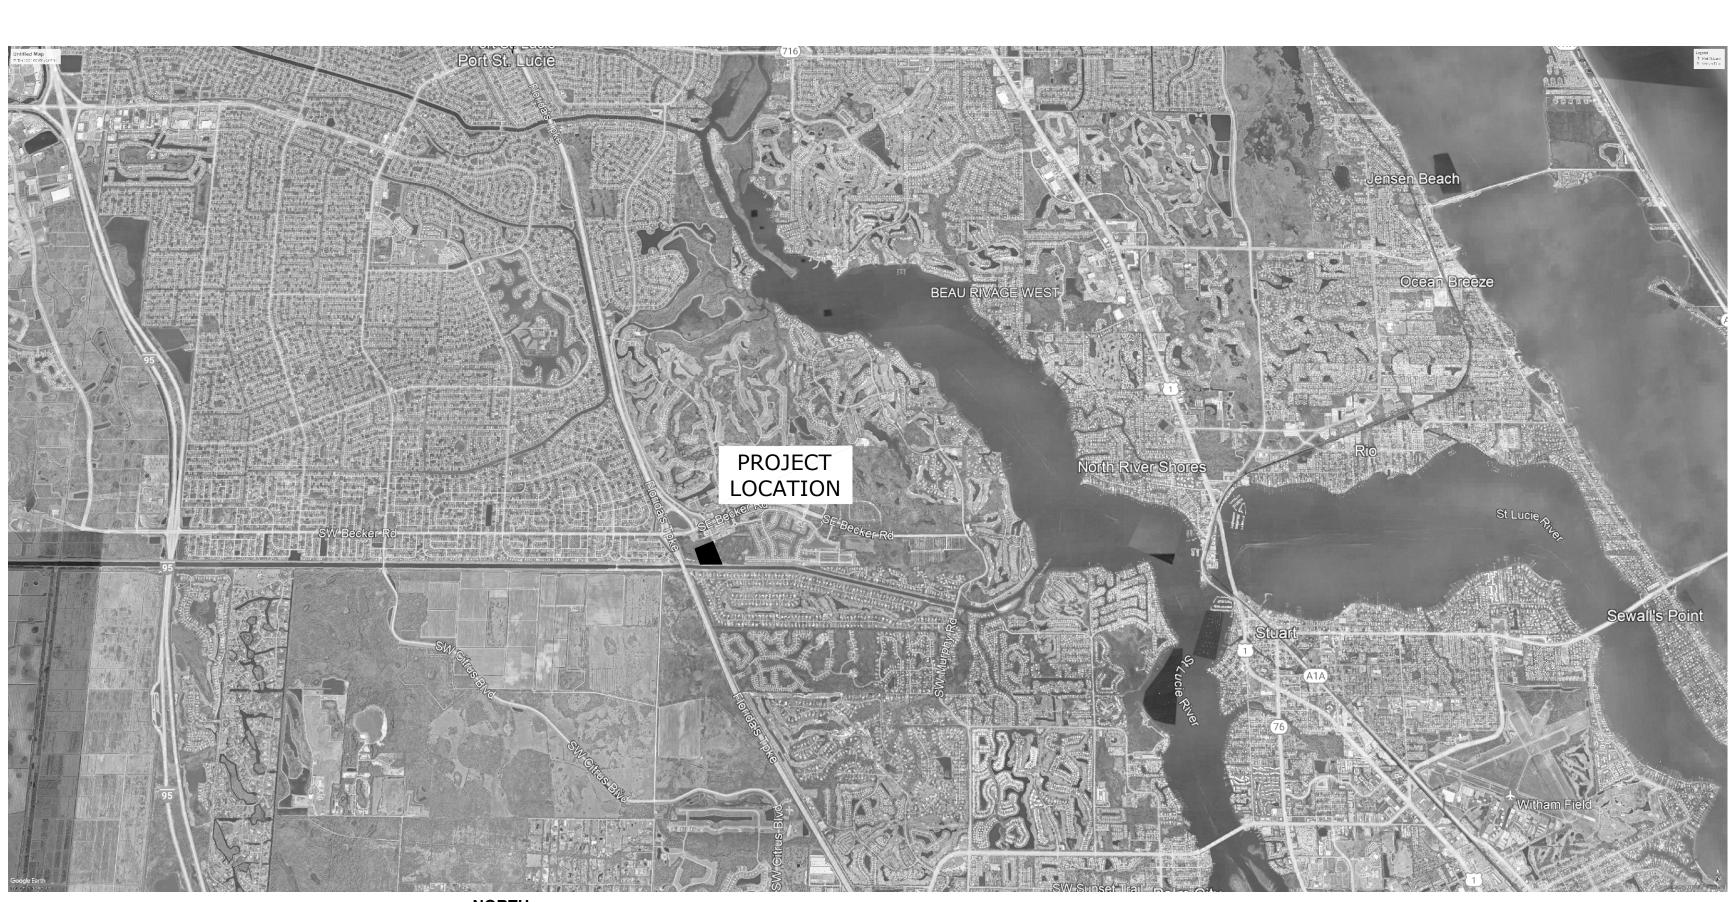

VICINITY MAP



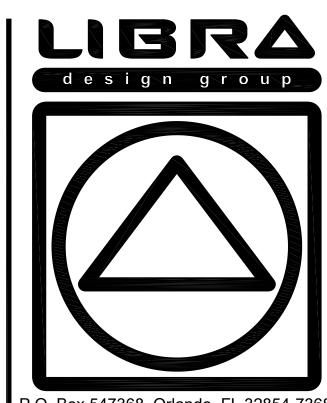

P.O. Box 547368, Orlando, FL 32854-736 Tel (407) 649-1828 Fax (407) 479-3279 Landscape Architecture & Planning www.libradesigngroup.com

© 2023 Libra Design Group - All Rights Reserved.

This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited.


Florida License LC26000253

THIRD LAKE DEVELOPMENT

ISSUE

23.03.01 PORT ST. LUCIE CITY SUBMISSION 1 23.05.24 PORT ST. LUCIE CITY SUBMISSION 2 23.08.21 OWNER REVIEW

Veranda Falls Arcadia PORT ST LUCIE, FL



Brian F. Davis LA0000935

KEY PLAN

JOB NO.:

DESIGNED BY:

DRAWN BY:

CHECKED BY:

PROJECT APPROVAL:

LANDSCAPE COVER SHEET 22122

COVER

GENERAL DEMOLITION NOTES

Prior to commencement of demolition the contractor will coordinate his activities with all the utility companies serving this area. Copies of all dig permits shall be made available to the owner's representative prior to excavating. Contractor to coordinate fully with the utility companies on the exact location of underground utilities prior to excavation.

The contractor, prior to beginning any underground excavation, digging, boring, pile driving, blasting, or planting, must first obtain an excavation permit and the contractor shall comply with Tennessee Statutes regarding notification of existing gas and oil pipeline company owners and shall notify per the notification information listed on the civil engineer's drawings prior to excavation. Evidence of such notice shall be furnished to the owner prior to excavating. The contractor shall coordinate fully with the owner's representative for all excavation permits and notification necessary prior to initiating all work. See project manual and specifications for further information.

Utility lines shall be demolished and removed or left in place as required by the applicable utility company and local requirements. Any conduits that are left in place shall have ends securely capped.

The location of all existing utilities and storm drainage shown on the plans is approximate and reflects the best available information and is given for the convenience of the contractor. The owner or engineer assumes no responsibility for accuracy. Prior to the start of demolition the contractor shall visit the site and determine the location and the existence of all structures and utilities shown or not on the plans, which would need to be removed or abandoned.

The contractor shall verify all dimensions, elevations and utilities. Any discrepancies shall be brought to the immediate attention of the owner's representative.

Temporary construction fence(s) shall be staked for location before construction. A walk-through by the contractor and owner's representative/engineer shall be conducted to confirm the location.

All gates used on temporary construction fencing shall be locked with standard locks and keys provided by the contractor to the owner's representative.

Utility construction may be required in areas outside of the construction fence or work limit line. The contractor shall schedule this work with the owner's before beginning. Open cut, repair and restoration shall be completed in a timely manner.

The contractor shall remove all base and pavement materials and other construction debris from landscape areas and islands and grade these areas in preparation for landscape work.

All excess materials resulting from excavation for construction of the project shall be disposed of by the contractor off-site.

All practical and necessary efforts shall be taken during construction by the contractor to control and prevent erosion and transport of sediment to surface drains.

The contractor shall control fugitive dust originating on the project by watering or other methods as required.

GENERAL SITE FURNISHINGS NOTES

The contractor shall provide the following submittals:

All manufacturer's data including directions or recommendations for installation, methods, procedures and maintenance.

Complete shop drawings for all site furnishings indicating all details of fabrication and installation including sizes, shapes, finishes, colors, thickness, material quality and all other related work applicable to the site furnishings.

Submit color samples for approval.

Deliver all materials with manufacturer's tags and labels intact in clean, dry and protected locations.

Store and handle all site furnishings so as to avoid damage.

All site furnishings shall be provided by the contractor including ordering, shipping, delivery, unpacking, and installing according to manufacturer's specifications and as detailed on the drawings. The contractor shall verify installation procedure with the owner's representative prior to installing.

The contractor shall coordinate with the owner's representative the delivery of all site furnishings and shall be completely responsible for shipping, unpacking, removing packaging, disregarding pallet and packaging materials, and all handling after delivery to place site furnishings in locations designated on the plans.

All site furnishings locations are to be approved by owner's representative prior to being placed on site.

All site furnishings shall be guaranteed by the contractor free of defects, cracks, chips, stains and shall be completely clean and free of damages upon final placement and approval.

ABBREVIATIONS

LNDG

LANDING

LEVEL

ABBREVIA	<u>TIONS</u>		
+/-	PLUS OR MINUS ACCESSORY/ACCESSORIES AREA DRAIN (IN SOD) AREA DRAIN (IN PLANTING BED) APPROVED APPROXIMATE(LY) ACCESSIBLE ROUTE BOTTOM OF CURB BACKFLOW PREVENTER BUILDING BLOCKING BACK OF CURB BOTTOM OF DAMP (FLEVATION)	MAX	MAXIMUM
ACSY	ACCESSORY/ACCESSORIES	MFGR MIN	MANUFACRURER
AD	AREA DRAIN (IN SOD)	MIN	MINIMUM
ADB	AREA DRAIN (IN PLANTING BED)	MISC	MISCELLANEOUS
APRV	APPROVED '	N	NORTH
APPX	APPROXIMATE(IY)	NIC	NOT IN CONTRACT
AR	ACCESSIBLE ROUTE	NIC NOM	NOMINAL
BC	BOTTOM OF CURB	NTS	NOT TO SCALE
BEP	BACKELOW PREVENTER	NVL	NATURAL VEGETATION LINE
BLDG	BUILDING	OC_	NATURAL VEGETATION LINE ON CENTER OPPOSITE HAND
BLKC	BI OCKING	OH	OPPOSITE HAND
BOC	BACK OF CLIDB	OH	OVERHANG
BOT	BOTTOM	DΔ	PLANTED AREA
DO I	BOTTOM OF DAMP (FLEVATION)	OH PA PD	PLANTER DRAIN
DC	DOTTOM CTED (FLEVATION)	PL	DI ANTER
DS DW	BOTTOM OF WALL	DC	DOOL CODING
BW	BUTTOM OF WALL	DC	DOINT OF CURVATURE
C/C	CENTER TO CENTER	PCC	POOL COPING POINT OF CURVATURE POINT OF COMPOUND CURVATU POURED-IN-PLACE (CONCRETE) PLANTER
C/L	CENTERLINE	PCC	POLINE OF COMPOUND CORVATO
CIP	CAST-IN-PLACE (CONCRETE)	PIP	POURED-IN-PLACE (CONCRETE)
CMU	CONCRETE MASONRY UNIT	PL DDC	PLANTER POINT OF REVERSE CURVATURE POINT OF TANGENCY
CO	CLEAR OPENING	PRC	POINT OF REVERSE CURVATURE
CO	CLEANOUT	PI	POINT OF TANGENCY
CONC	CONCRETE	PI	PRESSURE TREATED QUANTITY RADUIS
CONT	CONTINUOUS	QTY R	QUANTITY
CRS	COURSE	R	RADUIS
DD	DECK DRAIN	R	RISER(S)
DESC	DESCRIPTION	REINF	RISER(S) REINFORCING ROUGH OPENING RIGHT OF WAY
DI	DRAIN INLET (ELEVATION)	RO	ROUGH OPENING
DIA	DIAMETER ` ´	ROW	RIGHT OF WAY
DS	DOWNSPOUT	SD	STRIP DRAIN
E EG ELEC ELEV	BACK OF CURB BOTTOM BOTTOM OF RAMP (ELEVATION) BOTTOM STEP (ELEVATION) BOTTOM OF WALL CENTER TO CENTER CENTERLINE CAST-IN-PLACE (CONCRETE) CONCRETE MASONRY UNIT CLEAR OPENING CLEANOUT CONCRETE CONTINUOUS COURSE DECK DRAIN DESCRIPTION DRAIN INLET (ELEVATION) DIAMETER DOWNSPOUT EAST EXISTING GRADE (ELEVATION) ELECTRIC ELEVATION EQUAL EQUIPMENT EDGE OF PAVEMENT EACH WAY EXISTING FACE TO FACE FINISH(ED)	SIM	STRIP DRAIN SIMILAR SLAB ON GRADE
EG	EXISTING GRADE (ELEVATION)	SOG	SLAB ON GRADE
FLFC	FLECTRIC	SPECS	SPECIFICATIONS
FLFV	ELEVATION	SQ, SQR	SOUARE
FO	FOLIAL	STD	STANDARD
FOPM	EQUAL EQUIPMENT EDGE OF PAVEMENT	STD STL	STEEL
FOP	EDGE OF PAVEMENT	STR	STRAIGHT SOUTHERN YELLOW PINE TANGENT LENGTH OF CURVE TO BE DETERMINED
F/W	EACH WAY	SYP	SOUTHERN YELLOW PINE
EX	FXISTING	TAN	TANGENT LENGTH OF CURVE
FYICT	FYISTING	TBD	TO BE DETERMINED
EX EXIST F/F	FACE TO FACE	TC	TO BE DETERMINED TOP OF CURB (ELEVATION) TEMPORARY
FIN	FINISH(ED)	TEMP	TEMPORARY
FFE	FINISHED FLOOR ELEVATION	THK	THICK
FG	FINISHED FLOOK ELEVATION FINISHED GRADE (ELEVATION)	TOB	TOP OF BLOCK (CMU)
FOB	FACE OF BLOCK	TC	TOP OF CONCRETE
FOC		TOC	TOP OF CONCRETE
	FACE OF CONCRETE	TOF	TOP OF FOOTING
FOC	FACE OF CONCRETE	TR	TOP OF RAMP (ELEVATION)
FRMG	FRAMING	TS	TOP STEP (ELEVATION)
FS	FINISHED SURFACE (ELEVATION)	TW	TOP OF WALL (ELEVATION)
GEN	GENERAL	TYP	TYPICAL
GC	GENERAL CONTRACTOR	ÜD	UNDERDRAIN
HB	HOSE BIB	UNO	UNLESS NOTED OTHERWISE
HC	HANDICAP	VERT	VERTICAL
HORT	HORIZONTAL	W/	WITH
HP	HIGH POINT (ELEVATION)	W/O	WITHOUT
INV	INVERT (ELEVATION)	WF	
JST	JOIST	WF WW	WATER FEATURE
LA	LANDSCAPE ARCHITECT		WALKWAY
LC	LANDSCAPE CONTRACTOR	WWF	WELDED WIRE REINFORCING
LF	LINEAR FEET		

GENERAL SITE LAYOUT NOTES

Contractor shall fully familiarize himself/herself with the project prior to bidding the work

See site layout drawings for construction layout geometry of the project's site development elements. Refer to hardscape plans and details as well as the structural documents for additional layout information.

Contractor shall coordinate and verify all points of beginning and benchmarks for the site with the owner's representative prior to initiating layout of site elements. Any discrepancies shall be immediately brought to the attention of the owner's representative and the Landscape Architect.

Unless noted otherwise, the limits of construction shall be as noted on the drawings.

Contractor shall utilize the geometry indicated on the site layout plans to layout all site elements, pavement and pavement patterns, etc. Bring any discrepancies, inconsistencies or errors to the attention of the owner's representative and Landscape Architect prior to construction.

Wherever possible, the contractor shall coordinate the layout of the pavement and pavement pattern with the location of the drain inlets and other at grade utility elements.

GENERAL SITE HARDSCAPE NOTES

The contractor shall familiarize himself/herself with the project site prior to bidding the work. The contractor shall field verify all existing conditions and location of proposed improvements prior to initiating any construction.

Refer to the site layout drawings for layout geometry information for all site elements.

The contractor shall notify all necessary utility companies at least 48 hours prior to digging for field verification of all underground utilities, irrigation and other elements and coordinate with the owner's representative prior to initiating operations. Drawings are prepared according to the best information available at the time of preparing these documents.

All existing site roads, parking lots, curbs, utilities, sewers and other elements to remain shall be fully protected from any damage unless otherwise noted. Report any discrepancies between the construction drawings and field conditions to the owner's representative immediately

The contractor shall coordinate all work with related contractors and with the general construction of the project in order not to impede the progress of the work of others or the contractor's own work.

The contractor shall provide all necessary safety measures during construction operations to protect the public according to all applicable codes and recognized local practices.

The contractor shall coordinate access and staging areas with the owner's representative

All pavement joints are to be parallel, perpendicular or tangent to adjacent lines unless noted otherwise. Layout curvilinear joints as indicated on the drawings for approval by the owner's representative prior to construction.

All pavement shall be staked in the field using dimensions and layout geometry indicated on the site layout plans or as instructed and approved by the owner's representative prior to construction. Alignment may be adjusted to accommodate existing drain inlets, manholes, or other site elements.

The contractor shall provide sample pours of all paving for approval by the owner's representative prior to construction in conformance with the specifications.

The contractor shall submit samples of all joint sealants and colors for approval by the owner's representative prior to installation.

The contractor shall maintain all existing erosion and sedimentation control measures (silt fence, orange geo fence and/or other measures) during construction. Provide additional measures as necessary to minimize adverse impacts to the (lake, guest areas, existing parking lots, etc.) according to all applicable federal/state law and local codes.

See hardscape details for concrete expansion joints and control joints. Control and expansion joint module width may vary to achieve the layout depicted on the plans. The contractor shall field measure and identify modular widths that achieve the intent of the layout shown on the plan. Contractor shall submit to the owner's representative a redlined plan showing any required changes in joint layout prior to placement. Expansion joints shall be provided as shown on the plans and at all interfaces.

See site grading plans and civil engineering drawings for pavement elevations. Match grades with existing conditions. Verify that the pavement surfaces between existing and new are flush and do not create a tripping hazard.

The contractor shall clean the work areas at the end of each working day. Rubbish and debris shall be collected and deposited off-site daily. All materials, products and equipment shall be stored in an organized fashion as directed by the owner's representative.

The contractor shall be responsible for coordinating the location of all drain inlets, catch basins, yard drains and manholes indicated on the plans under previous construction packages. Where possible, drain inlets in pavement shall be located at the intersection of pavement joints or in the center of a pavement field defined by the pavement joint pattern indicated on the drawings.

All pedestrian walkways shall be five feet wide unless noted otherwise.

All raduised returns at pedestrian walkways shall be 2' (24") unless noted otherwise.

GENERAL GRADING NOTES

The contractor shall familiarize himself/herself with the project prior to bidding the work.

All landscape islands on parking areas shall be crowned 6" above the top of the curb unless noted otherwise on the plan(s).

Numerous underground utilities, conduit, sleeves, drainage pipes, etc., have been previously installed or scheduled for future installation by others. Contractor shall coordinate and work closely with other contractors, trades, and the owner's representative to avoid damage to these underground and at grade elements. Any damages shall be reported immediately to the owner's representative.

Finished grade in planting bed areas shall be 2" to 3" below the finished elevations shown for all hardscape surfaces (see details for varying conditions).

All utilities, sleeves, manholes, outfall structures, swales, and other structures or topographical features shall be field staked and verified prior to construction. Notify the owner's representative of any existing utility which needs to be raised to match finished grades shown in the drawings.

All required fill shall be clean, well draining soil. Fill shall be clean and free of all material harmful to plant growth and deleterious material such as rocks (larger than 2" dia.), compacted clay, roadbed or surfacing material, muck, roots, branches, etc.

Contours for berming shall be smooth, continuous arcs. Side slopes shall be smooth and even in transition and void of depressions and surface irregularities. All berms shall have a maximum side slope of four feet (4') horizontal to one foot (1') vertical (ie, 4 to 1), unless otherwise noted.

Maximum sidewalk slope shall be 8% (12' to 1') and meet all accessibility requirements. Minimum sidewalk slope shall be 1%. Maximum sidewalk cross slope shall be 2% pitched toward drainage structures.

All pavement and landscape areas of the project shall positively drain to drainage structures indicated on the site grading and civil engineering plans.

The contractor shall be responsible for all erosion protection and slope stabilization by owner-approved means.


Contractor shall furnish and install all necessary fences, barricades, and sediment control devices as well as maintain and repair any damage which may impede their effectiveness and as directed by the owner's representative.

Any limits of work abutting jurisdictional boundaries or existing water bodies shall be verified in the field and approved by the owner's representative.

SYMBOL LEGEND



DETAIL REFERENCE



RETAINING WALL BY OTHERS

RETAINING WALL MATCHLINE

LIMIT OF CONSTRUCTION ———— PROPERTY LNE

DECORATIVE FENCE WITH GATE

TYP. STAIR W/HANDRAILS

TYP. RAMP W/HANDRAILS

TYP. IN-LINE CURB RAMP HARDSCAPE MATERIAL ID (SEE HARDSCAPE SCHEDULE) SITE FURNISHING ID

(SEE HARDSCAPE SCHEDULE) LANDSCAPE LIGHT FIXTURE ID (SEE HARDSCAPE SCHEDULE) (F-X)(SEE HARDSCAPE SCHEDULE)

DRAINAGE INLET (SEE HD-01) SURFACE DRAINAGE FLOW

STORMWATER DRAIN PIPE — UD — UD — UNDERDRAIN (SEE HD-01) STRIP DRAIN (SEE HD-01) ELEVATION BREAK LINE

PROPOSED CONTOURS EXISTING CONTOURS PROPOSED SPOT ELEVATION GEOMETRY CONTROL POINT

GEOMETRY COORDINATE GEOMETRY COORDINATE



P.O. Box 547368, Orlando, FL 32854-7368 Tel (407) 649-1828 Fax (407) 479-3279 Landscape Architecture & Planning www.libradesigngroup.com

© 2023 Libra Design Group - All Rights Reserved. This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction copying or other use without the written consent of Libra Design

Group, Inc. is hereby expressly prohibited.

Florida License LC26000253


THIRD LAKE **DEVELOPMENT**

ISSUED DATE: FOR:

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1 2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2

2023.08.21 OWNER REVIEW

Veranda Falls -Arcadia PORT ST LUCIE, FL



Brian F. Davis LA0000935

KEY PLAN


22122 JOB NO.: **DESIGNED BY:**


BFD


DRAWN BY: CHECKED BY:


PROJECT APPROVAL:

GENERAL NOTES **ABBREVIATIONS**

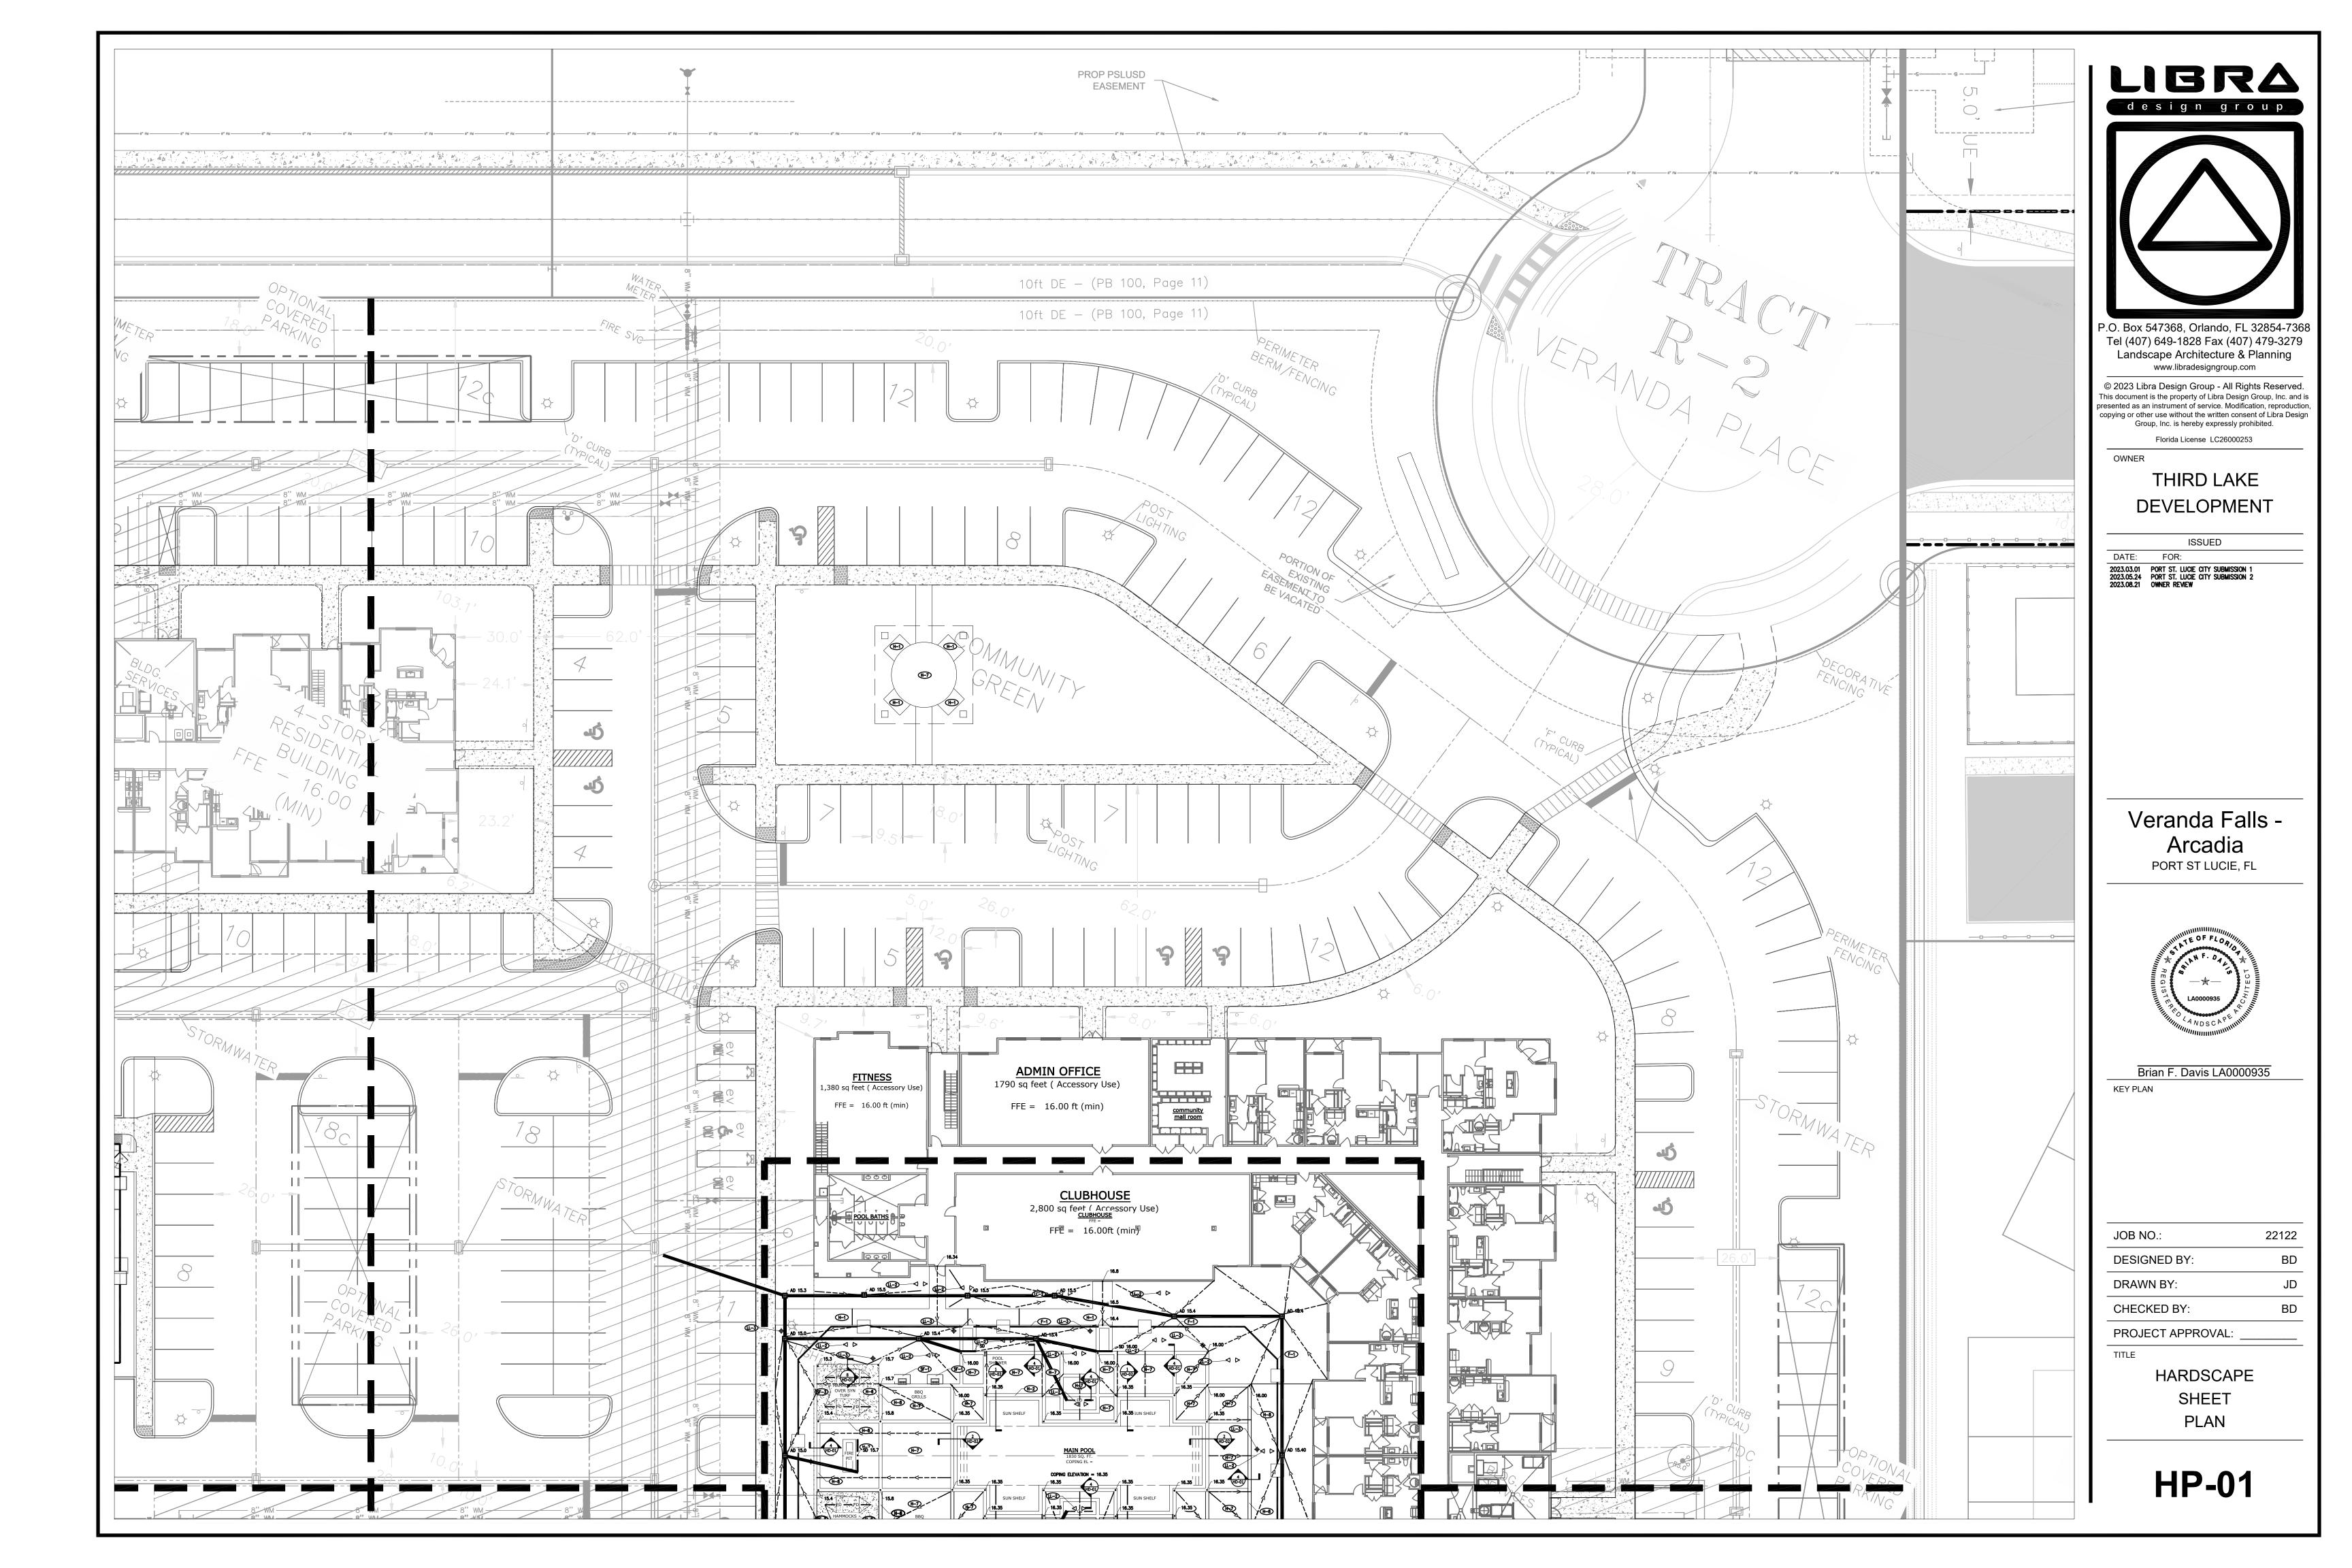

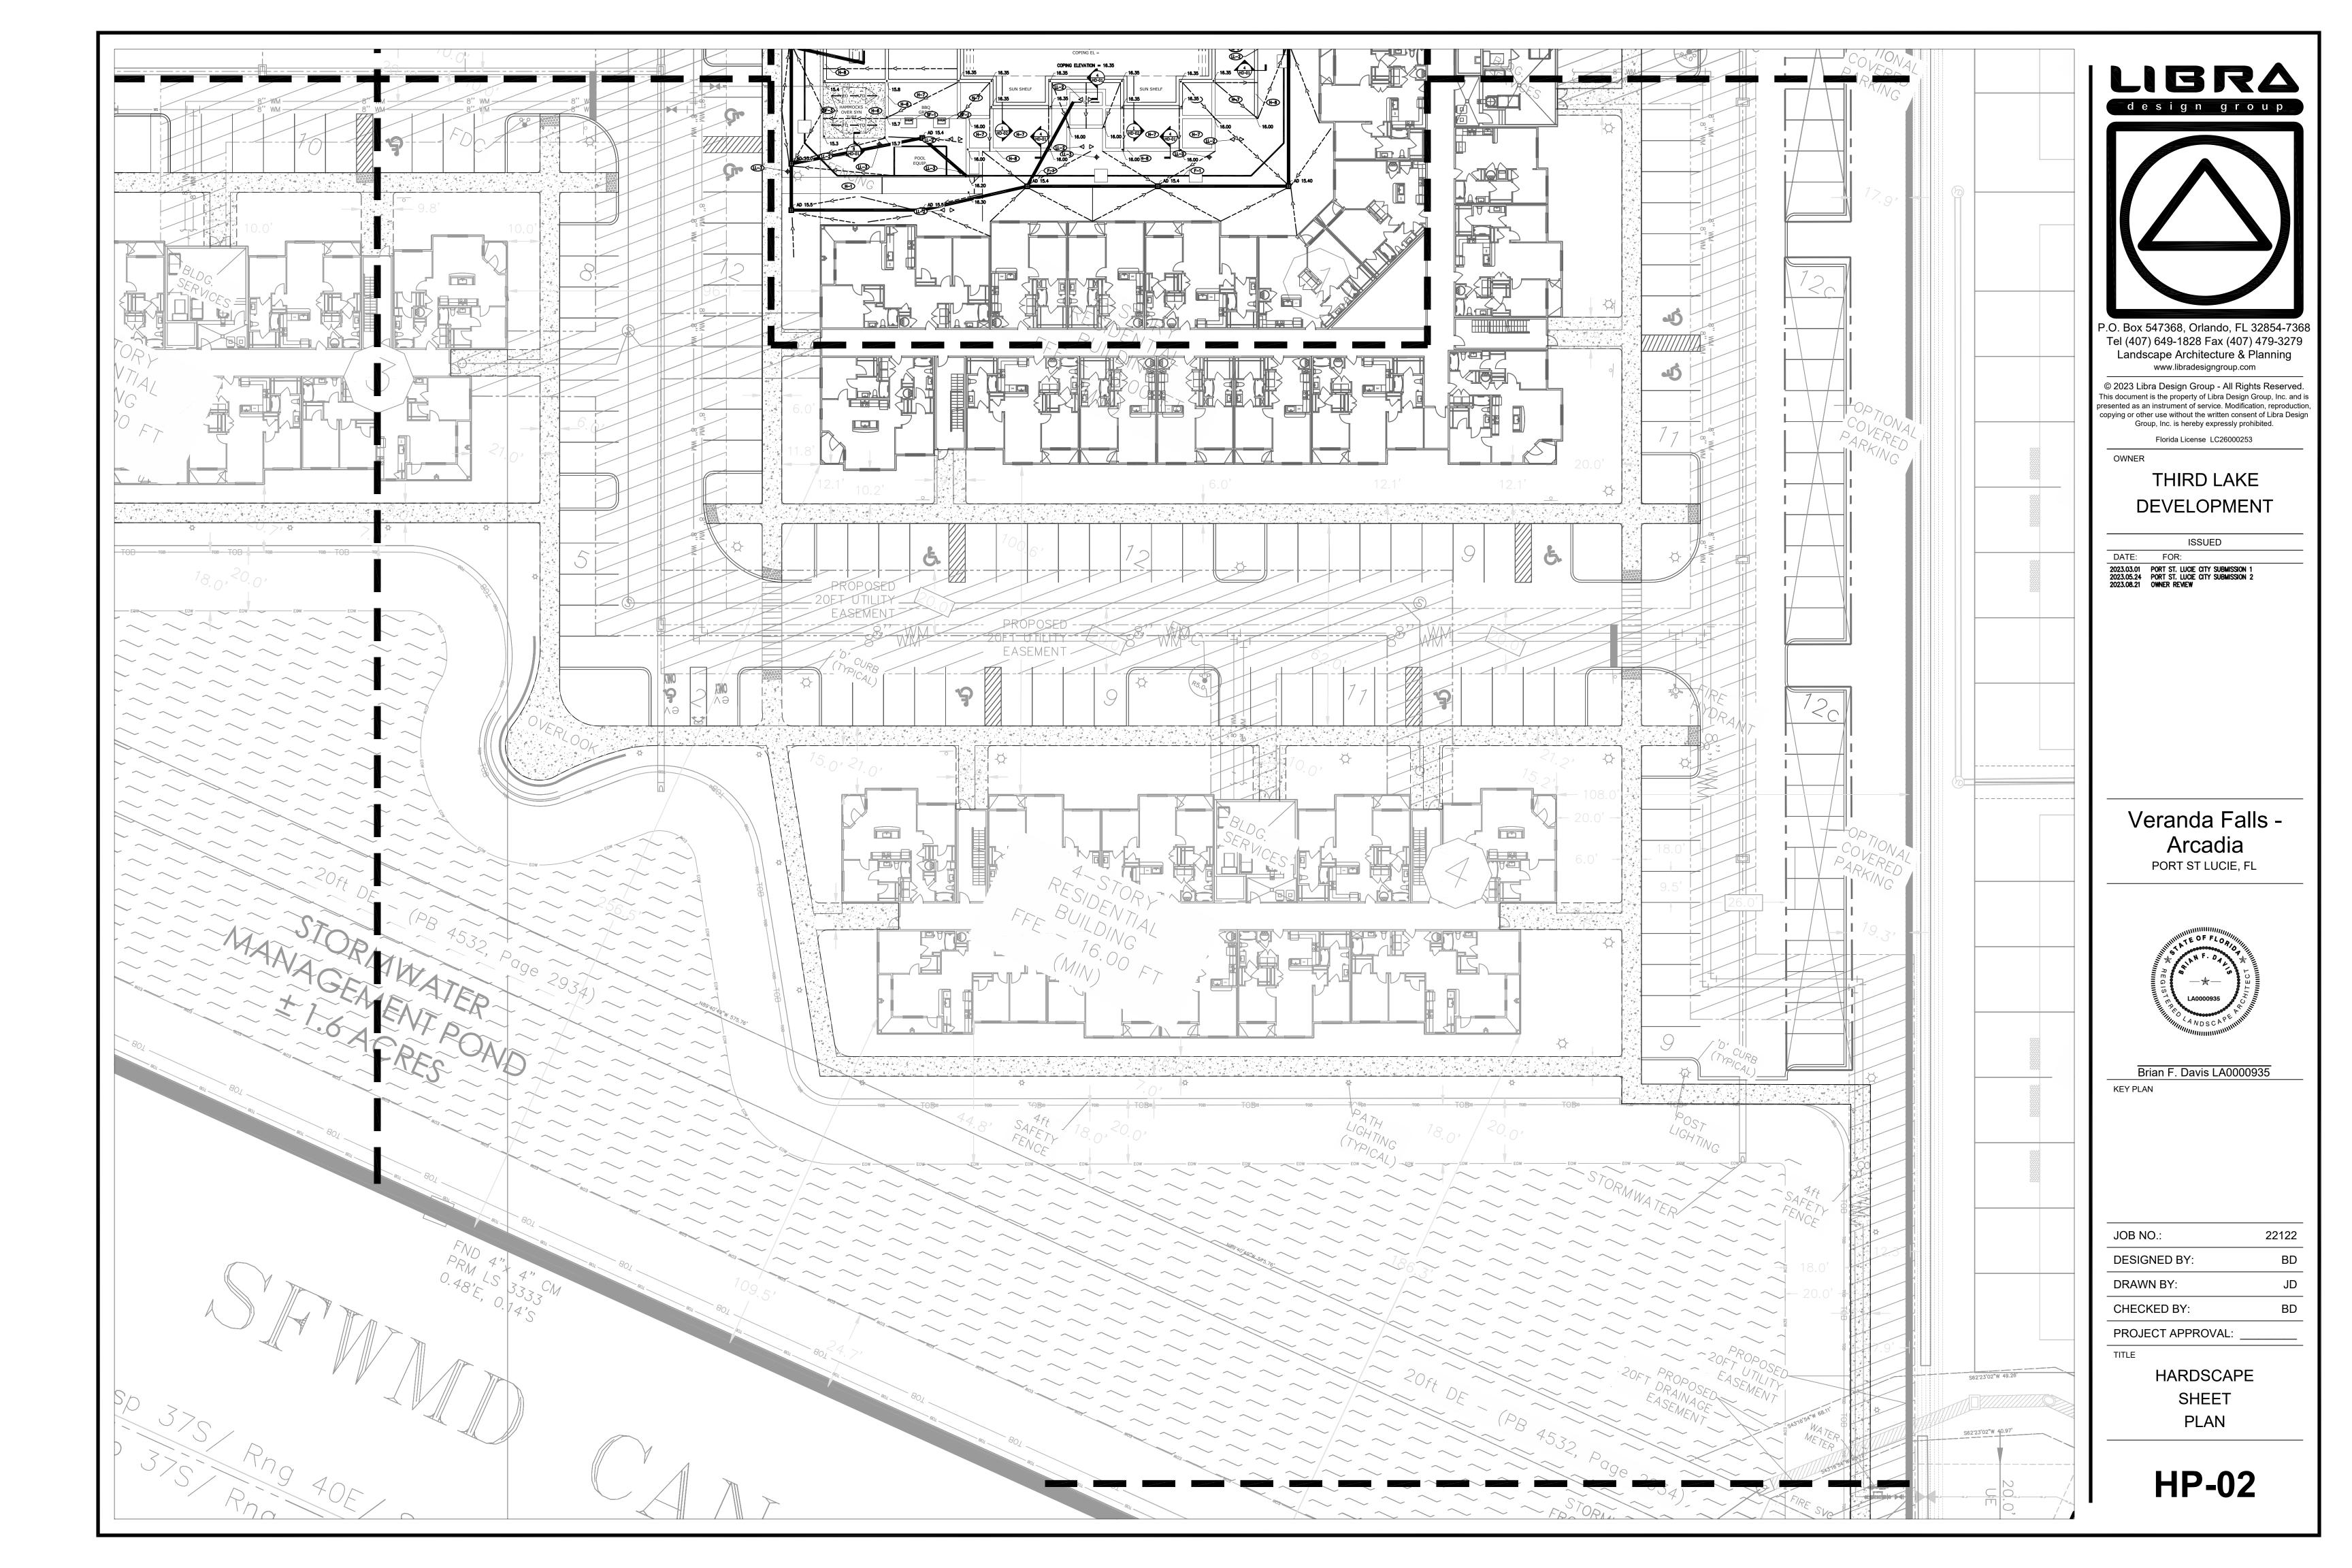

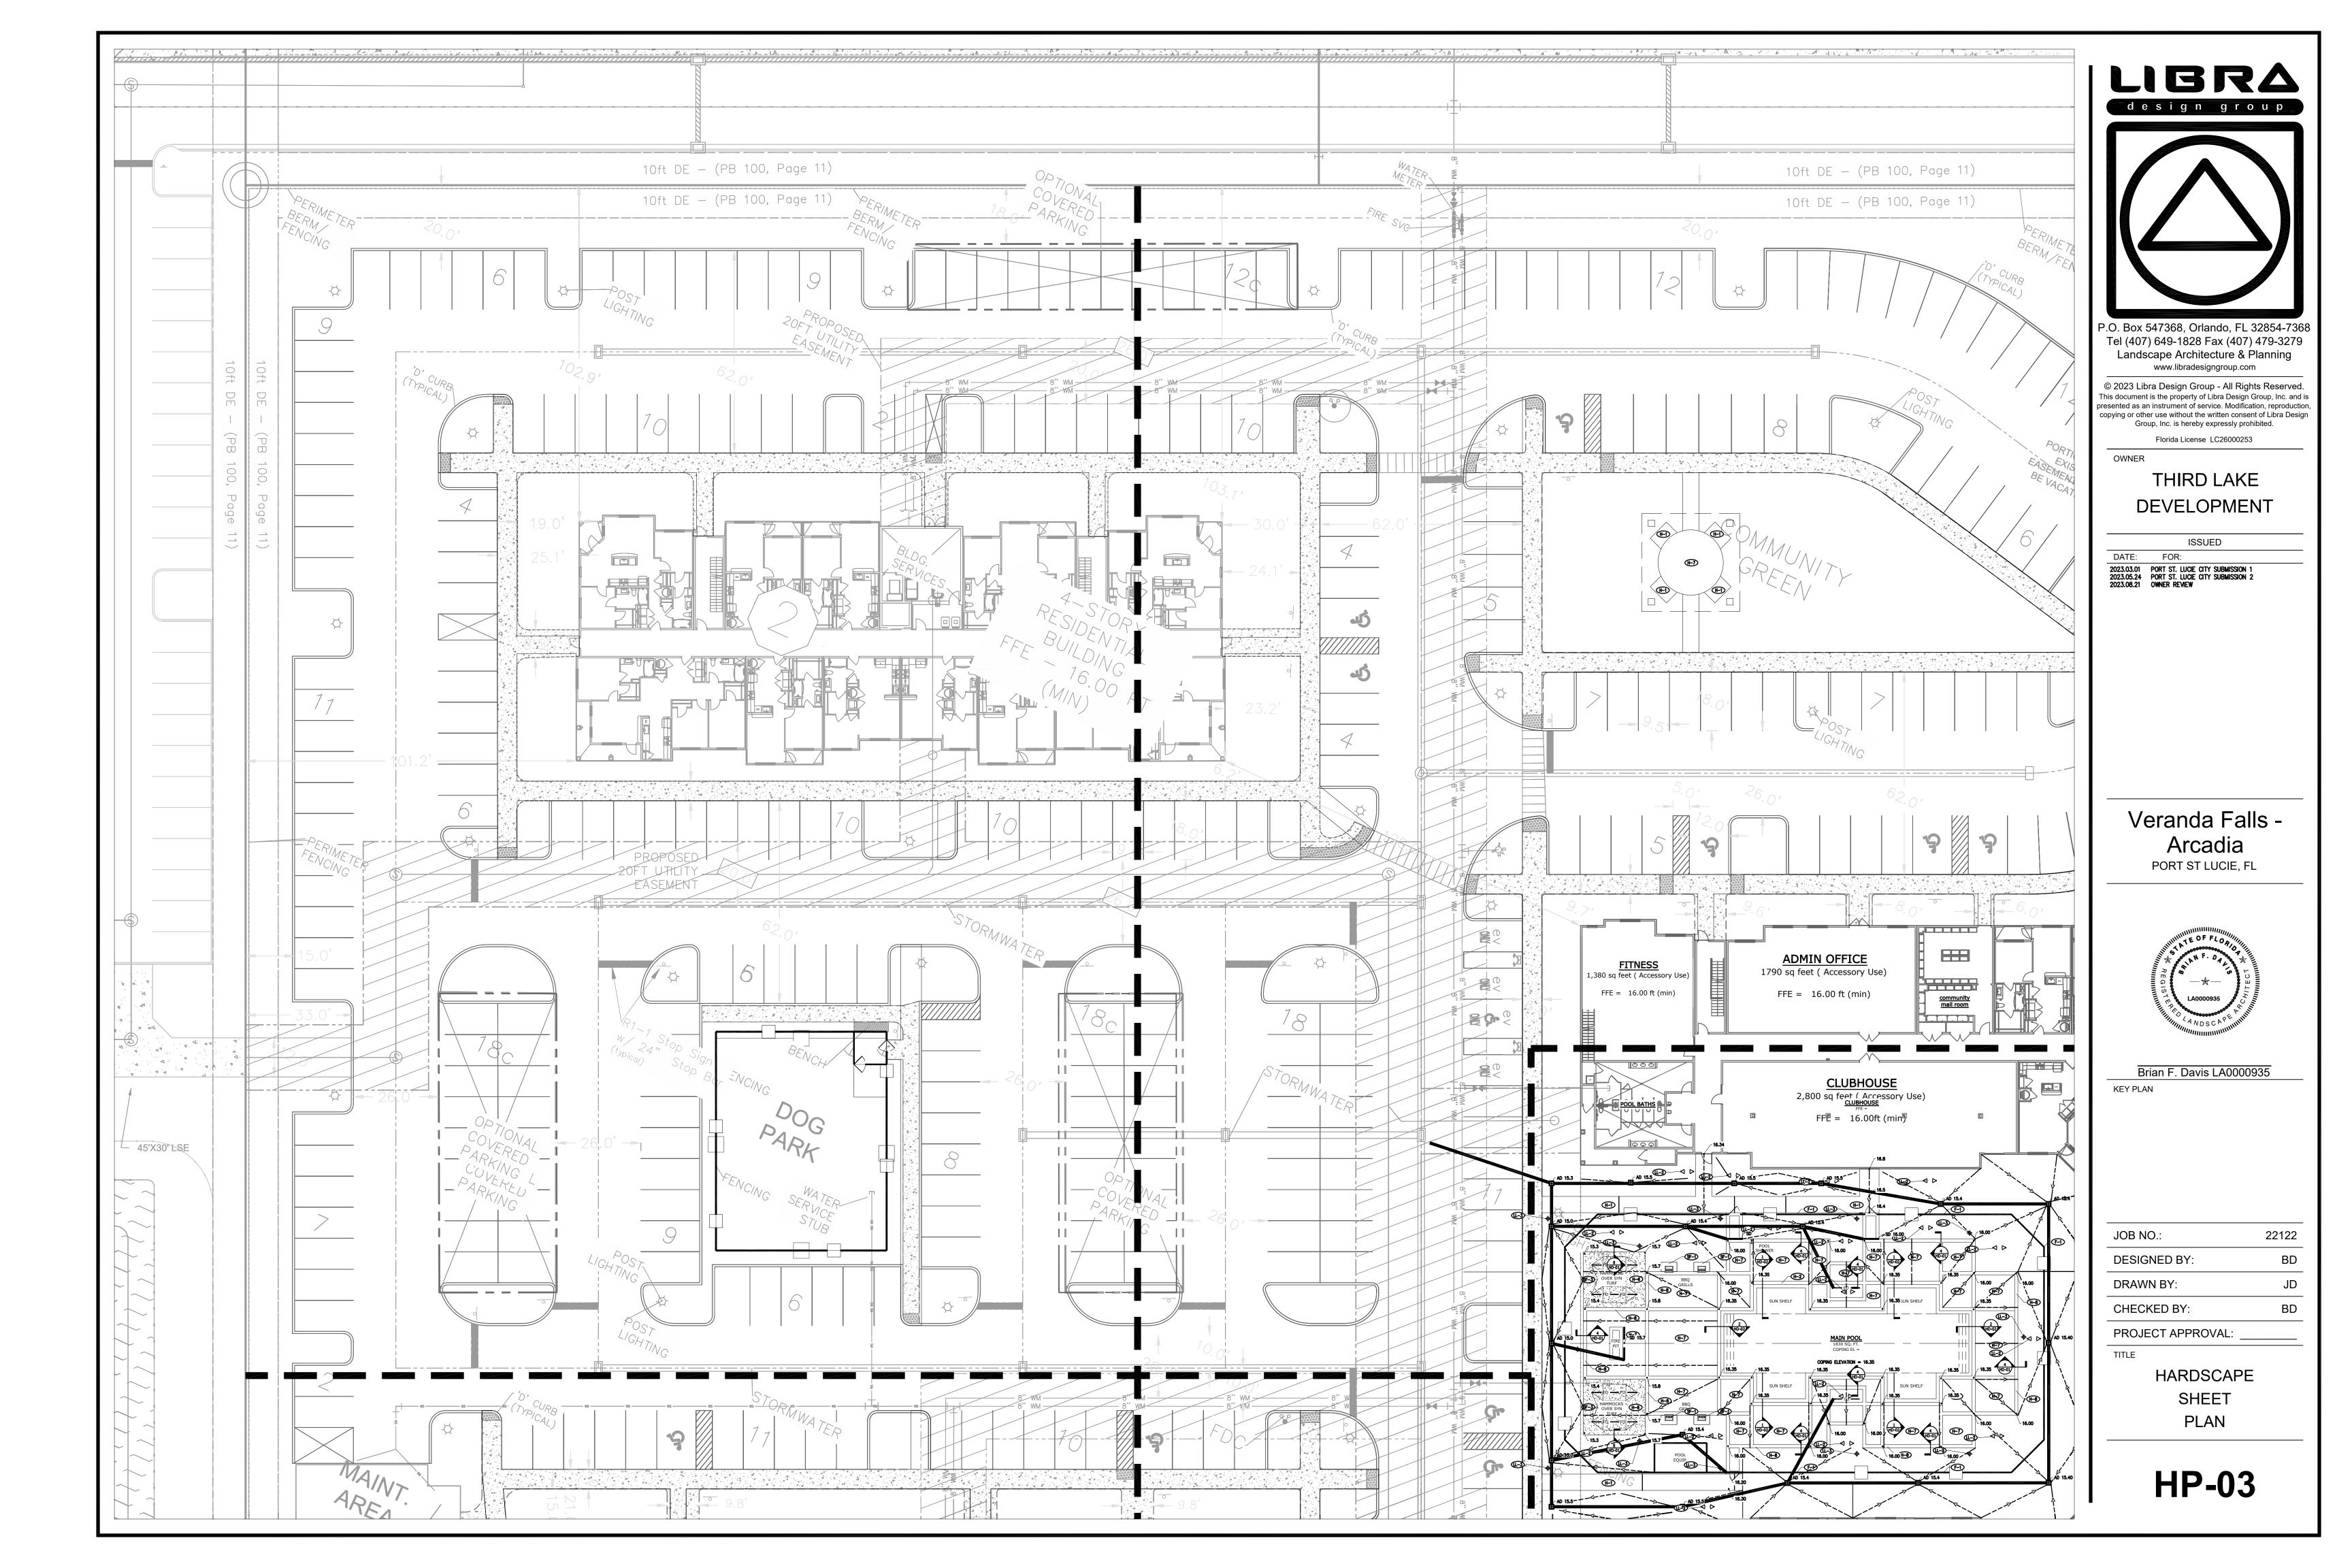

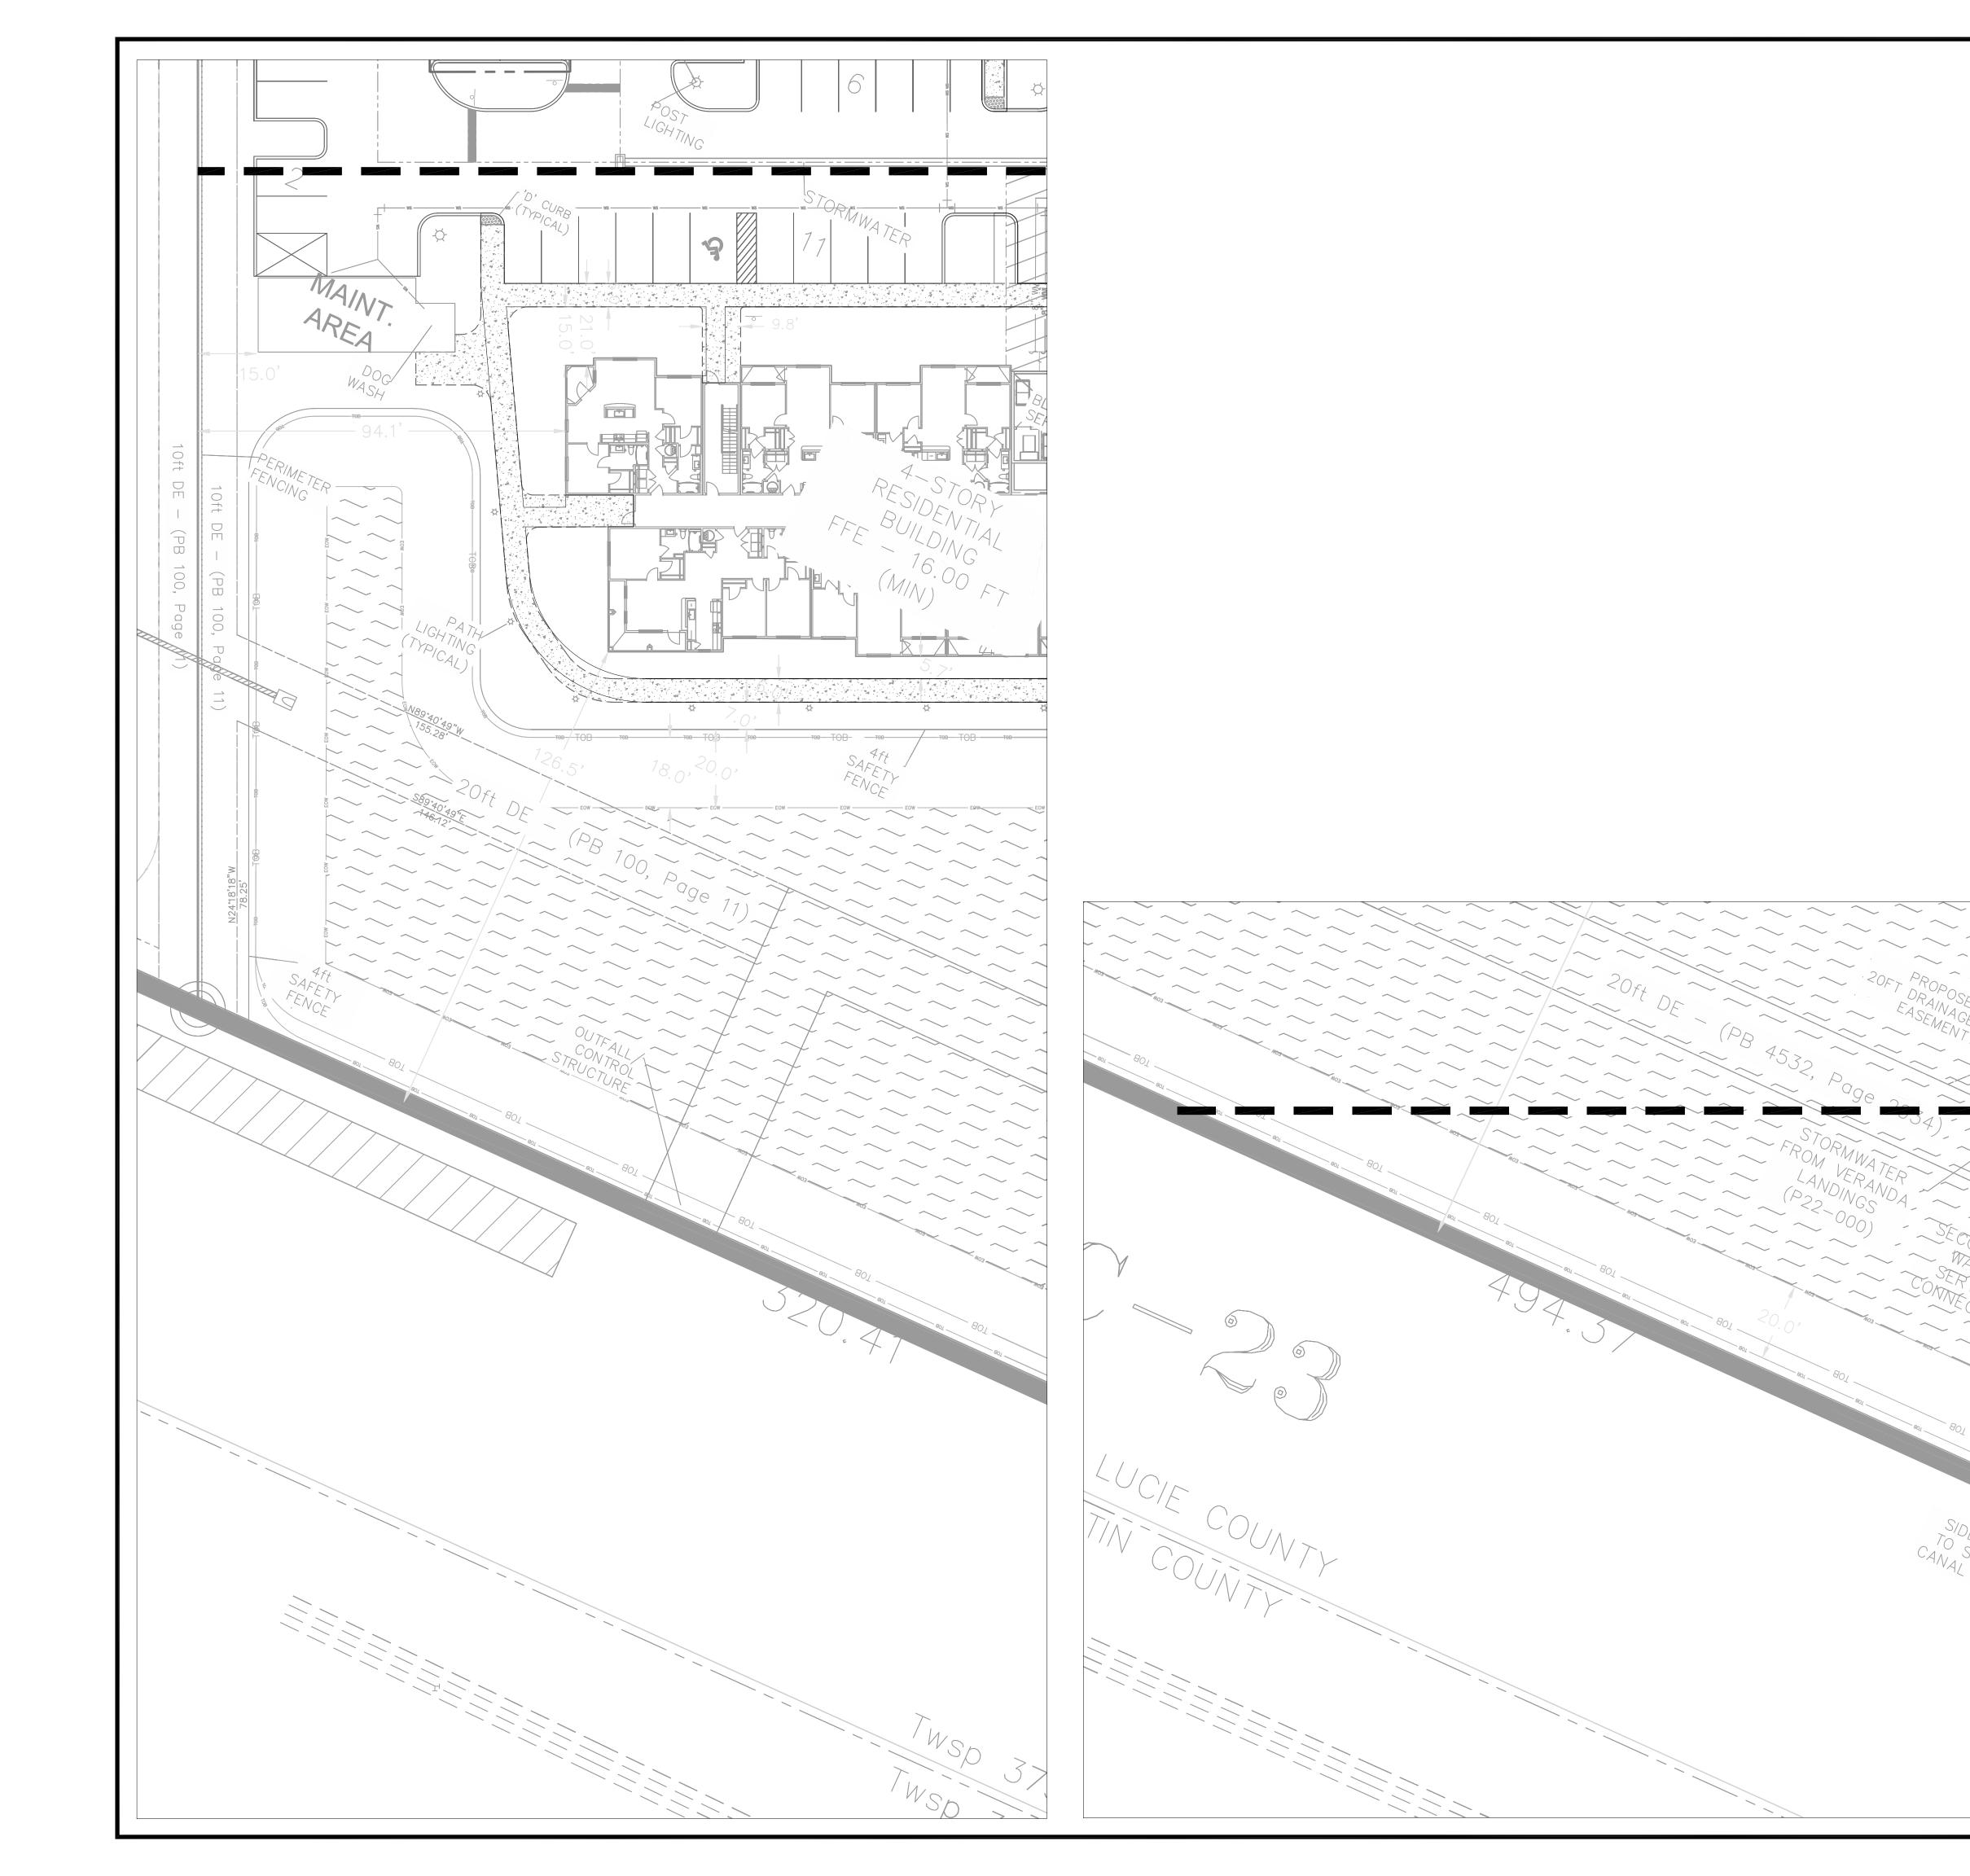



© 2023 Libra Design Group - All Rights Reserved.

This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction, copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited.

Florida License LC26000253

WNER

THIRD LAKE
DEVELOPMENT

ISSUED

DATE: FOR:

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1
2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2
2023.08.21 OWNER REVIEW

Veranda Falls Arcadia
PORT ST LUCIE, FL



Brian F. Davis LA0000935

KEY PLAN


JOB NO.:	22122
DESIGNED BY:	BD
DRAWN BY:	JD
CHECKED BY:	BD


PROJECT APPROVAL:

TITLE

HARDSCAPE SHEET PLAN

HP-04

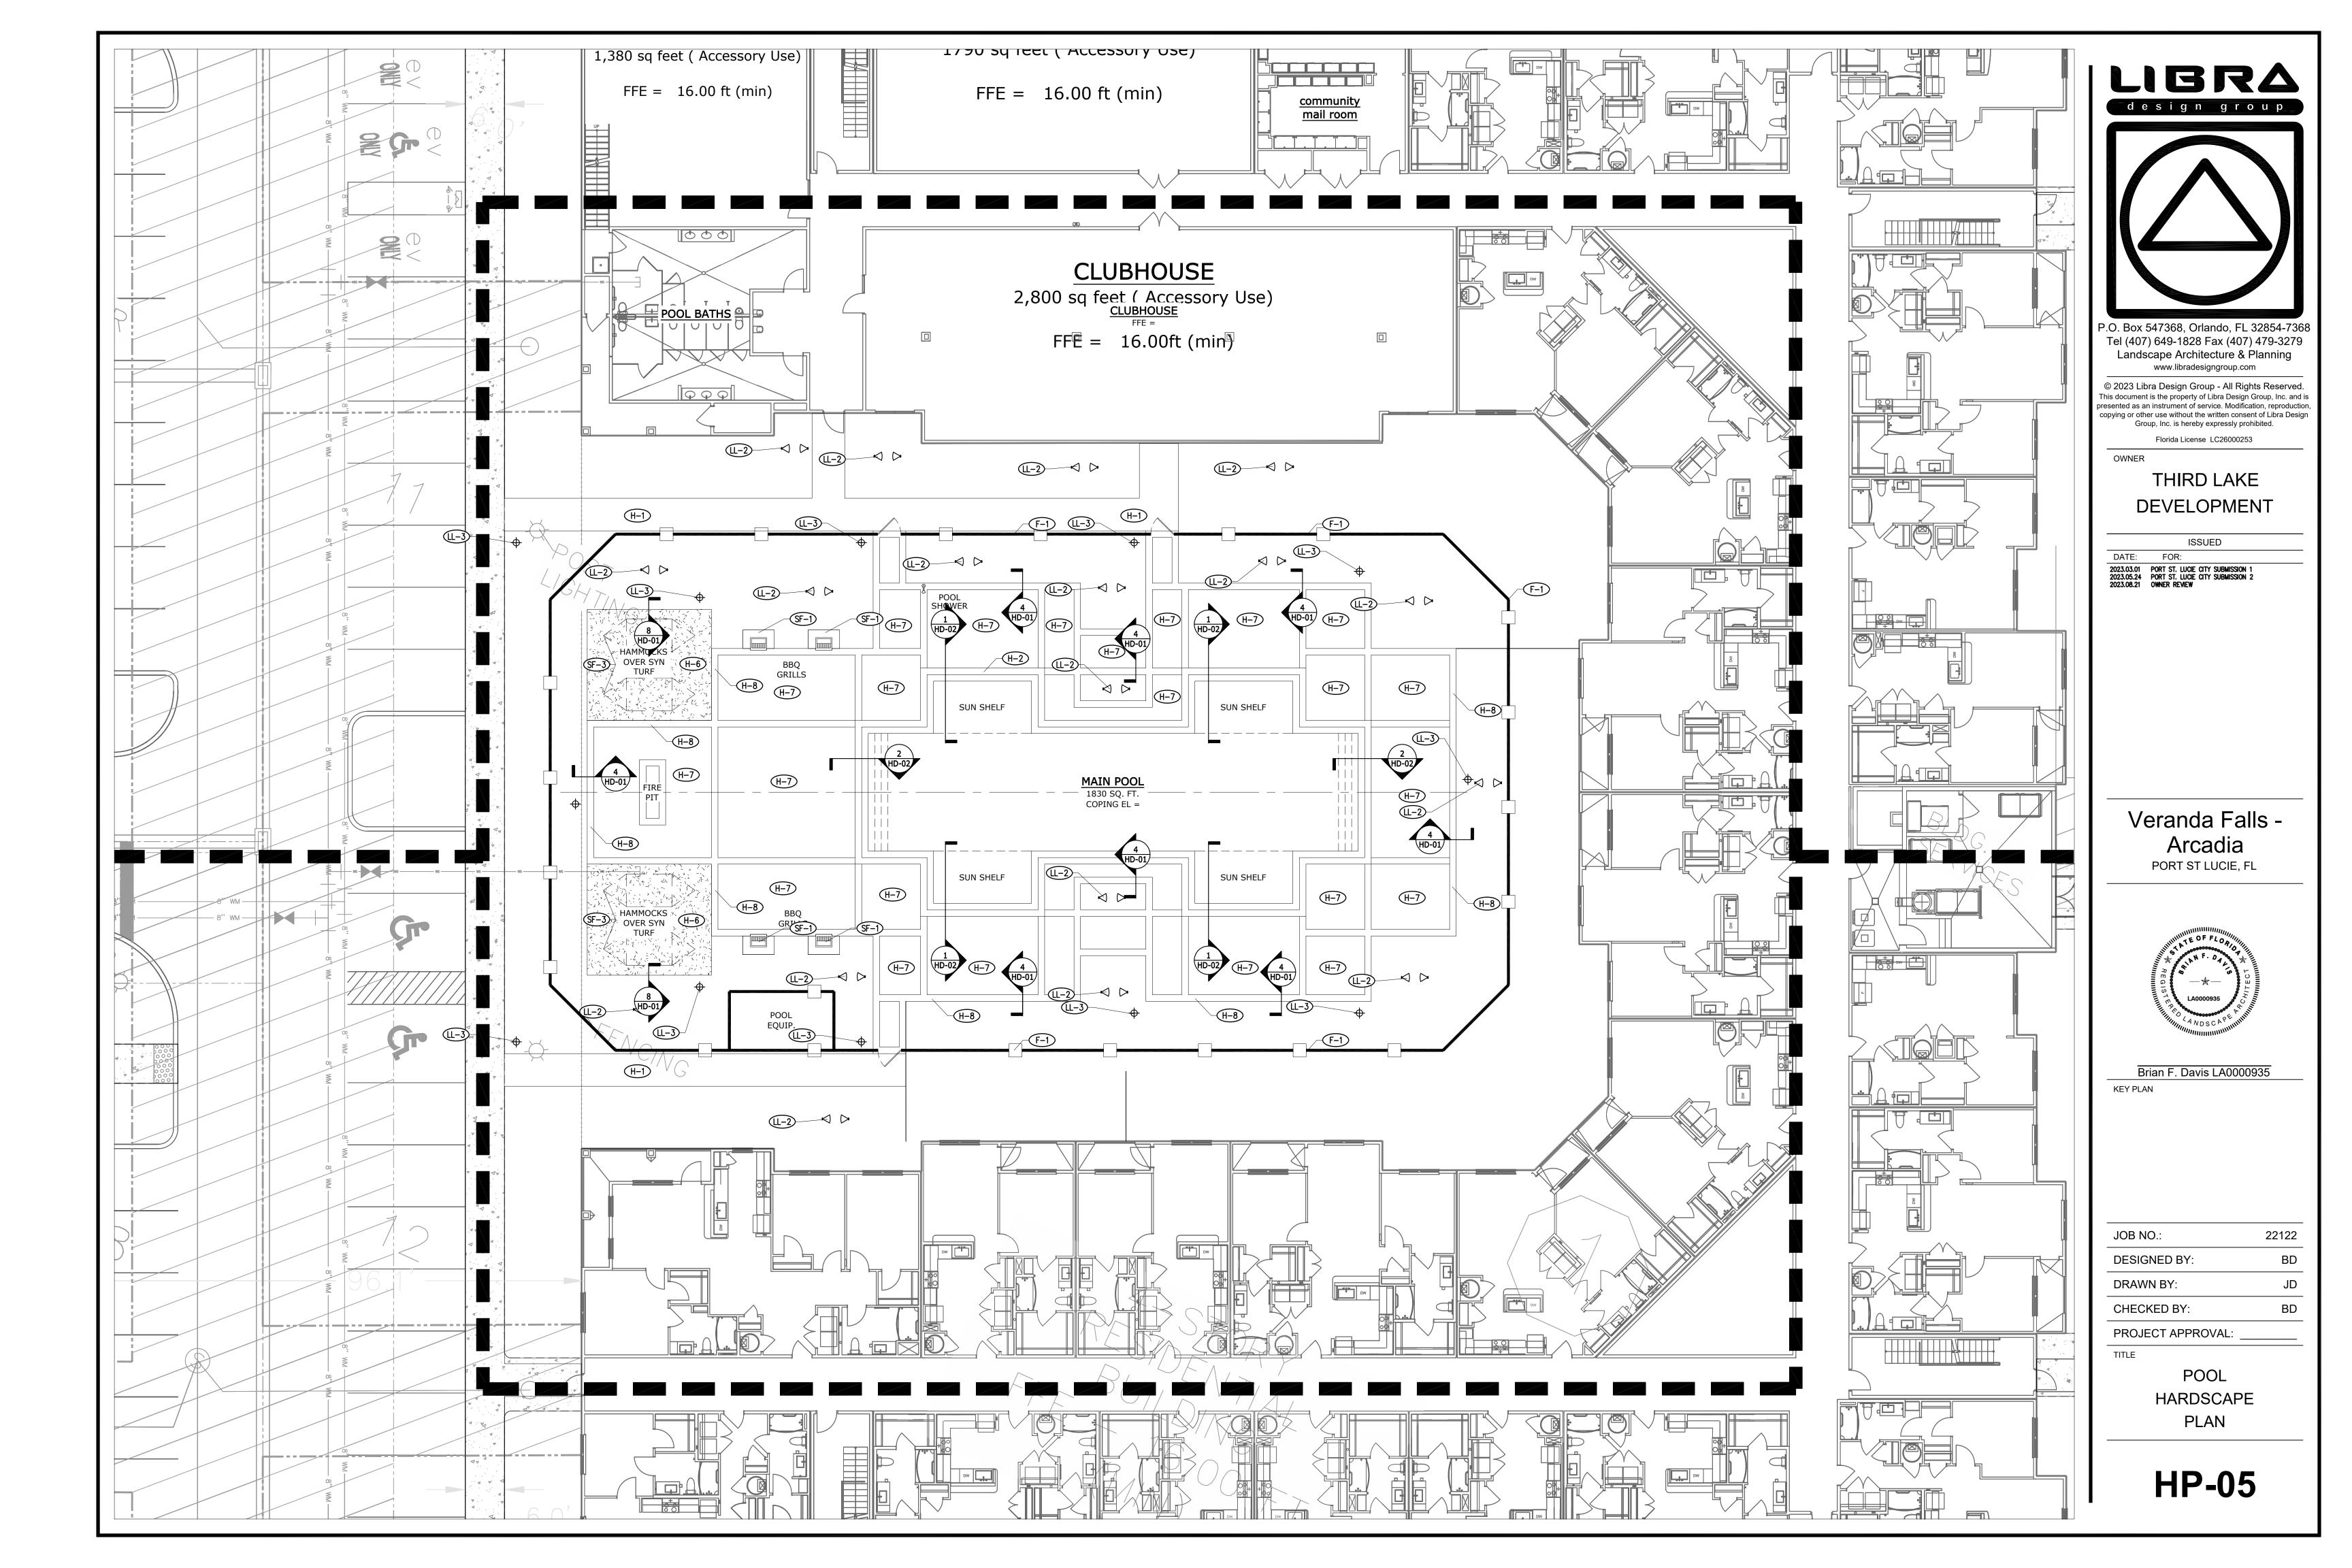

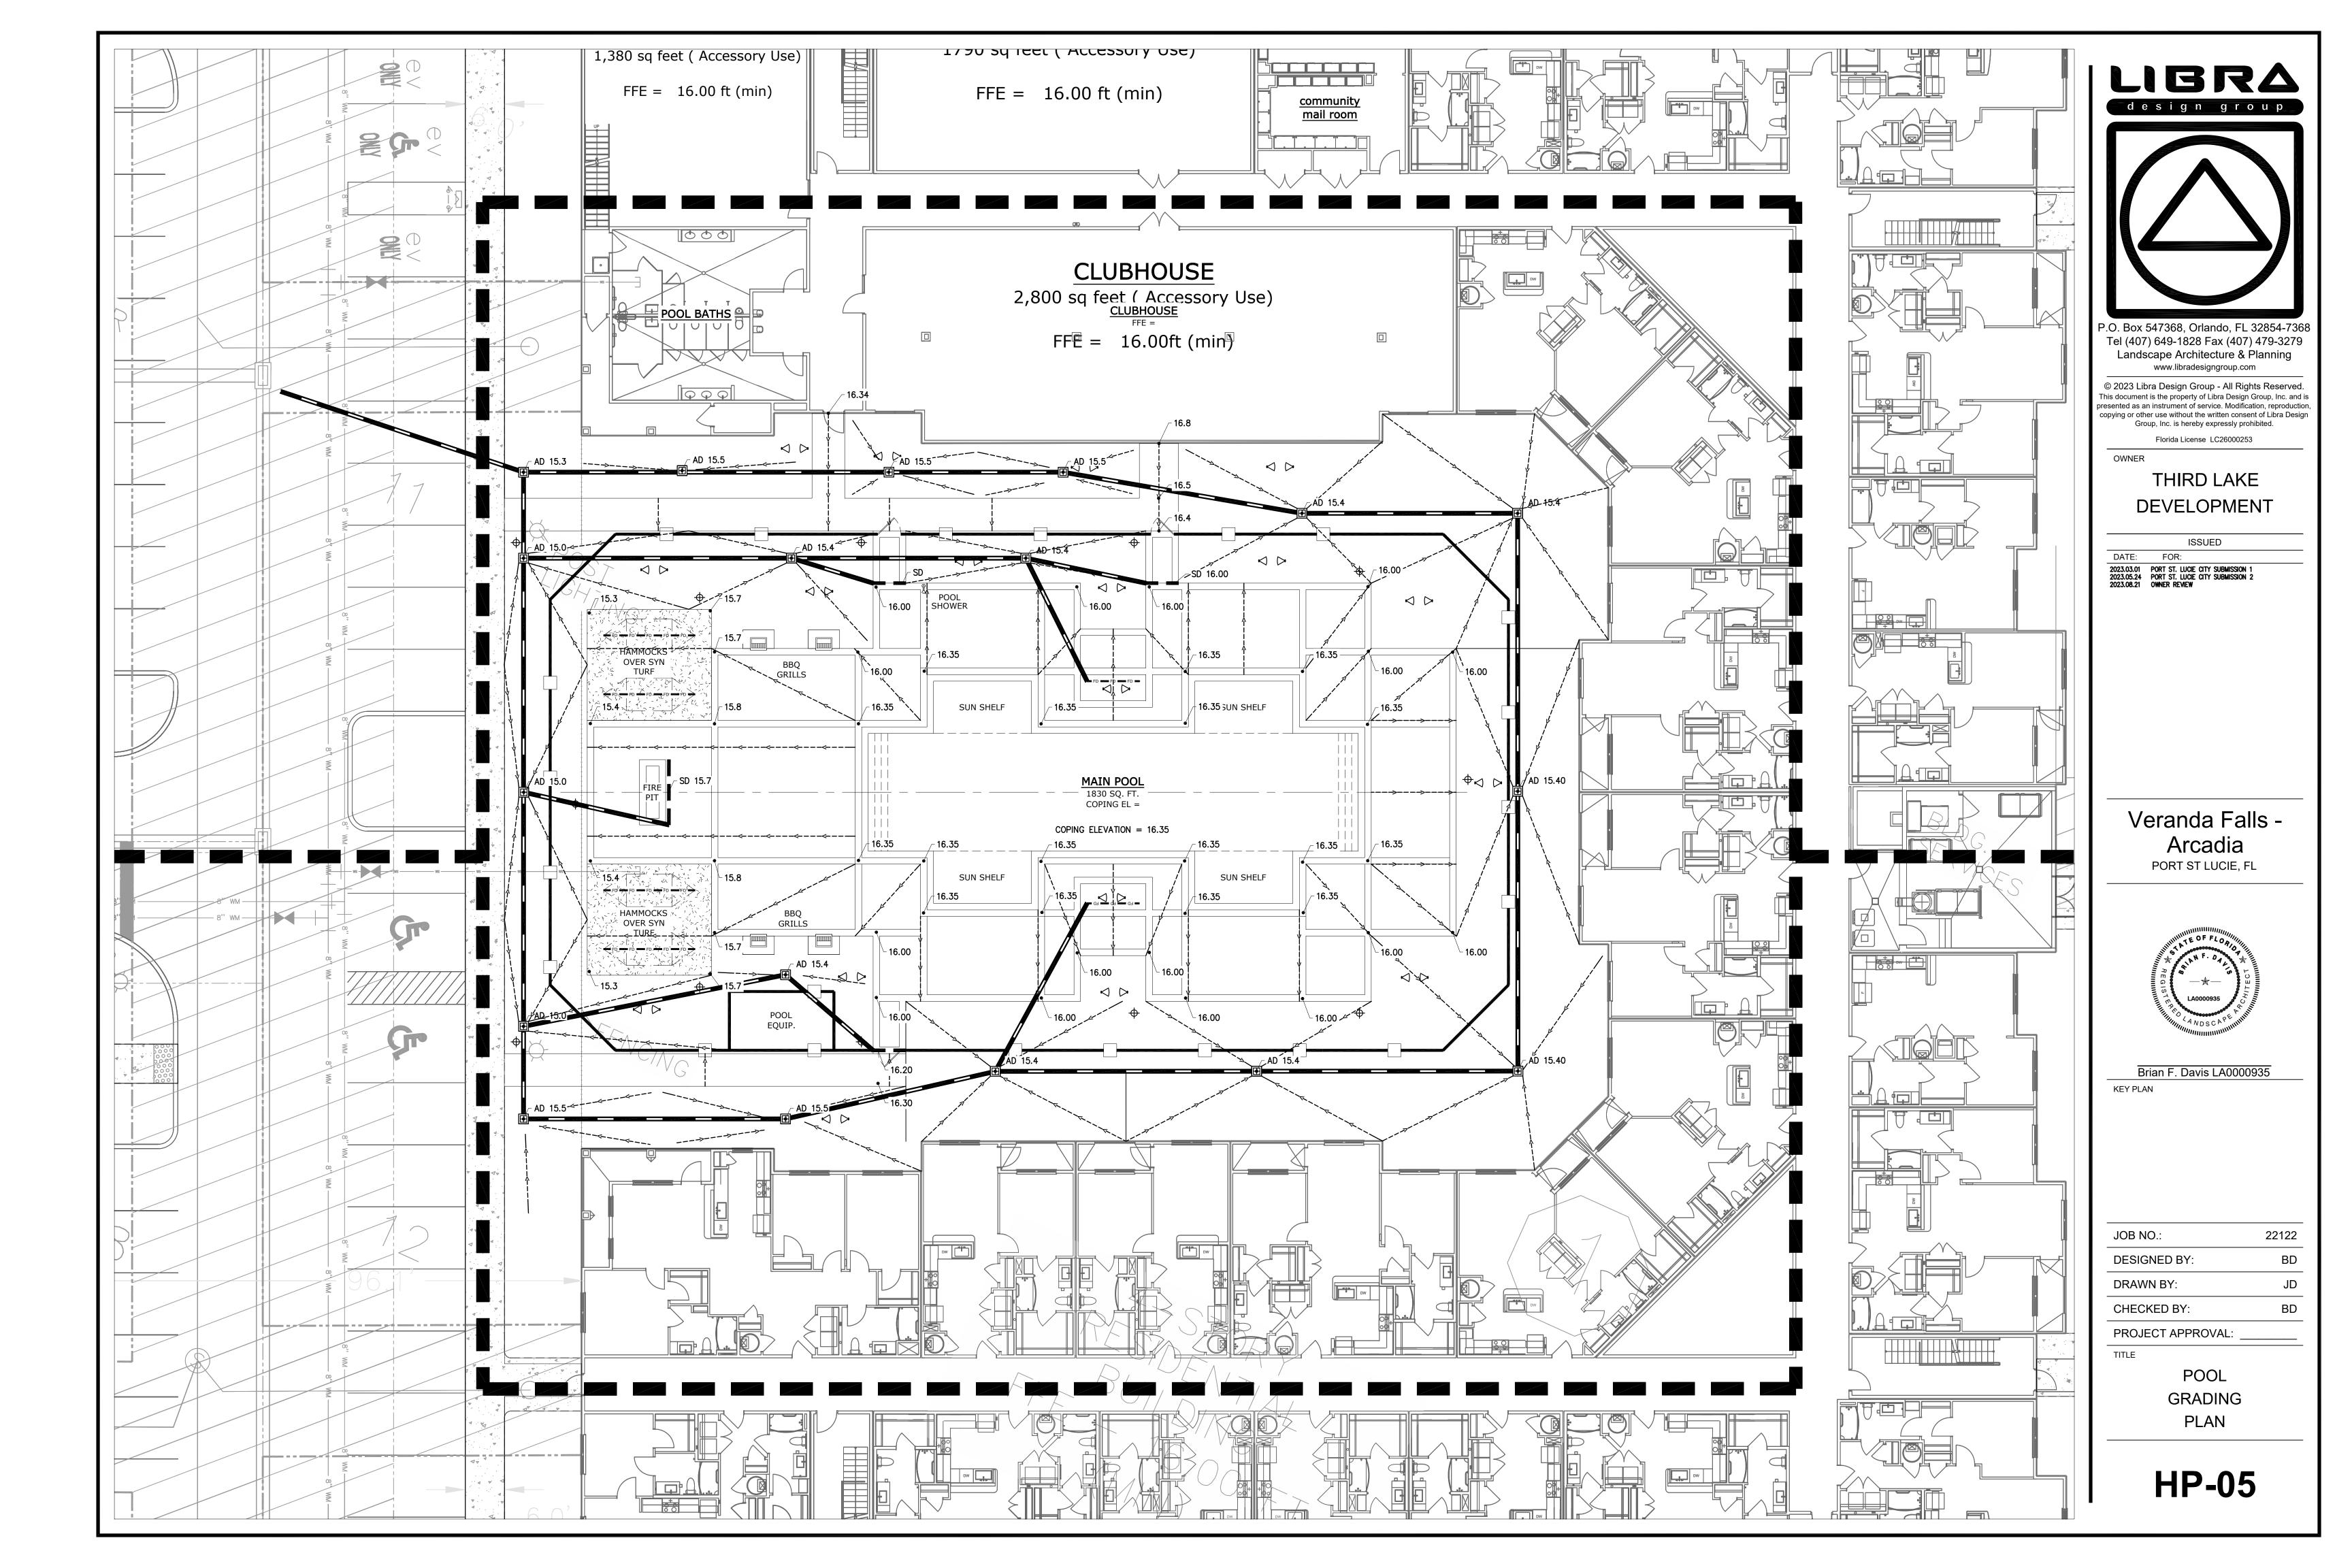

CALL OUT	DESCRIPTION	MANUFACTURER	SPECIFICATION
H-0	FUTURE, EXISTING OR WORK BY OTHERS (NOT IN CONTRACT)	N/A	N/A
H-1	CONCRETE SIDEWALK	N/A	FINISH: BROOM, PICTURE FRAME COLOR: GREY SEE: 1/HD-02
H-2	POOL COPING	ARTISTIC PAVERS	BULL NOSE COLLECTION REGULAR BULLNOSE SIZE: 12" X 24" THICKNESS: 1 5/8" COLOR: IVORY
H-3	POOL TILE	FUJIWA	SERIES: JOYA SIZE: 6" X 6" COLOR: ALBI 602 FINISH: SEMI-GLOSSY, SLIGHTLY TEXTURED, INTENTIONAL VARIATION FROM TILE TO TILE
H-4	POOL FINISH	DIAMOND BRITE	DIAMOND BRITE EXPOSED AGGREGATE POOL FINISH COLOR: SUPER BLUE
H-5	POOL STEP TILE	N/A	STEP TILE ON TOP STEP TILE ON FACE SKID RESISTANCE BULLNOSE CERAMIC TILE BLACK
H-6	SYNTHETIC TURF	SYNTHETIC TURF INTERNATIONAL	SOFTLAWN PET PREMIUM SEE 11/HD-02
H-7	PAVER FIELD	ARTISTIC PAVERS	STEPLOCK SERIES PLANKLOCK SIZE: 4" X 8" THICKNESS: 1 5/8" COLOR: SILVER SAM 50%, IVORY 50% RUNNING BOND RANDOM
H-8	PAVER BAND	ARTISTIC PAVERS	STEPLOCK SERIES SHELLOCK SIZE: 12" X 24" THICKNESS: 1 5/8" COLOR: IVORY PATTERN: RUNNING BOND
H-9	PERMEABLE VEHICULAR PAVERS	TREMRON PAVERS	PERMEABLE PAVERS SIZE: 4" X 8" THICKNESS: 3 1/8" COLOR: GRANITE PATTERN: HERRINGBONE
(H-10)	VEHICULAR PAVERS	TREMRON PAVERS	PARK PLAZA SIZE: 12" X 24" THICKNESS: 4" COLOR: GLACIER PATTERN: HERRINGBONE 45 DEGREE
(H-11)	VEHICULAR PAVERS ROUNDABOUT	TREMRON PAVERS	TUSCANY PAVERS SIZE: 4" X 4" THICKNESS: 4" COLOR: GLACIER
(H-12)	VEHICULAR PAVERS BAND	TREMRON PAVERS	PARK PLAZA SIZE: 12" X 24" THICKNESS: 4" COLOR: CHARCOAL
(H-13)	VEHICULAR CONCRETE BAND	N/A	SEE CIVIL ENGINEERING DRAWINGS FOR DETAIL AND STRUCTURAL

CALL OUT	DESCRIPTION	MANUFACTURER	SPECIFICATION
SF-1	OUTDOOR GAS GRILL	PSG	PGS T-SERIES GRILLD MODEL: T40NG FUEL: LIQUID PROPANE BASE: AMPB LED OPTION BUILT IN PGS FUELSTOP 60 MINUTE TIMER
(\$F-2)	POOL SHOWER ACCESIBLE	OUTDOOR SHOWER CO, LLC	MODEL: PS-900-ADA SEE: 10/HD-01 .5" ACCESSORIES & WATER SUPPLY CONNECTION
(SF-3)	НАММОСК	TUUCI	AIR LOUNGE HAMMOCK MATERIAL: CREST ASH 4662-0000 GRADE: MARINE C
SF-4	FIRE PIT	FLAME CREATION	60" Camden Concrete Fire Pit IGNITION: ELECTRONIC IGNITION FINISH: URBAN SLATE FUEL TYPE: LIQUID PROPAINE GAS (175,000 btu's) KEY VALVE: YES COVER: PREMUIM ACRYLIC
(SF-5)	ADA OUTDOOR GAS GRILL	LYNX GRILLS	30" SEDONA IGNITION: ELECTRONIC IGNITION FUEL TYPE: LIQUID PROPANE
SF-6	POOL CABANA	RESORT CABANA	CANCUN CABANA ENGINEERED SIZE: 10' X 10' Smoke 4615-0000 TEVELVISION MOUNTING PANEL POLYESTER POWDER COAT PAINTED FRAME: BLACK 10' UPRIGHT LEG CLEARANCE INSTALLATION SERVICES
 \$F−7	ICON SHELTERS	CRAFTSMAN SERIES	BUILDING TYPE: CC34M-P4 SHAPE: OCTAGON BUILDING SIZE: 32' COLOR: BLACK BASE CONNECTION: SURFACE MOUNT WITH COVERS
(SF-8)	POND FOUNTAINS	CASCADE FOUNTAINS	PISCES 1500 15 HP 230 VOLT THREE PHASE 208 OR 460V (3) PHASE
SF-9	BENCH	LANDSCAPE FORMS	AUSTIN BENCHED MOUNT: FREESTANDING MOUNT BACKED: ALUMINUM BOARDS OPTIONS: END ARMS COLOR: STEEL
(SF-10)	DOG FOUNTAIN	DOG ON IT PARKS	BARRIER FREE FOUNTAIN WITH PET BOWL OPTIONS: FREEZE RESISTANT VALVES; LEASH HOOK; HOSE BIB ITEM#: 7211 COLOR: GREEN .5" SUPPLY LINE MINIMUM 1.25" WASTE LINE
(SF-11)	SMALL DOG PLAY	DOG ON IT PARKS	SMALL DOG SYSTEM ITEM#: 1007 ADJUSTABLE JUMP BAR, AGILITY WALK, HOUND HURDLES, WALL JUMP (SINGLE), DOUBLE BOW WOW BARREL WITH CUSTOM DOG HOUSE, WAIT TABLE, & FLEXIBLE WEAVE POLES
€F-12)	LARGE DOG PLAY	DOG ON IT PARKS	COMPLETE SYSTEM ITEM#: 1015 A-FRAME, DOG WALK RAMP, WAIT TABLE, TEETER TOTTER, AGILITY WALK, HOUND HOOPS, HOUND HURDLES, FLEXIBLE WEAVE POLES, ADJUSTABLE TIRE JUMP, ADJUSTABLE JUMP BAR, WALL JUMP (SINGLE & DOUBLE), AND DOUBLE BOW WOW BARREL WITH CUSTOM DOG HOUSE.

CALL OUT	DESCRIPTION	MANUFACTURER	SPECIFICATION
(F-1)	POOL FENCE	AMERISTAR FENCE PRODUCTS	STYLE: ECHELON PLUS, MAJESTIC POOL, 3 RAIL MATERIAL: ALUMINUM STYLE: 4'-6' COLOR: BLACK SEE: 4/HD-03
(F-2)	DOG PARK FENCE ALTERNATE TO CHAIN LINK	AMERISTAR FENCE PRODUCTS	STYLE: ECHELON PLUS PUPPY, MAJESTIC, 3 RAIL MATERIAL: ALUMINUM HEIGHT: 4' COLOR: BLACK SEE: (SIMILAR)
(F-3)	POND FENCE	BARFIELD FENCE & FABRICATION	HEIGHT: 4' 2" X 6" X 6 GAUGE GALVANIZED POWDER COATED STEEL MESH 2.25" X .125" SQ. ALUM TUBE DIRT. SET IN CONCRETE FOOTER COLOR: BLACK
F-4	Х	X	X
(F-5)	VYNL FENCE	CERTAIN TEED	STYLE: GALVESTON HEIGHT: 6' COLOR: WHITE

CALL OUT	DESCRIPTION	MANUFACTURER	SPECIFICATION	SYMBOL
PE-1	POOL EQUIPMENT	×	125 AMP ELECTRICAL SERVICE 4" MIN. POOL WASTE WATER SERVICE (SANITARY OR STORM) 1" MIN. POTABLE WATER SERVICE ENCLOSURE COLOR: BLACK OR GREEN	
(LL-1)	SIGN LIGHT	COOPER INDUSTRIES	EON 303 A1 FINISH: BLACK	
(12)	LANDSCAPE LIGHT	COOPER INDUSTRIES	LUMIERE CAMBRIA 203 FINISH: BLACK	\triangle
(L-3)	POST TOP LIGHT	COOPER INDUSTRIES	INVUE ARB ARBOR POT TOP MOUNTING HEIGHT: 10; FINISH: BLACK	\oplus
<u>(L-4)</u>	BOLLARD LIGHT	COOPER INDUSTRIES	INVUE ABB ARBOR BOLLARD FINISH: BLACK	



© 2023 Libra Design Group - All Rights Reserved.

This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction, copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited.

Florida License LC26000253

JWNER

THIRD LAKE
DEVELOPMENT

ISSUE

DATE: FOR:

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1
2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2
2023.08.21 OWNER REVIEW

Veranda Falls Arcadia
PORT ST LUCIE, FL



Brian F. Davis LA0000935

KEY PLA

JOB NO.: 22122
DESIGNED BY: BFD

DRAWN BY:


CHECKED BY:

PROJECT APPROVAL: _

PROJECT APPROVAL

HARDSCAPE SCHEDULE

HD-00

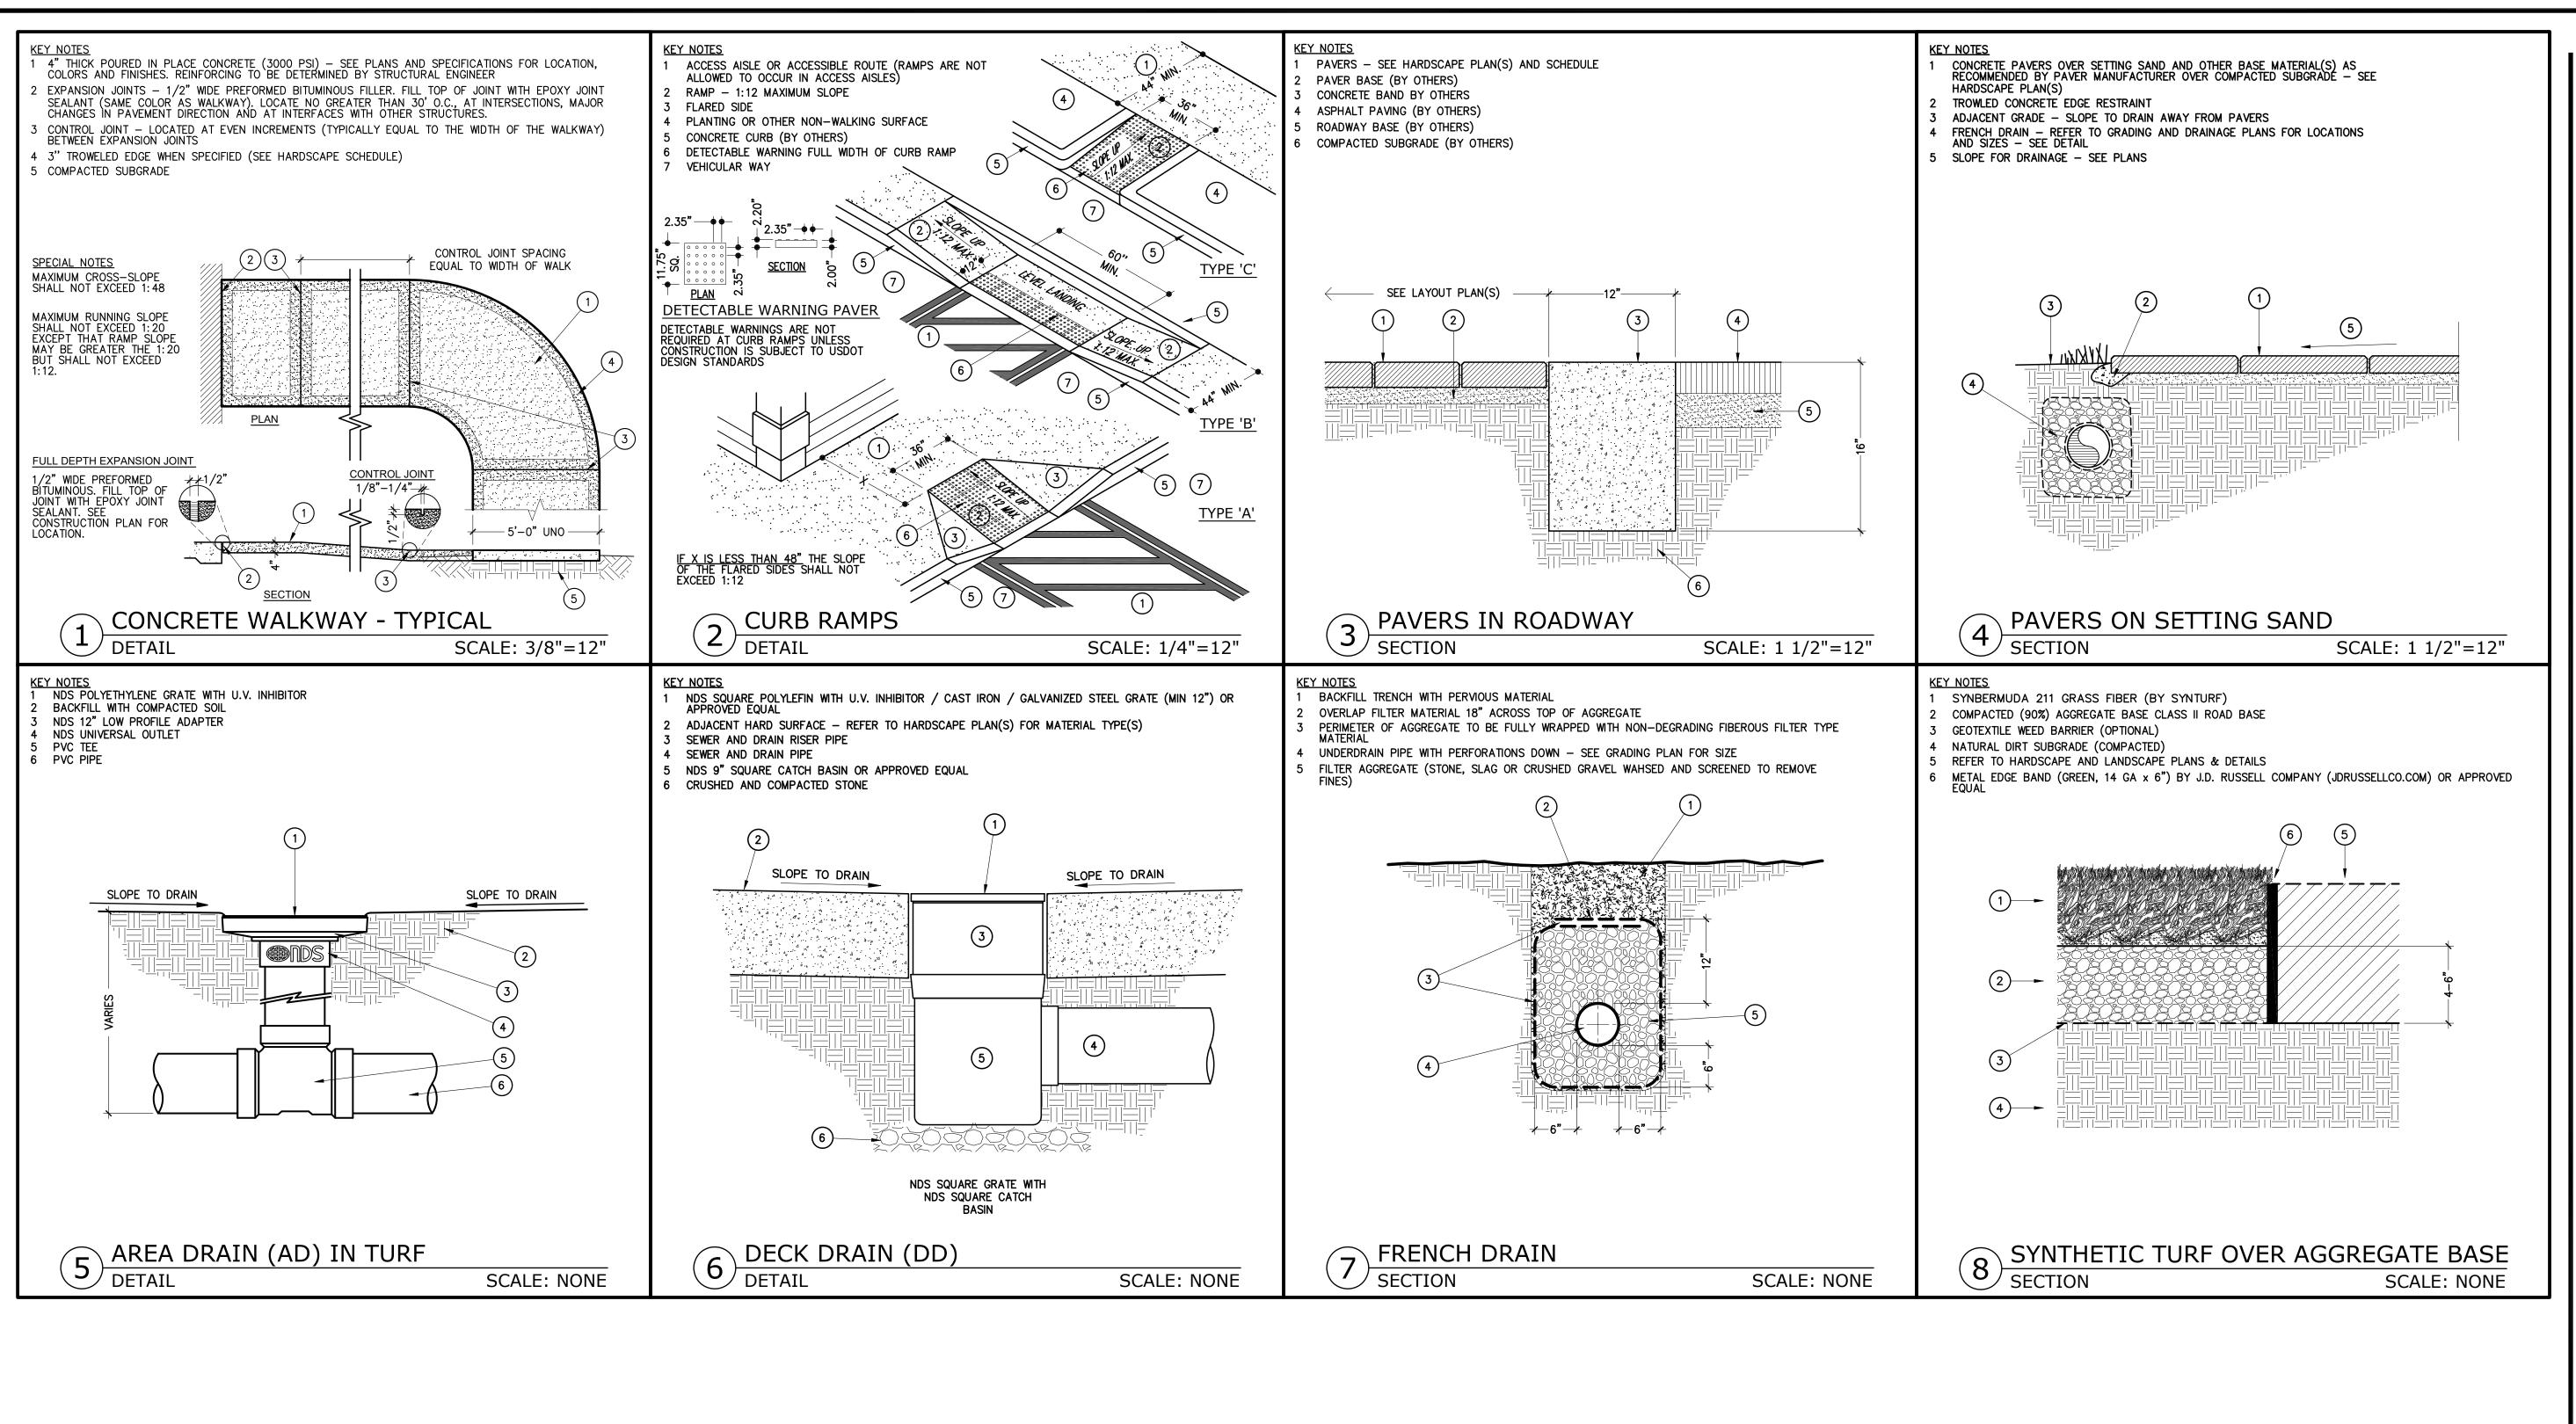



© 2023 Libra Design Group - All Rights Reserved. This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction, copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited.

Florida License LC26000253

OWNER

THIRD LAKE
DEVELOPMENT

ISSUED

DATE: FOR:

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1
2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2
2023.08.21 OWNER REVIEW

Veranda Falls Arcadia
PORT ST LUCIE, FL



Brian F. Davis LA0000935

KEY PLAN


JOB NO.: 22122
DESIGNED BY: BFD
DRAWN BY:

CHECKED BY:

PROJECT APPROVAL:

HARDSCAPE DETAILS

HD-01

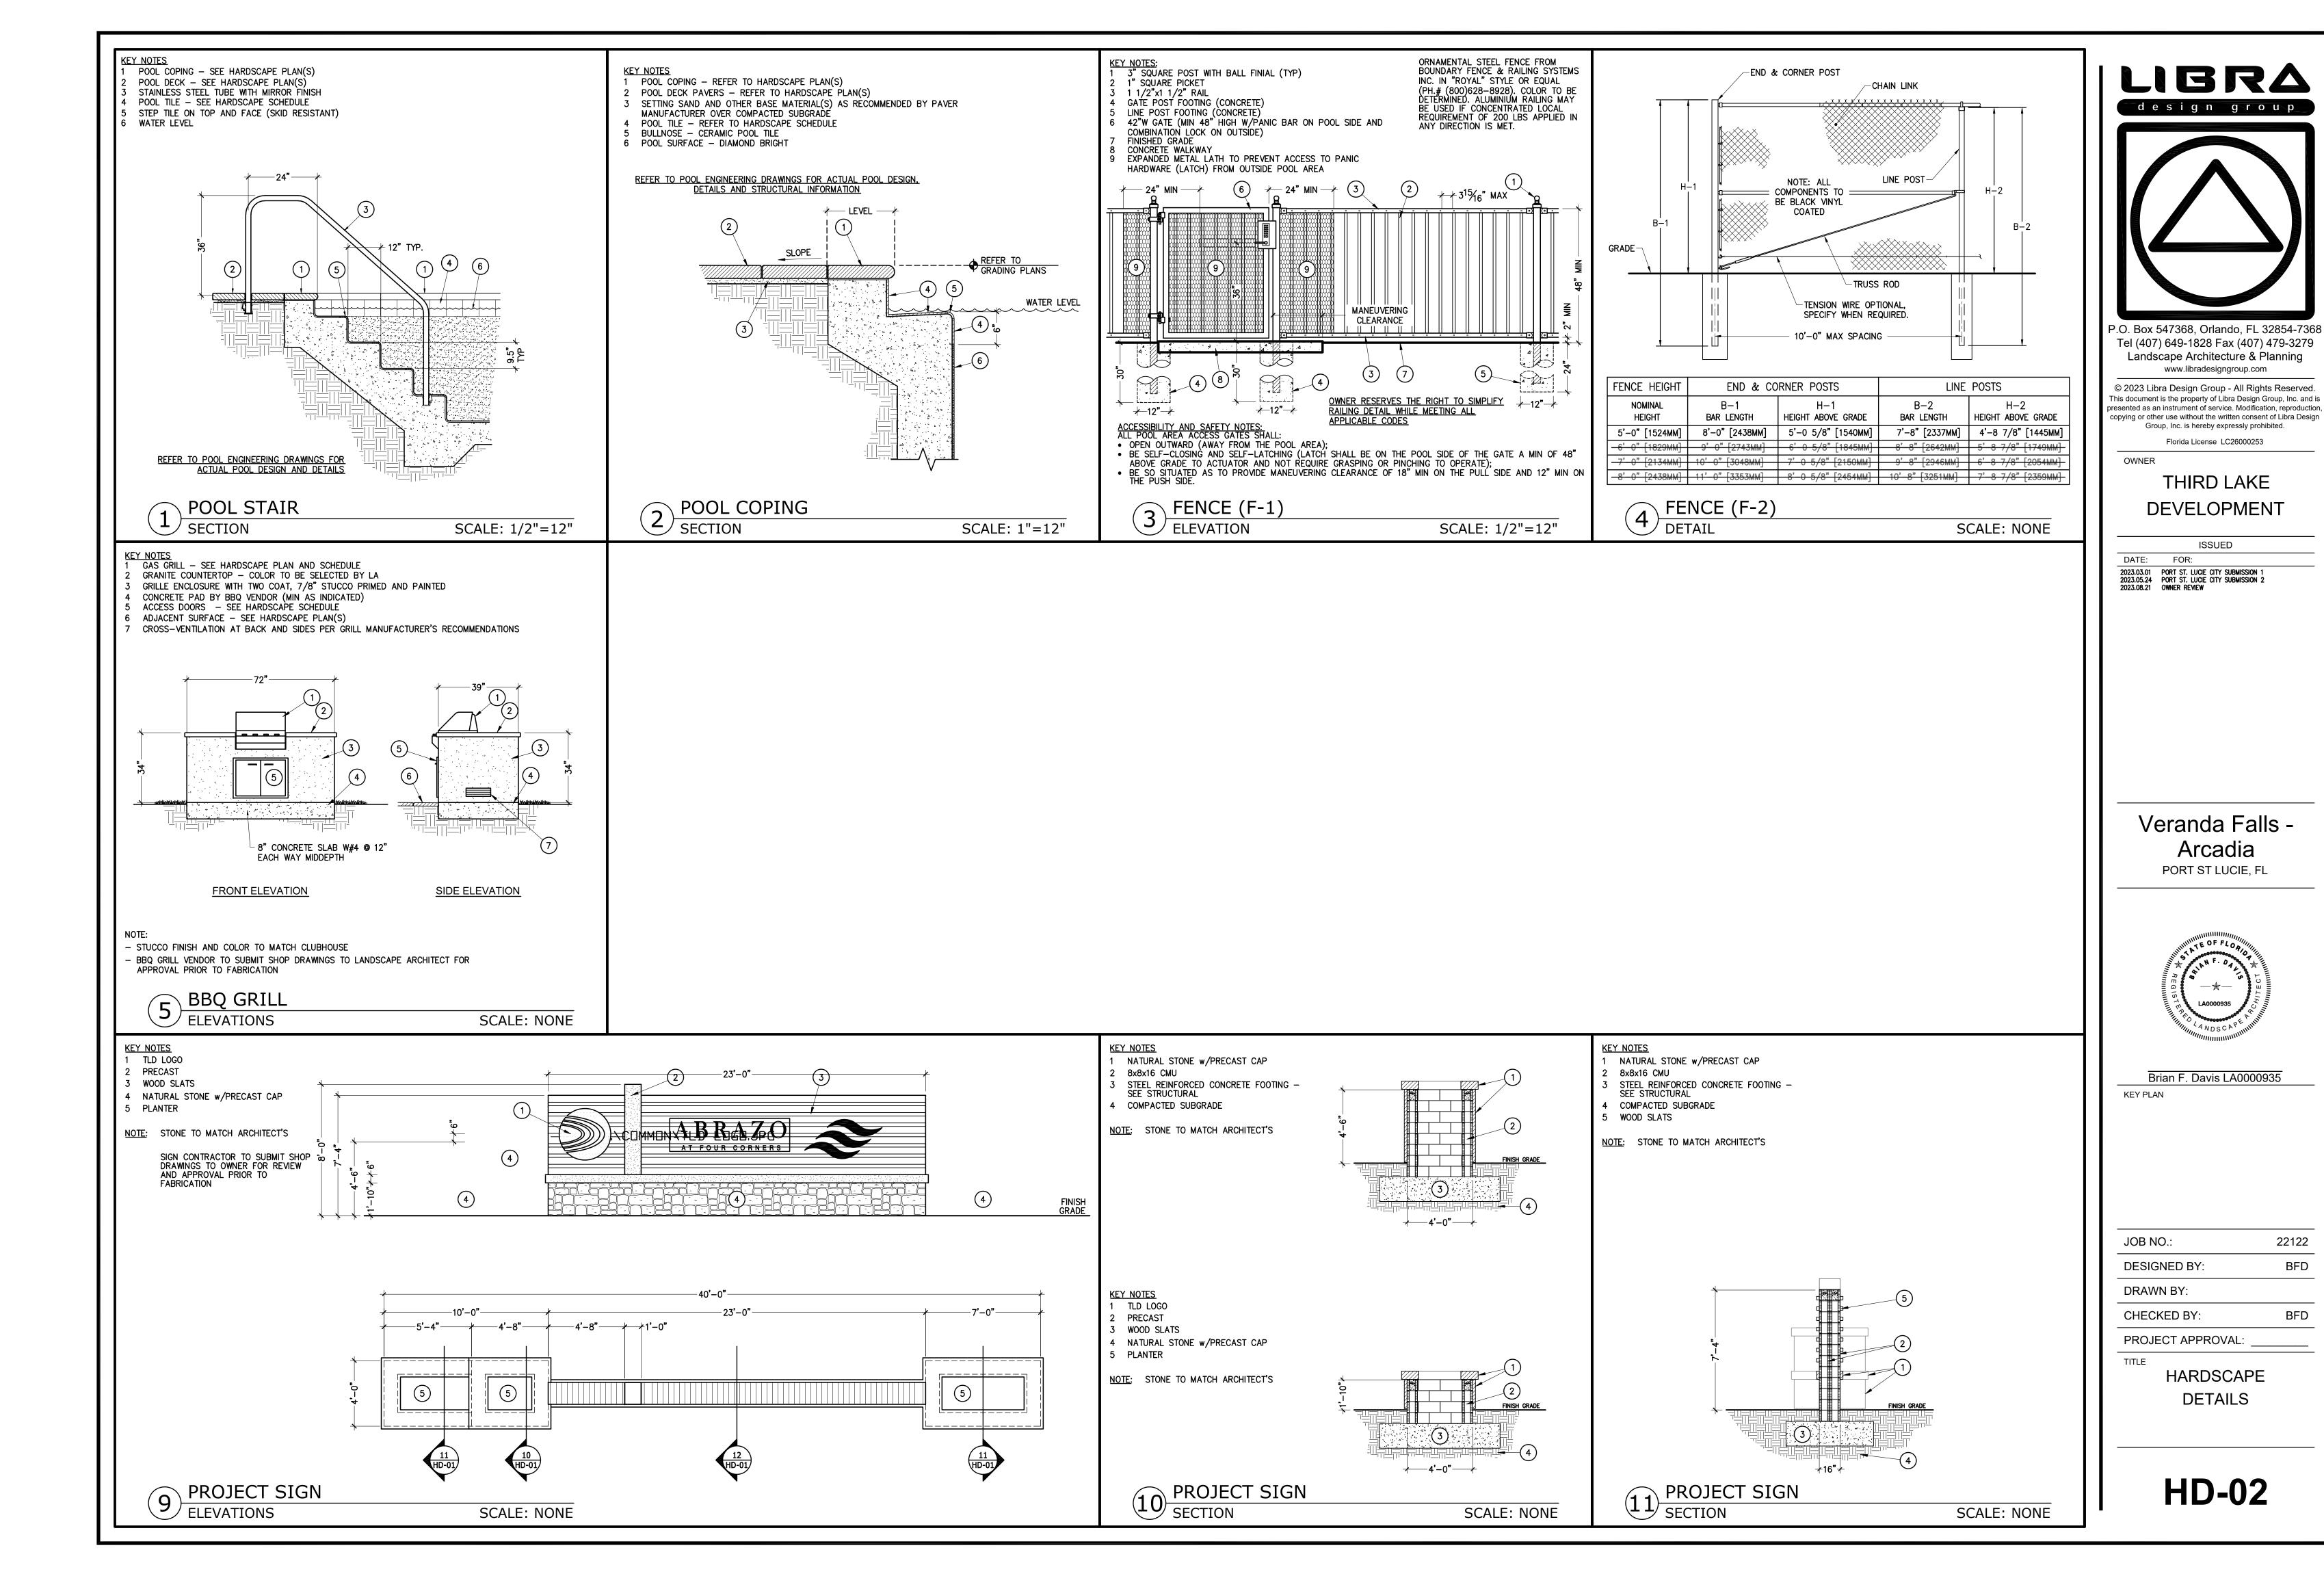

TREE ORDINANCE AND LANDSCAPE REQUIREMENTS CHECKLIST

Sec. 154.04. - Landscape material standards.

The following shall be considered minimum standards for all landscape materials:

(A)Plant Materials. Plant material used in conformance with the provisions of this chapter shall conform to the most recent standards for Florida No. 1 or better as given in "Grades and Standards for Nursery Plants", State of Florida, Department of Agriculture, or equal thereto. Trees and plants used in a required landscape design shall be cold-tolerant, drought-tolerant, or appropriate for the environmental setting in which they are to be planted. The "Waterwise South Florida Landscapes" plant guide, published by the South Florida Water Management District, as amended, should be used to determine appropriate vegetation. Plant materials which are known to be intolerant of paving environments or temperature below 32° F or 0° C, or whose physical characteristics may be injurious to the public or which produce a quantity and/or quality of debris so as to present maintenance difficulties shall not be specified for use under this chapter.

(B)Florida Friendly or Xeriscape plant materials. Florida Friendly or Xeriscape landscaping means a type of quality landscaping that conserves water and protects the environment by using site appropriate plants, an efficient watering system, proper planning and design, soil analysis, practical use of turf, the use of mulches, and proper maintenance. The intent is to establish and maintain a healthy landscape by matching the right plants with existing site conditions to minimize the use of additional resources, such as water, fertilizer, and pesticides. A Florida Friendly or Xeriscape plan may be approved by the site plan review committee when the applicant can assure the health and survivability of all landscaping plant materials. Plant materials shall be approved native and suitable non-native trees, shrubs, and ground covers that require minimal maintenance when planted under appropriate conditions. Appendix D: City of Port St. Lucie Suggested Tree List and the South Florida Water Management District "Waterwise South Florida Landscapes" plant guide shall be used as a guide for choosing plant materials.

(C)Trees.

1.Trees shall be a species having an average mature spread of crown greater than 20 feet. Trees shall have a trunk that is maintained in a clean condition with over five feet of clear wood (no branches).

2.Tree species shall be a minimum of twelve (12) feet overall height when planted with a minimum five (5) foot crown spread. At planting, the trees shall have a caliper of at least 2.5 inches. Palm trees shall have a minimum clear trunk height of ten (10) feet except for Canary Island Date Palm, Edible Date Palm, and Bismark Palm. Canary Island Date Palm, Edible Date Palm, and Bismark Palm shall have a minimum clear trunk height of six (6) feet. For the requirements of Section 154.03(C)(2) "Landscaping around Building Façade", the minimum height may be reduced to eight (8) feet. Required trees may be selected from Appendix C: City of Port St. Lucie Suggested Tree List located at the end of this chapter and/or the "Waterwise South Florida Landscapes" plant guide, published by the South Florida Water Management District provided the trees are of the appropriate USDA plant hardiness zone and ecological setting. Additional tree species may be considered based upon certification from a Florida registered landscape architect as to appropriate USDA plant hardiness zone and ecological setting. Smaller trees having an average mature spread of crown less than 20 feet may be arranged in groupings or clumps of two (2) or more so as to create the equivalent of a 20-foot crown spread; however, the grouping or groupings shall count as one (1) tree. Substitutions do not apply to certain portions of this chapter which identify specific planting requirements. The requirement for smaller trees to be planted in clumps of two or more so as to create the equivalent of a 20-foot crown spread does not apply to building façade landscaping or landscaping below overhead power lines.

3.No species designated as Category 1 on the Exotic Plant Pest Council's most recent list of "Florida's Most Invasive Species," shall be used to meet the requirements of this section.

4.No more than twenty-five (25) percent of required trees shall be palm trees. The building façade landscape strip is exempt from this requirement.

5.At least fifty (50) percent of all required trees shall be native species.

6.At least twenty (20) percent of the required trees shall be flowering trees.

7.At least seventy-five (75) percent of the trees located within landscape islands shall be evergreen shade trees.

8. When more than ten (10) trees are required to be planted to meet the requirements of this Code, a mix of species shall be provided. The minimum number of species to be planted is indicated in the following table. When a mix of species is required, no single species shall exceed a 2 to 1 ratio relative to all other individual species.

Required Tree Species Mix

Number of Trees Required	Minimum Number of Specie
11—20	2
21—30	3
31—40	4
41+	5

9. Trees of species whose roots are known to cause damage to public roadways, utilities, sidewalks, or other public works shall not be planted closer than 10 feet to those public works.

10. In those instances where a tree(s) is planted closer than five (5) feet from a sidewalk, or structure, a root barrier(s) shall be installed. Root barriers for trees shall be installed along the edge of structure, paving, or curb. The root barrier shall be a minimum of twenty-four (24) inches deep, but depending on the size, location, and species of tree to be planted, a larger barrier may be required. The root barrier shall be installed with twenty (20) linear feet, centered from the trunk, for large trees and fifteen (15) linear feet for smaller trees. All root barriers shall be linear.

(D)Shrubs and Hedges. Shrubs shall be a minimum of two feet in height when measured immediately after planting. When used for screening purposes they shall be spaced a maximum of twenty-four inches on center and shall be maintained so as to form a continuous, unbroken, solid screen within a maximum of one year after time of planting. If wider growing plants are used, spacing may be increased, but should provide a full appearance with adjacent plants touching each other. Required shrubs shall be selected from the "Waterwise South Florida Landscapes" plant guide, published by the South Florida Water Management District. Additional species may be considered based upon certification from a Florida registered landscape architect as to appropriate USDA plant hardiness zone and ecological setting. Saw Palmetto can have a minimum size of 12 inches and be spaced a maximum of thirty-six inches on center. At least twenty-five (25) percent of all shrubs shall be native species.

(E)Ground Cover. Ground covers, other than grass, shall be planted in such a manner as to present a finished appearance and a reasonably complete coverage within four months after planting. Ten (10) percent of the groundcover shall be flowering groundcover. Groundcover shall be selected from the "Waterwise South Florida Landscapes" plant guide, published by the South Florida Water Management District. Additional species may be considered based upon certification from a Florida registered landscape architect as to appropriate USDA plant hardiness zone and ecological setting.

(F)Lawn Grass. Grass areas shall be planted in species normally grown as permanent lawns in the county. Limit the use of sod to a maximum of 50 percent of site landscaping.

(G)Vines. Vines shall be a minimum of 30 inches in height immediately after planting and may be used in conjunction with fences, screens, or walls to meet physical barrier requirements as specified.

(H)Synthetic Plants. Synthetic or artificial material in the form of trees, shrubs, ground cover, vines, or artificial turf shall not be used in lieu of plant requirements in this section. (Ord. No. 15-70, § 1, 9-14-15)

Sec. 154.05. - Installation and maintenance of required landscaping.

The following standards shall apply:

(A)Planting Practices. All landscaping shall be installed according to sound nursery practices in a manner designed to encourage vigorous growth. Soil improvement measures may be required to ensure healthy plant growth. All elements of landscaping shall be installed so as to meet any other applicable ordinances. A plant's or tree's growth characteristics shall be considered before planting to prevent conflicts with utilities, views, or signs. See Section 154.03(I) for landscaping and utilities.

(B)Staking. All balled and burlapped trees and palms shall be staked. Trees and palms shall be staked until the roots have become established for a period typically between 6 months and 1 year or as specified by a landscape architect.

(C)Responsibility. The owner, tenant, and their agent, if any, shall be jointly and severally responsible for the maintenance of all landscaping which shall be maintained in good condition so as to present a healthy, neat, and orderly appearance at all times, shall be kept free from refuse, debris, and exotic vegetation. Maintenance shall include, but is not limited to, trimming, replacement of all dead plant material, removal of all invasive and exotic plant material, and removal of refuse and debris. If vegetation which is required to be planted or preserved dies it shall be replaced with equivalent vegetation.

(D)Irrigation. All sodded and planted areas shall be provided with an irrigation system except for Florida Friendly or Xeriscape areas. Florida Friendly or Xeriscape areas must have a readily available water supply to provide temporary irrigation until plantings are established. A Florida Friendly or Xeriscape plan may be approved by the Site Plan Review Committee when the applicant can assure the health and survivability of all landscaping plant materials. See Section 154.03(H) for irrigation requirements.

(E)Nonconformance. If at any time after issuance of a certificate of occupancy the landscaping of a development is found to be in nonconformance, the Planning and Zoning Department shall issue notice to the owner, tenant, and/or agent that action is required to comply with this chapter and the owner, tenant, and/or agent shall have 30 days to restore the landscaping as required. Failure to comply will result in a Code Compliance Board hearing.

(F)Pruning and Topping. Pruning restrictions shall not apply for trees located under power lines. Trees shall be pruned only as necessary to promote healthy growth. Trees shall be allowed to attain their normal size and shall not be severely pruned or "hatracked" in order to permanently maintain growth at a reduced height. Trees may be periodically pruned or thinned in order to reduce leaf mass in preparation for tropical storms. All pruning shall be accomplished in accordance with the National Arborist Association's standards.

(G)Vertical Clearance Over a Roadway. Trees that encroach into roadways shall be maintained in accordance with the St. Lucie County Fire District Fire Prevention Code.

(H)Walls and Fences. All walls, fences, and entrance features shall be maintained in working order and shall be free from structural deterioration, sagging, disrepair, or other deterioration or defects so as to present a neat and orderly appearance at all times and shall be kept free from mildew, peeling paint, and graffiti.

(I)Permitted landscaping existing on the effective date of this chapter shall be maintained as originally permitted. However, replacement trees and plants must meet the current requirements of this chapter.

GENERAL LANDSCAPE NOTES

The work consists of the provision of all materials and work as called for on the landscape plans, specifications and as herein specified. This work shall include, but is not limited to, the supplying of all plant materials specified, the furnishing of all labor, equipment, water, electricity, equipment and all materials called for and in performing all operations in connection with the landscape installation. Further, the work shall include maintaining of all plants and planting areas until final acceptance by the owner and fulfilling all guarantee provisions. The landscape contractor shall assign a qualified project manager and field supervisor to work directly with the Landscape Architect and supervise the work at all times through final owner acceptance.

All installation of plant material shall comply with applicable jurisdictional codes. The contractor is responsible for obtaining all permits associated with their work.

All on-site existing conditions including surface and subsurface utilities, grades, dimensions and soil conditions shall be verified by the landscape contractor before construction begins. The landscape contractor shall become familiar with all plans prepared by others that affect the landscape and irrigation work. Any discrepancies shall be brought to the attention of the Landscape Architect.

Every possible safeguard shall be taken to protect building surfaces, equipment, furnishings and existing planting areas to remain including lawn. The contractor is responsible for any damage or injury to person or property that may occur as a result of negligence in the execution of the contractor's work.

The contractor shall interface with other work being performed by other contractors. It will be necessary for the contractor to coordinate and schedule activities, where necessary, with other contractors and their subcontractors. The landscape contractor shall insure that their work does not impact established or projected drainage patterns.

Prior to planting installation, the contractor shall confirm the availability of all the specified plant materials and make arrangements with the Landscape Architect to review and mutually field tag agreed upon plant materials at least 2 weeks prior to procurement and delivery to the job site. Representative samples of shrubs and groundcover to be provided to the Landscape Architect by the landscape contractor in lieu of field visits.

All plant material shall meet or exceed the requirements for FLORIDA #1 quality in accordance with the grades and standards for nursery plants published by the State of FLORIDA, Department of Agriculture, current edition.

All plant material sizes specified are minimum sizes. All container and tree caliper sizes are minimum. Container or caliper size may be increased if necessary to provide overall plant size specified.

The landscape contractor shall provide any specified b&b trees from a 'Roots Plus' nursery source. Contact the Roots Plus Growers Association at (800) 837-4011 or visit www.rootsplusgrowers.org for the names of member nurseries. All other trees to be container grown or as specified.

All plant material shall be subject to approval at the job site by the Landscape Architect prior to installation. When delivered plant material does not comply with the requirements, the Landscape Architect reserves the right to reject such plants and require the landscape contractor to replace rejected work and continue specified maintenance until reinspected and found to be acceptable. The landscape contractor shall remove rejected plants and materials from the planting site within 48 hours and replace with acceptable materials.

No plant substitutions will be permitted without prior written approval from the Landscape Architect. If specified plant materials are not available, identify the extent and quantity in writing together with a recommended substitution that meets or exceeds the initial requirement.

The landscape contractor shall be responsible for removing existing vegetation as required and preparing planting areas prior to installation of plant materials.

The landscape contractor shall test project soils to verify that the soils on-site are acceptable for proper growth of plant materials and adequate drainage in plant beds and planters. The landscape contractor shall coordinate the location, and procurement of existing on-site soil samples with the Landscape Architect. Representative samples shall be submitted to a certified testing laboratory for analysis. The findings, together with recommendations for amending the soils shall be reviewed and approved by the owner and Landscape Architect prior to delivery and installation of plant materials at the job.

The landscape contractor shall insure adequate vertical drainage in all plant beds and planters. If necessary to insure drainage, vertical drilling through hardpan and compacted fill shall be performed by the contractor.

All planting beds shall be staked in accordance with the plans and approved by the Landscape Architect prior to planting. The landscape contractor shall provide stakes or irrigation flags to locate the edges of all shrub and groundcover plant beds and individual trees and palms. The contractor shall field stake the location of all plant bed outlines and individual trees and obtain the Landscape Architect's approval prior to delivery and installation of the plant material. If existing conditions do not allow the design to be laid out as shown, notify the Landscape Architect immediately.

All proposed trees shall be installed either entirely in or entirely out of planting beds. Planting bed outlines shall not be obstructed and shall be smooth and flowing. If trees are located outside planting beds in sod areas, maintain a minimum 3' wide offset to allow for mowers to maneuver.

The plant quantities showed on the landscape contract documents are for the convenience of the landscape contractor. The landscape contractor is responsible for verifying all quantities and reporting any discrepancies to the Landscape Architect for clarification prior to contract award and commencement of work.

The landscape contractor shall verify the extent of sod work in the field. The contractor shall be responsible for providing grass sod in the areas shown on the plan in sufficient quantity to provide full coverage. Additional sod required will be adjusted based on a square footage unit price. Areas to be sodded shall be amended per soils report to provide required nutrients and soil ph of between 6.0 and 7.0.

The contractor shall be responsible for providing plants, spaced as specified in the plant list. When installing shrubs in planting beds, spacing of material shall take precedence over quantity of materials indicated for planting areas. The contractor shall notify the Landscape Architect immediately if such situations arise. Shrub and groundcover spacing is generally indicated on the plant list for all 'mass plantings'. Accent shrubs and trees that are not part of mass plantings shall be spaced as shown on the plans.

The landscape contractor shall be responsible for the stability and plumb condition of all installed plant materials and replacing any damaged plant material. With plants of equal kind, size and condition at no additional cost to the owner. No chains or cables shall be used when installing plant materials. It shall be the contractor's responsibility to prevent plants and trees from falling or being blown over, and to replace all plants which are damaged due to inadequate guying or staking, at no additional cost to the owner. The contractor shall remove all staking materials the end of the warranty period and dispose offsite.

All planting beds shall be top-dressed with a 3" layer of mulch as specified. All trees shall have a 3" thick mulch ring placed around the base of the trunk. The landscape scope of work includes mulching as an integral part the project and not as a separate cost or works item.

All plant materials shall receive adequate watering by the landscape contractor as required until the landscape irrigation system is fully operational and until final acceptance by owner.

All existing plant beds to remain within the construction limit line shall be left undisturbed. Existing trees to remain, as noted on the drawings, shall be left undisturbed and protected by wooden barricades erected at the perimeter of the tree drip line (s). No vehicle shall traverse this area nor shall any storage of materials or equipment be permitted within the area of the tree dripline(s). Any existing plant beds or trees damaged by construction activity shall be replaced by the responsible party at their own expense.

No trees shall be planted within designated utility corridors, public right of way (without right of way utilization permit) nor any plants located within four feet (4') of any swale centerline identified on the drawings. Field adjust as necessary and review adjustments with the Landscape Architect prior to installation.

The contractor shall be responsible for providing effective traffic control and removal of all debris and excavated backfill off-site on a daily basis at no additional cost to the owner.

Refer to the Landscape Specifications for additional requirements.

A fully underground automatic irrigation system will be installed as part of the project. The system will be a combination of drip and spray design with sod areas receiving spray irrigation and shrub bed areas designed for a drip system.



P.O. Box 547368, Orlando, FL 32854-7368 Tel (407) 649-1828 Fax (407) 479-3279 Landscape Architecture & Planning

www.libradesigngroup.com

© 2023 Libra Design Group - All Rights Reserved. This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction, copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited.


Florida License LC26000253

THIRD LAKE
DEVELOPMENT

DATE: FOR:

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1
2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2
2023.08.21 OWNER REVIEW

Veranda Falls Arcadia
PORT ST LUCIE, FL



Brian F. Davis LA0000935

KEY PLAN


JOB NO.:	22122
DESIGNED BY:	BD
DRAWN BY:	JD
CHECKED BY:	BD


TITLE


LANDSCAPE NOTES


PROJECT APPROVAL


LN-01

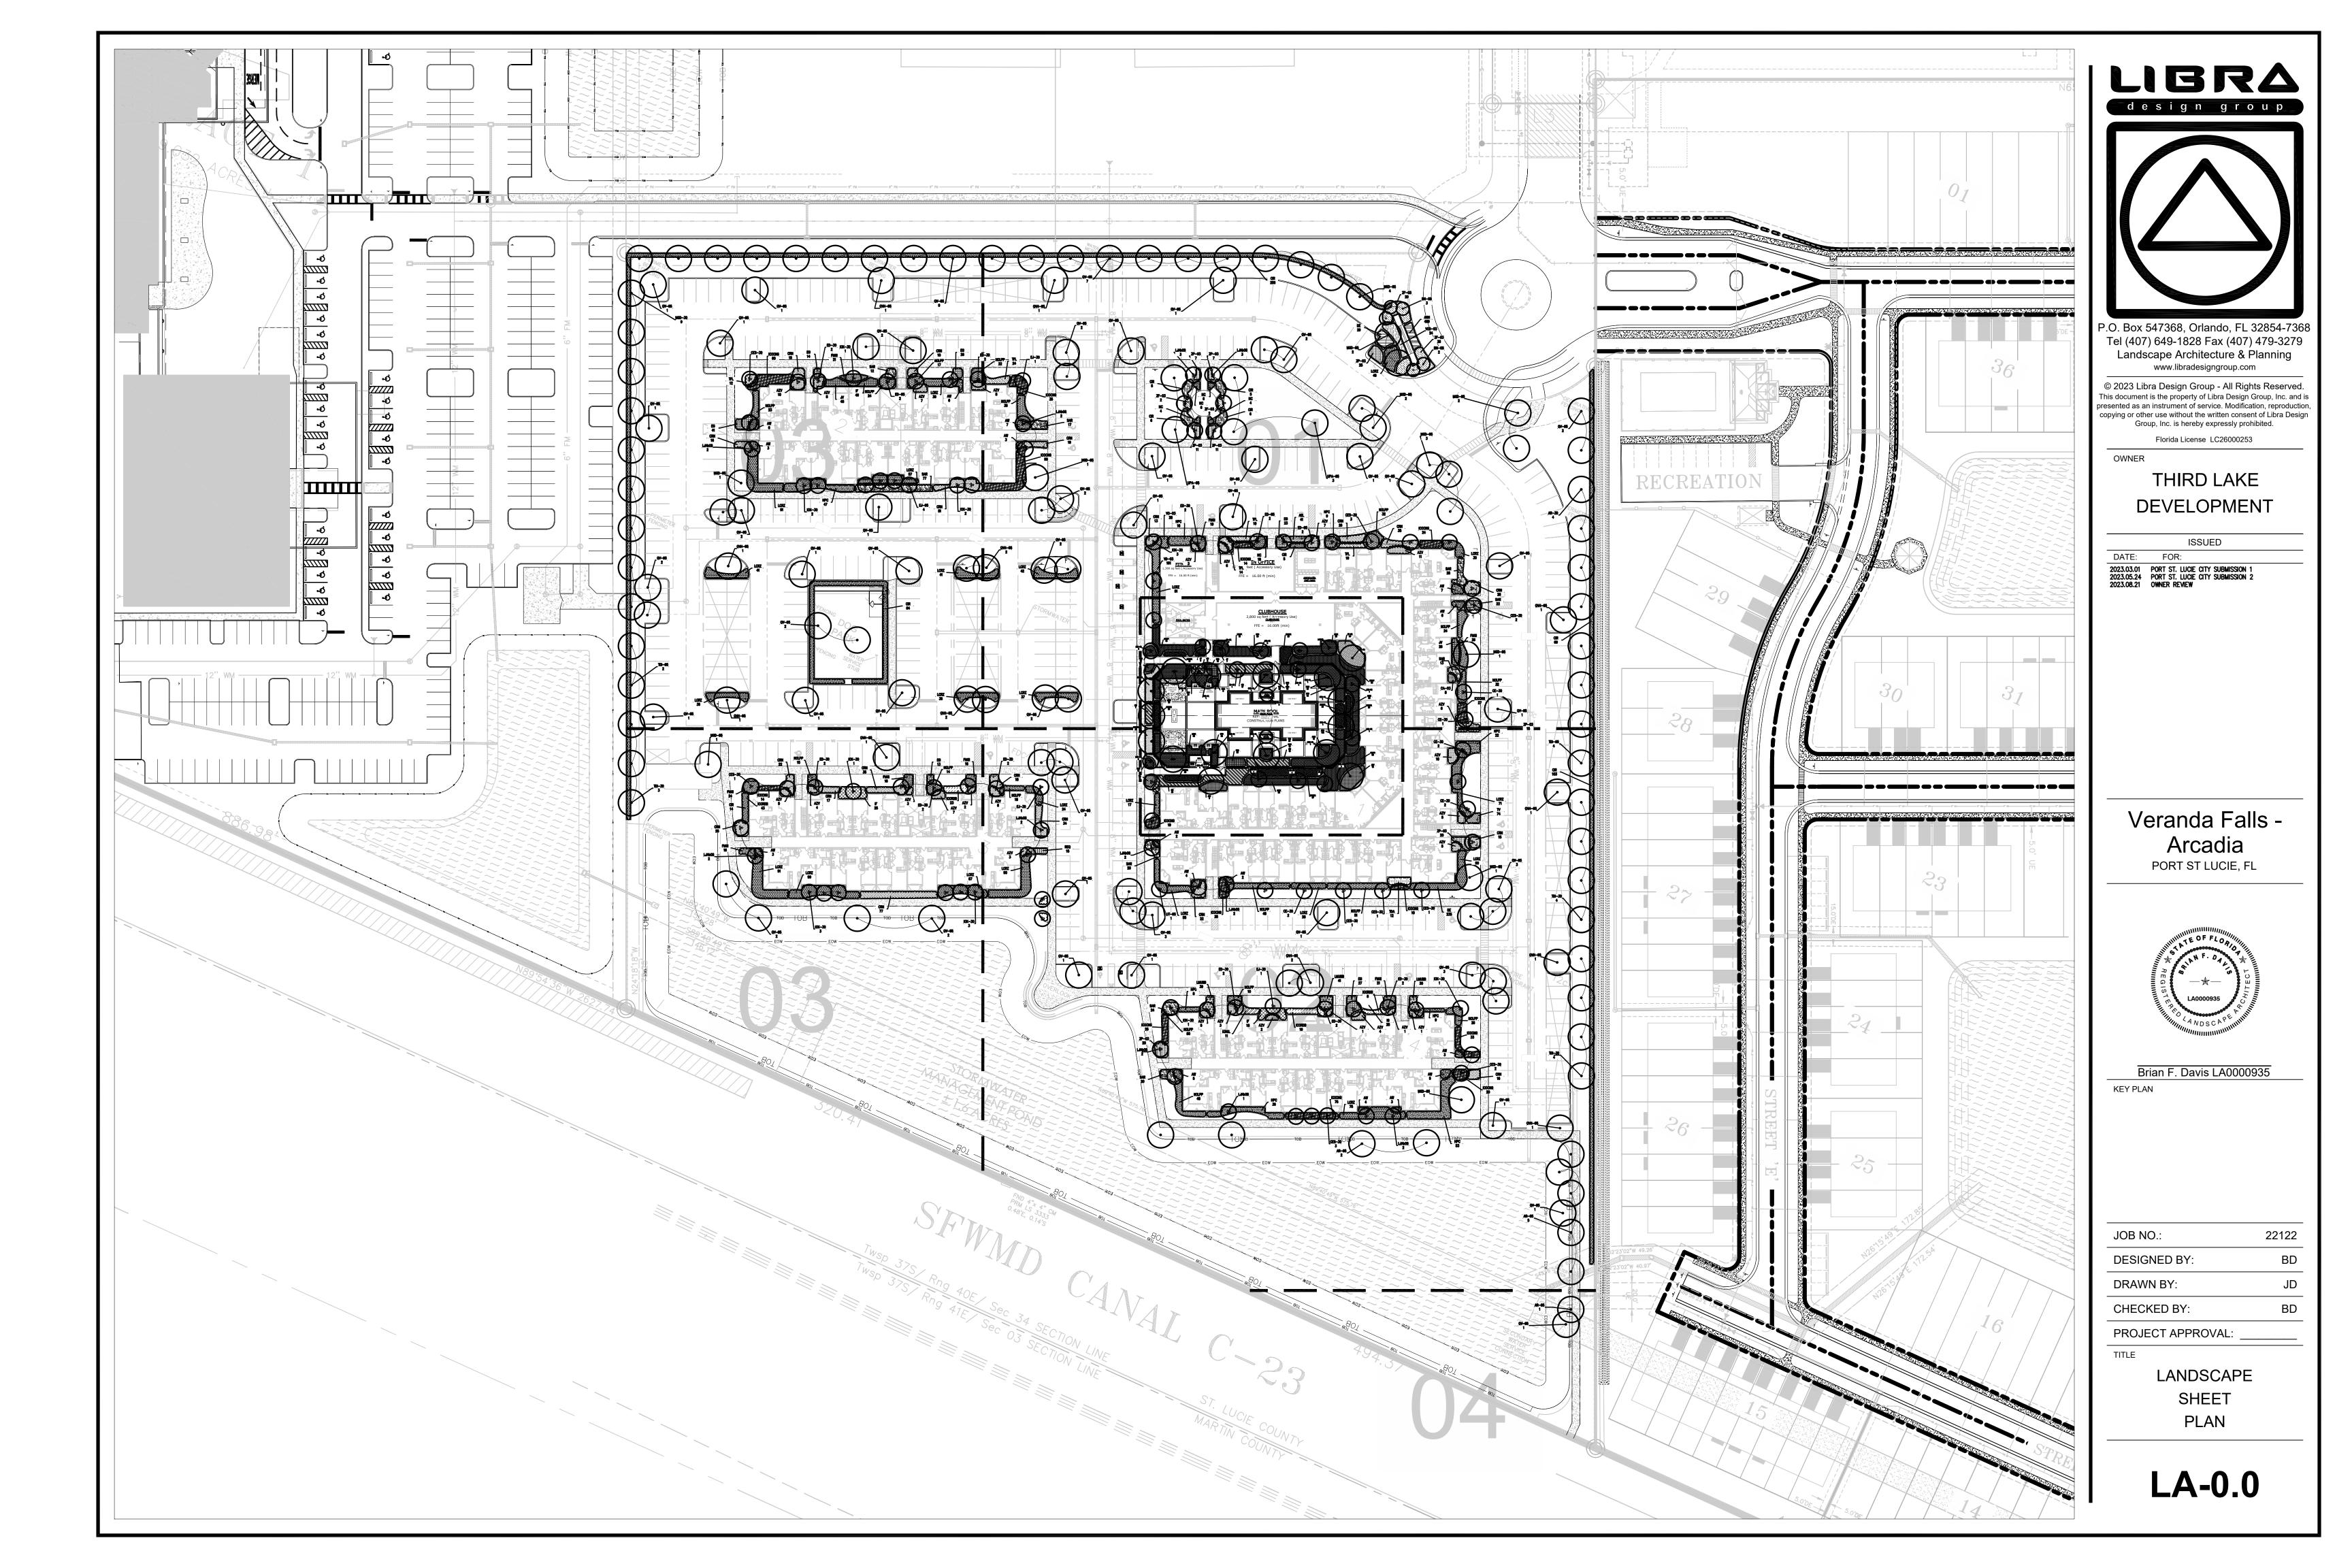


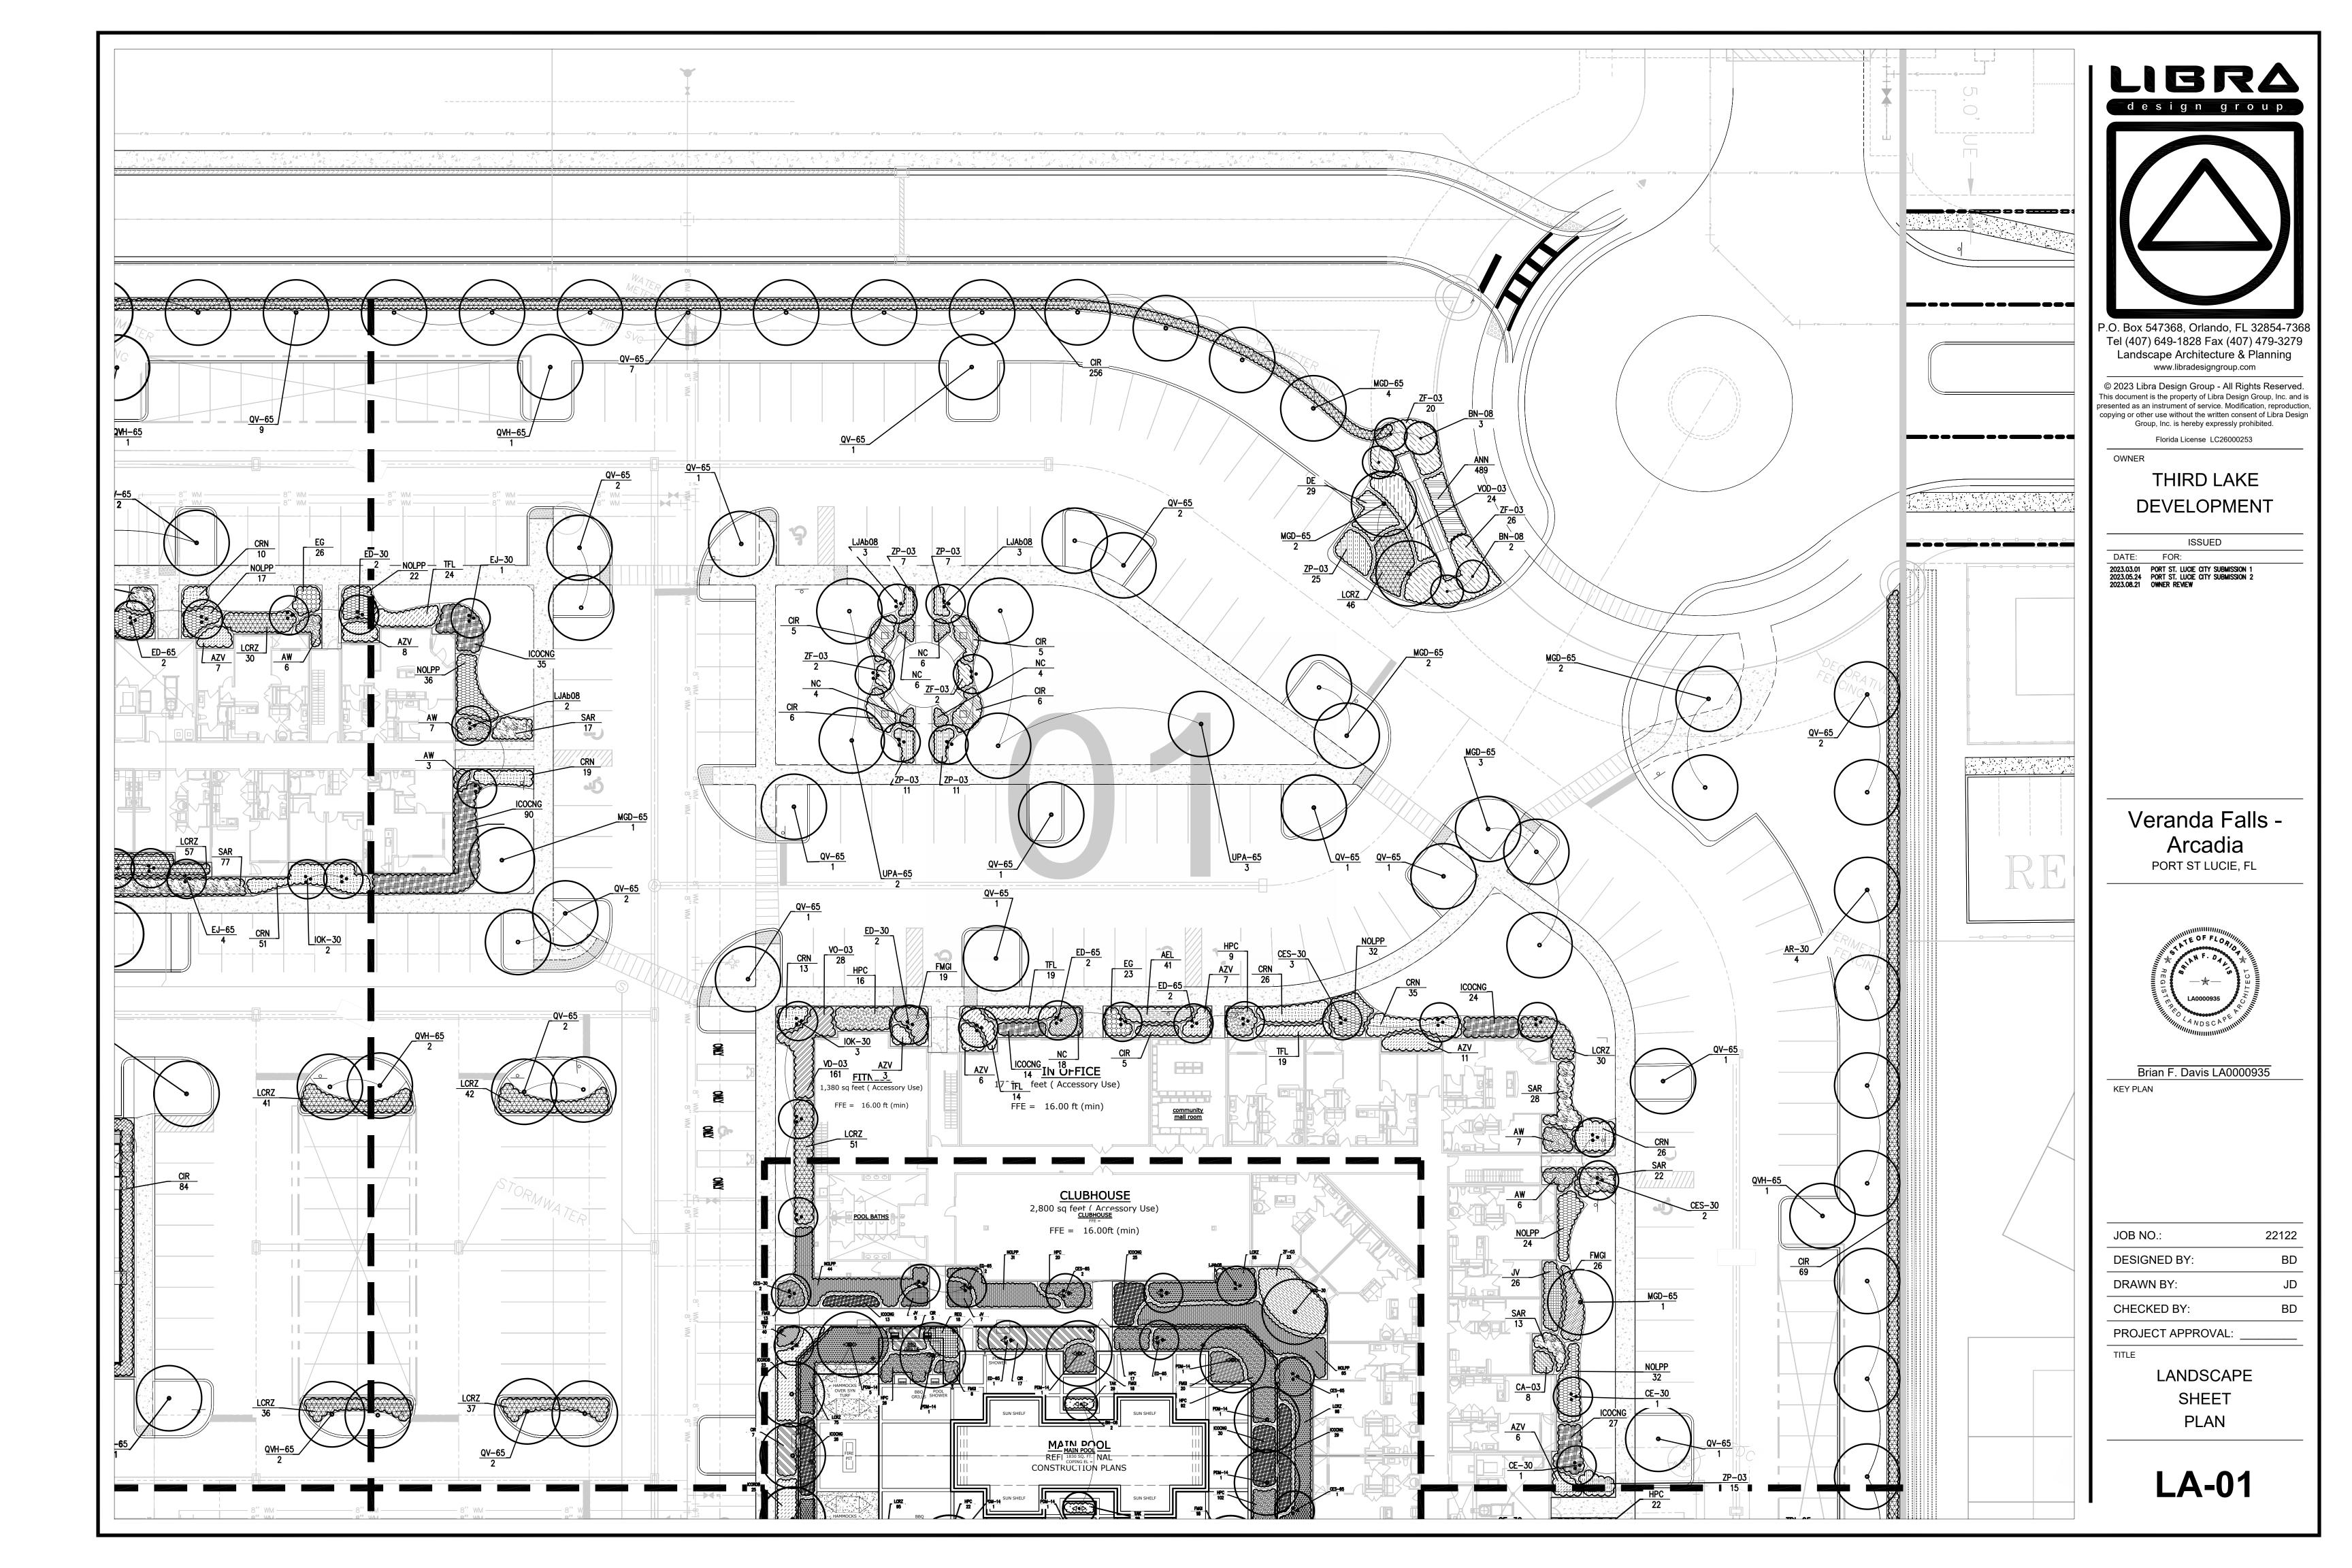

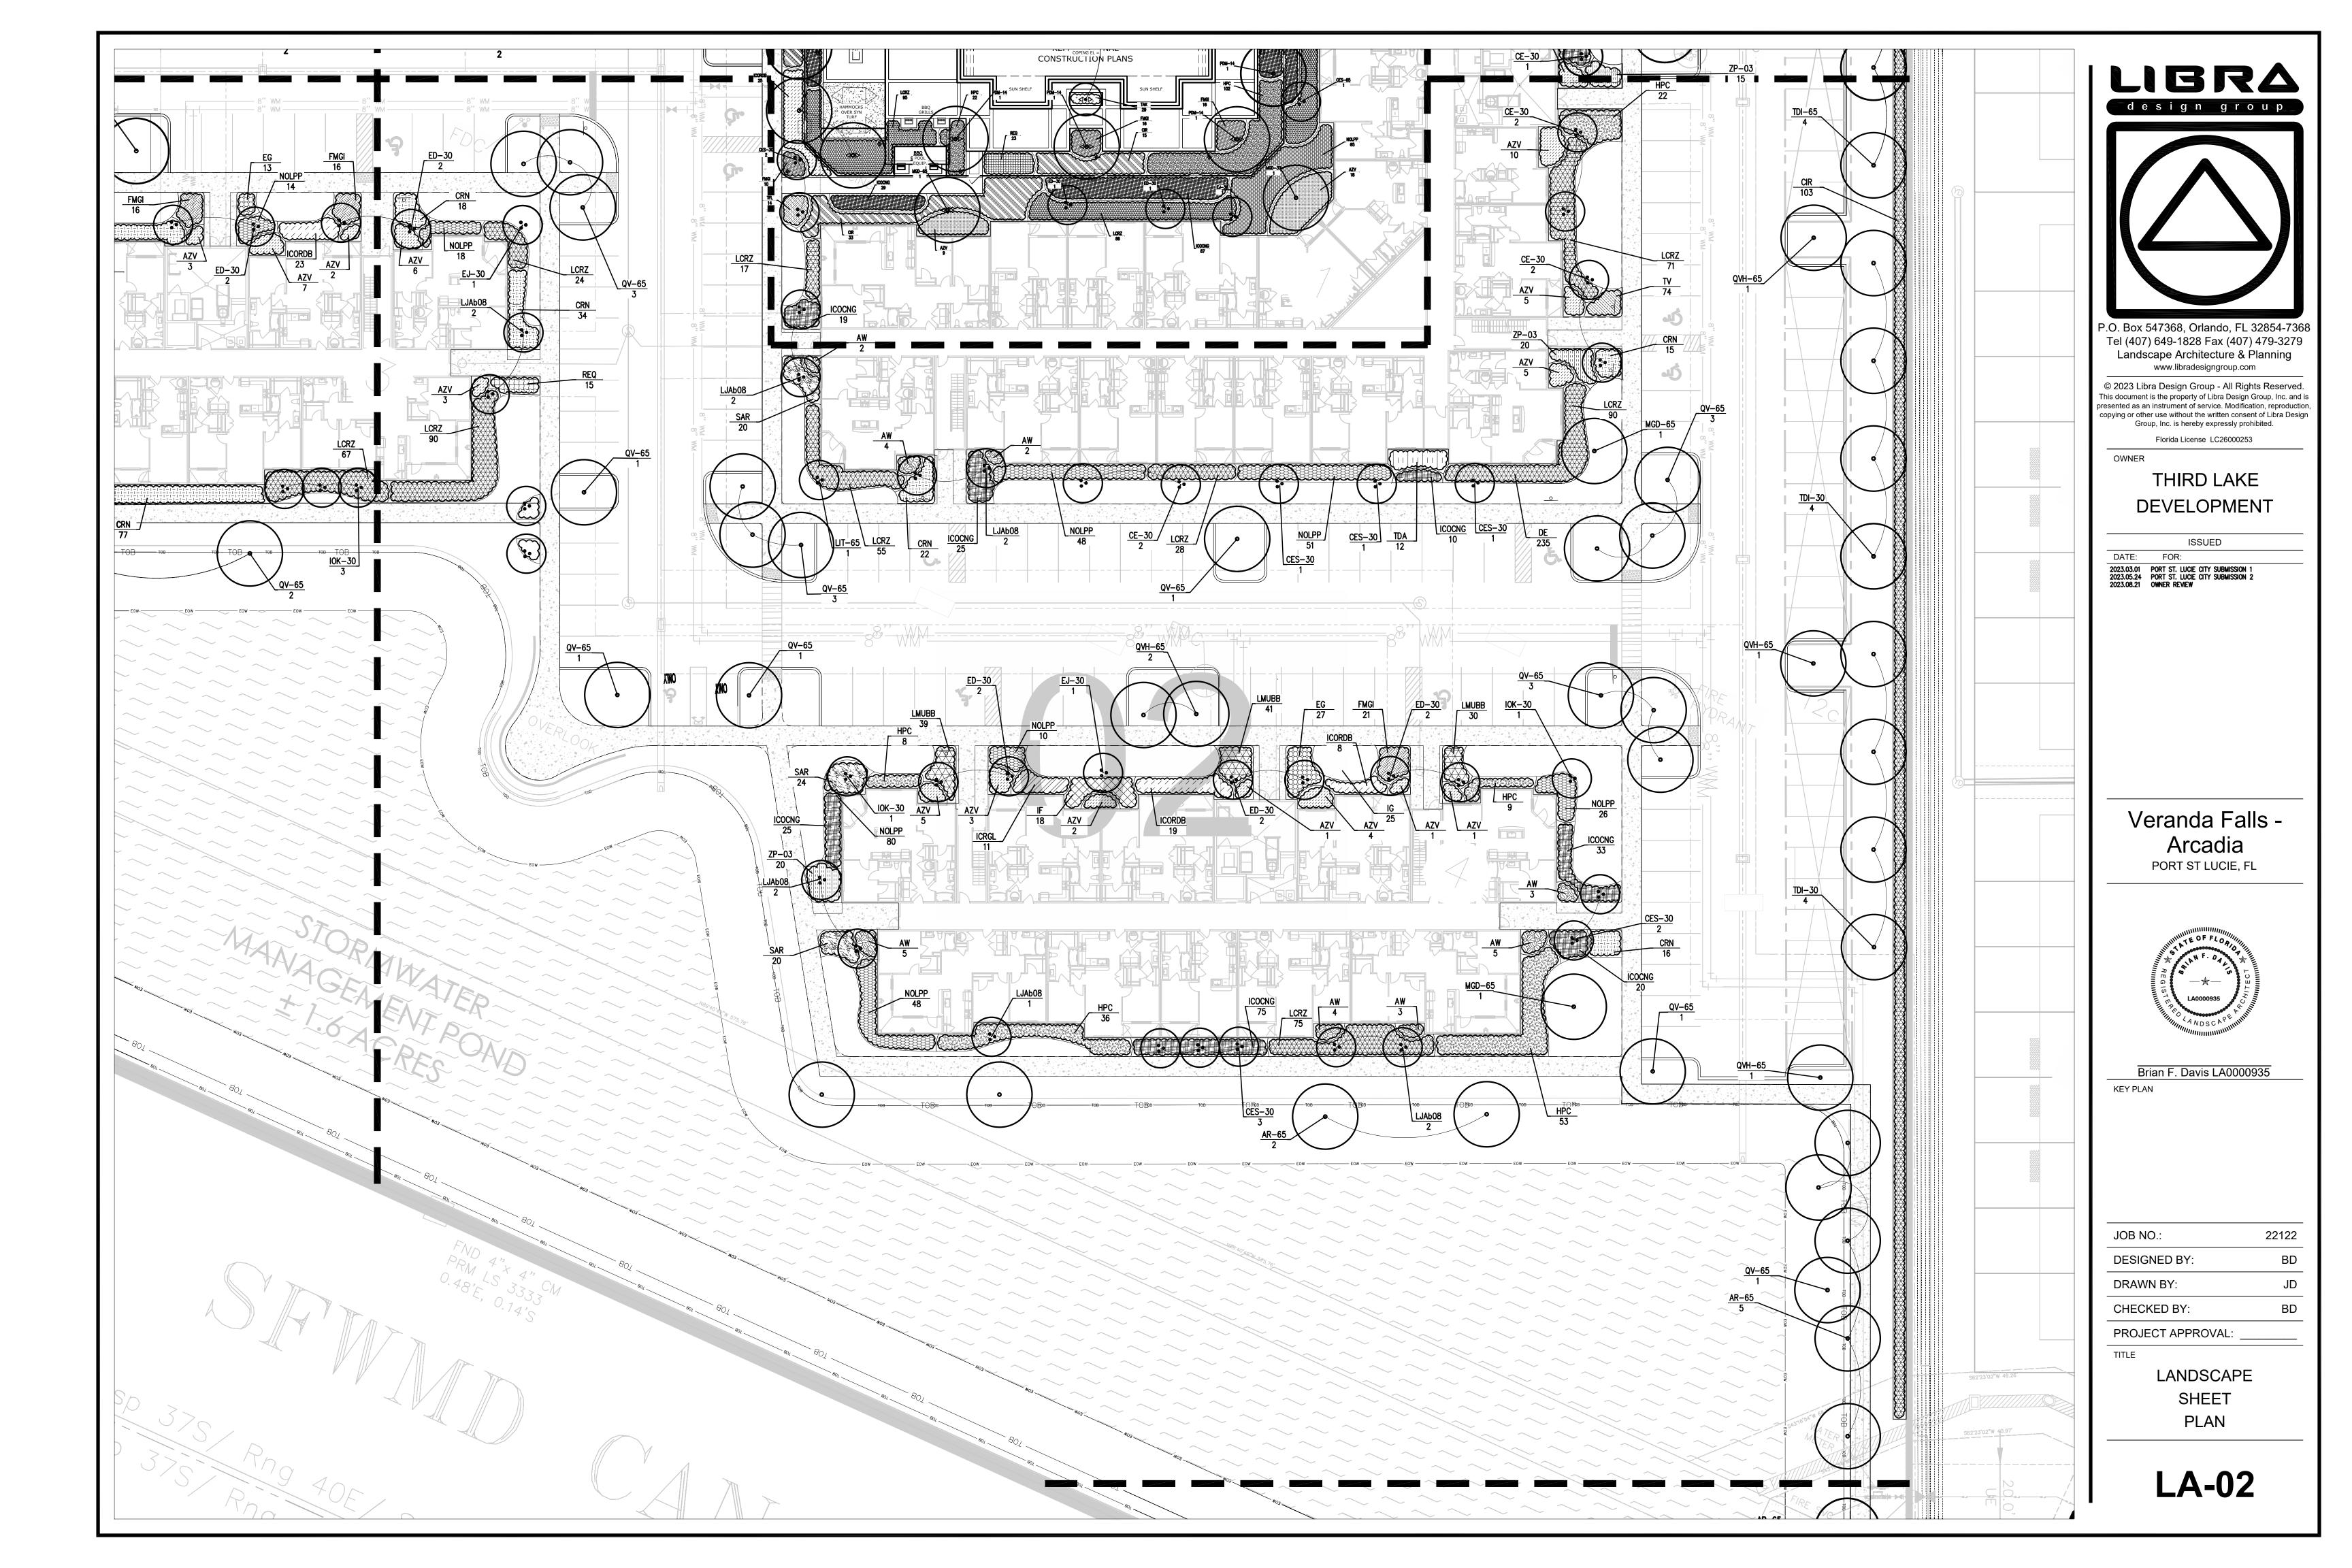

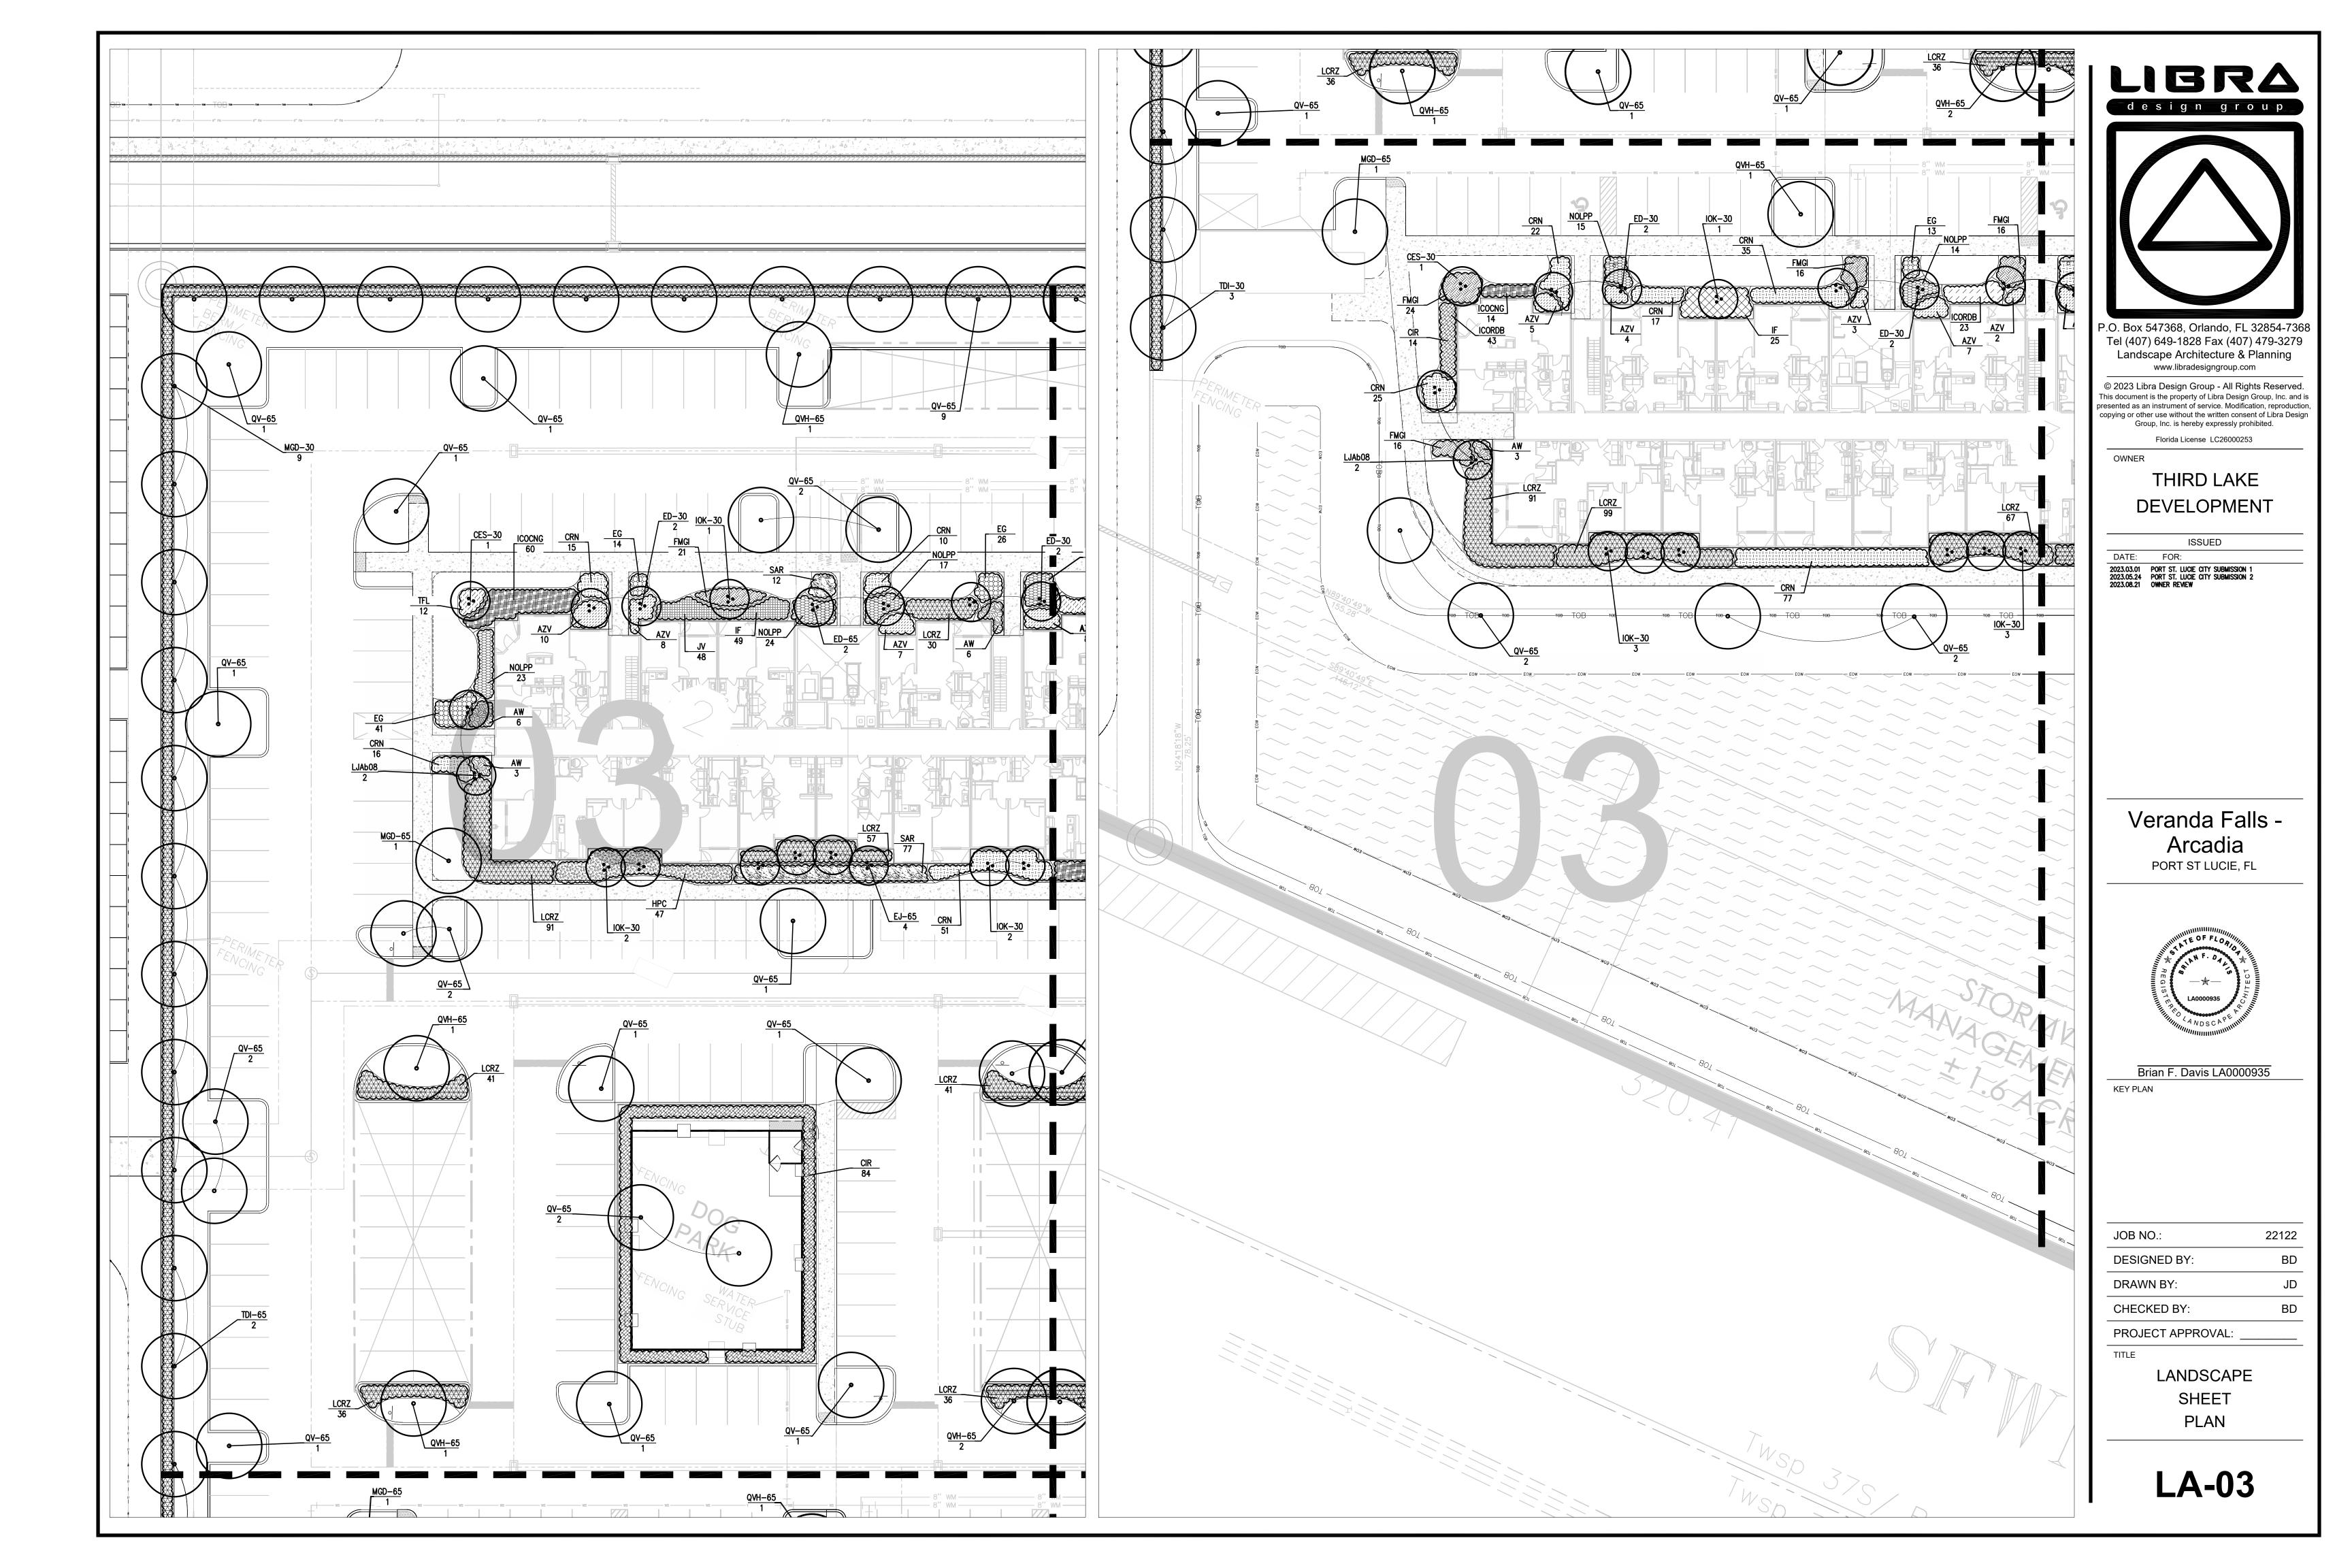

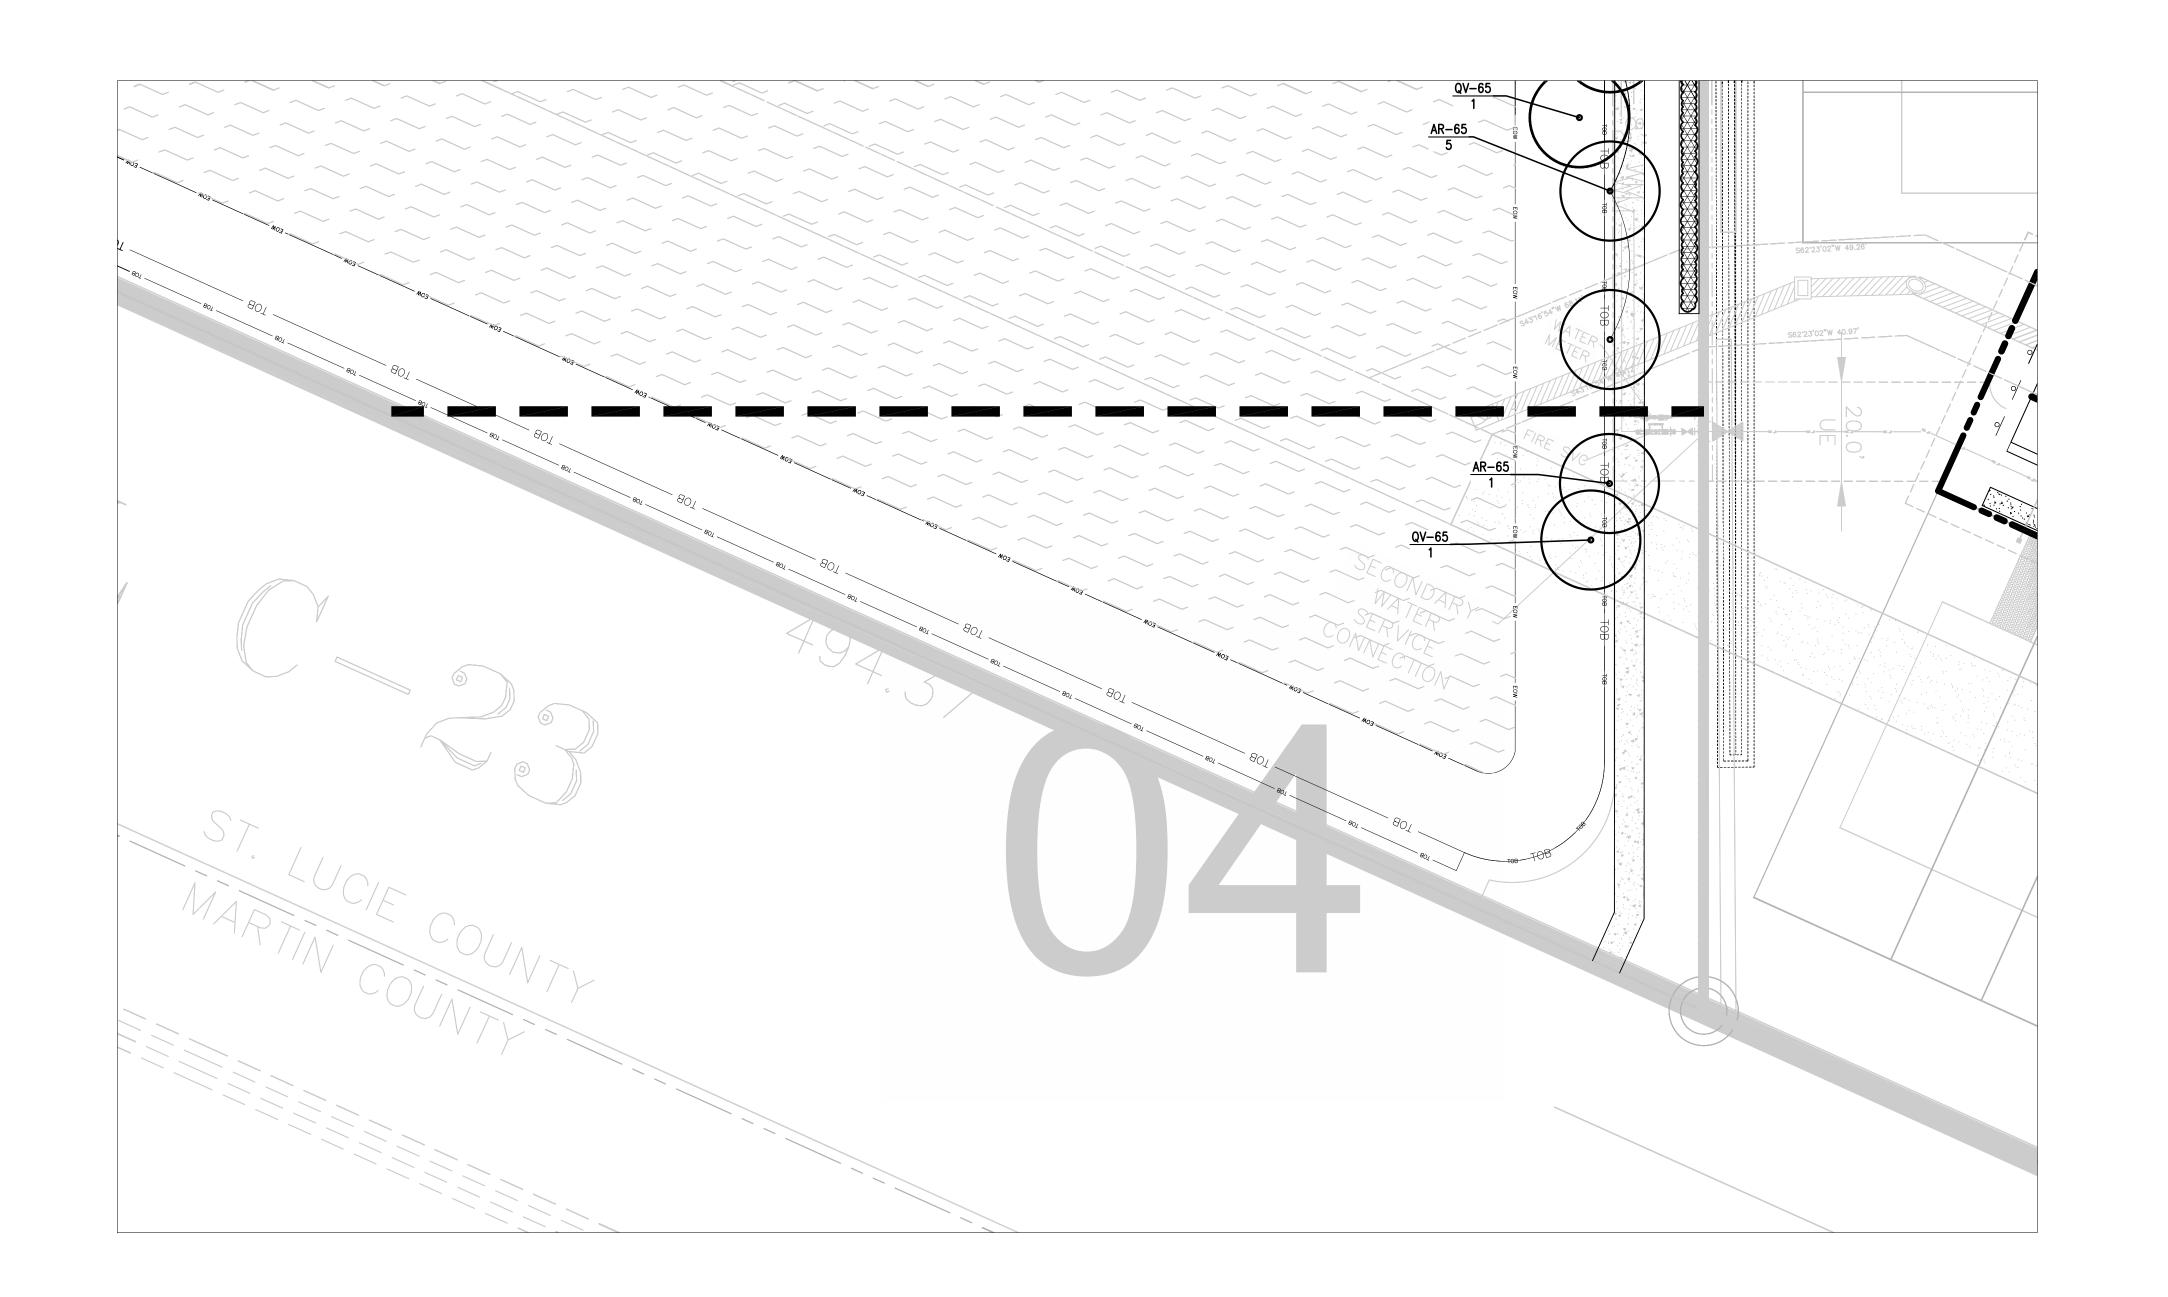

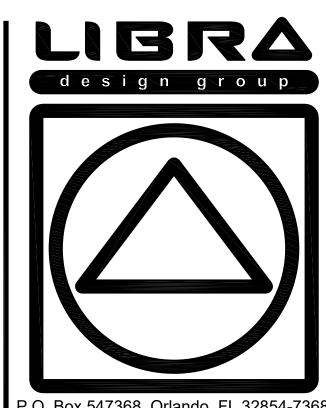

© 2023 Libra Design Group - All Rights Reserved.

This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction, copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited.

Florida License LC26000253

OWNER

THIRD LAKE DEVELOPMENT

DATE: FOR:

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1 2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2 2023.08.21 OWNER REVIEW

Veranda Falls -Arcadia PORT ST LUCIE, FL



Brian F. Davis LA0000935

KEY PLA


	JOB NO.:	22122
	DESIGNED BY:	BD
-	DRAWN BY:	JD
	CHECKED BY:	BD


PROJECT APPROVAL:


TITLI


LANDSCAPE SHEET PLAN


LA-04

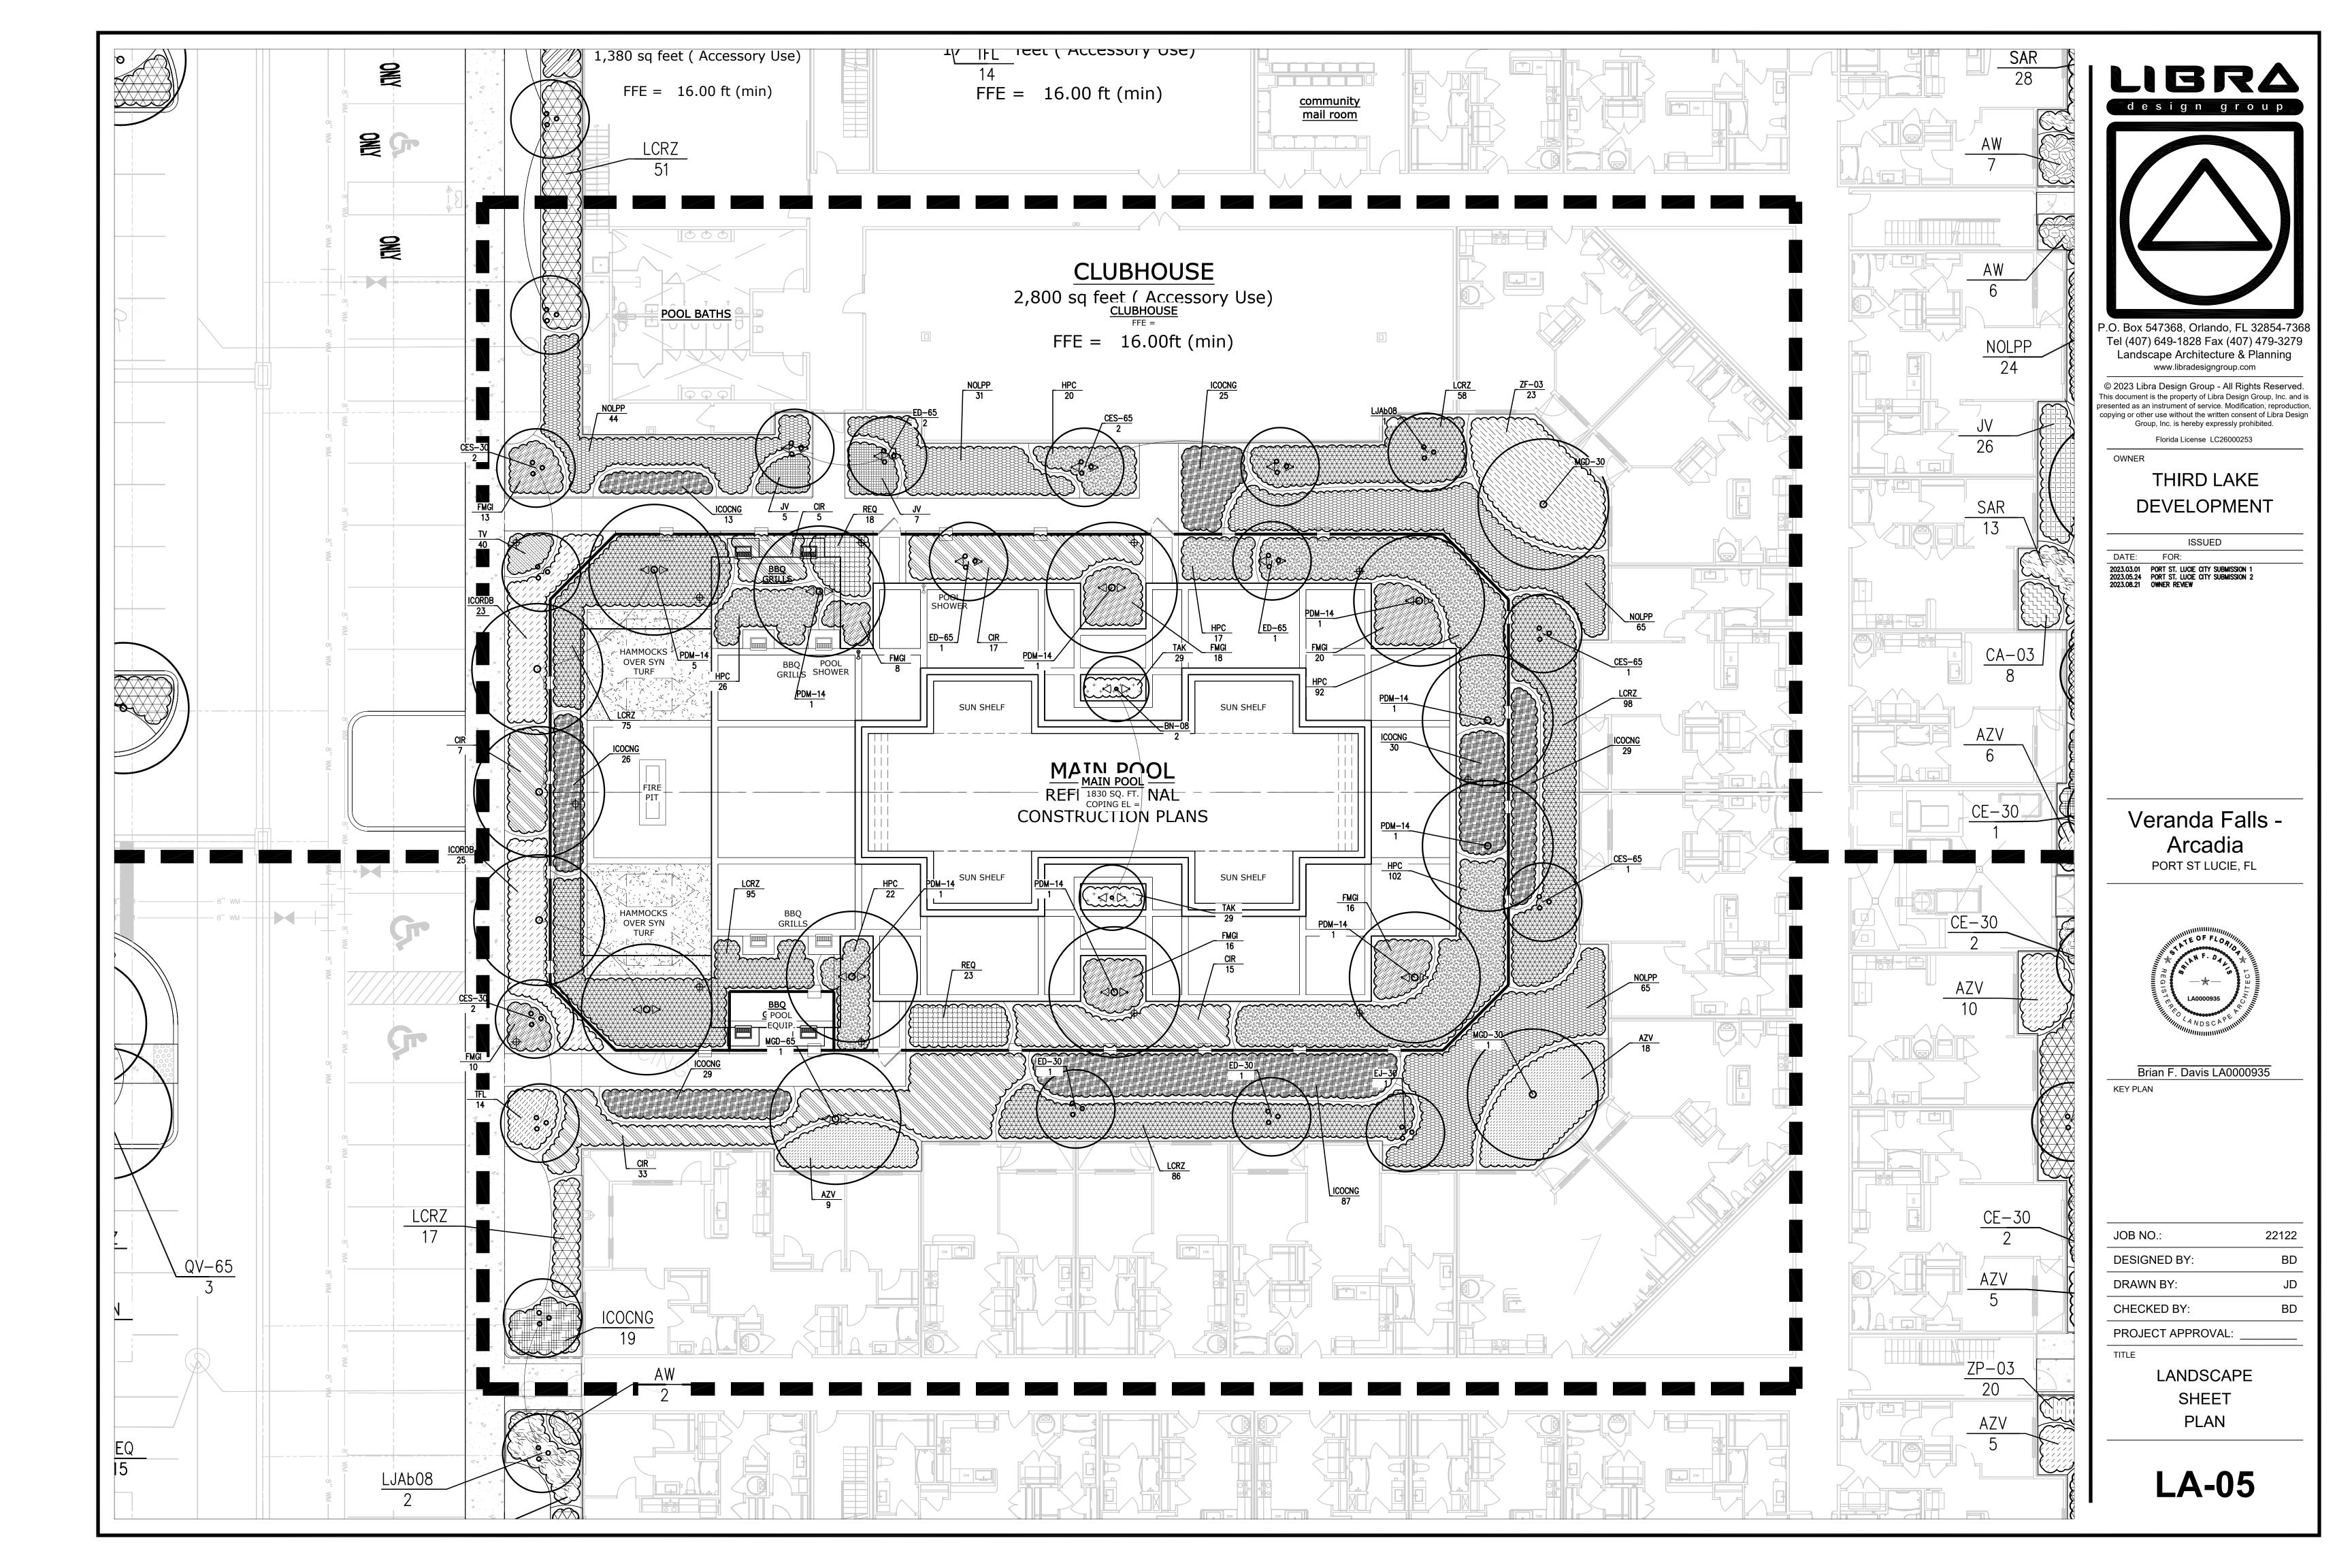


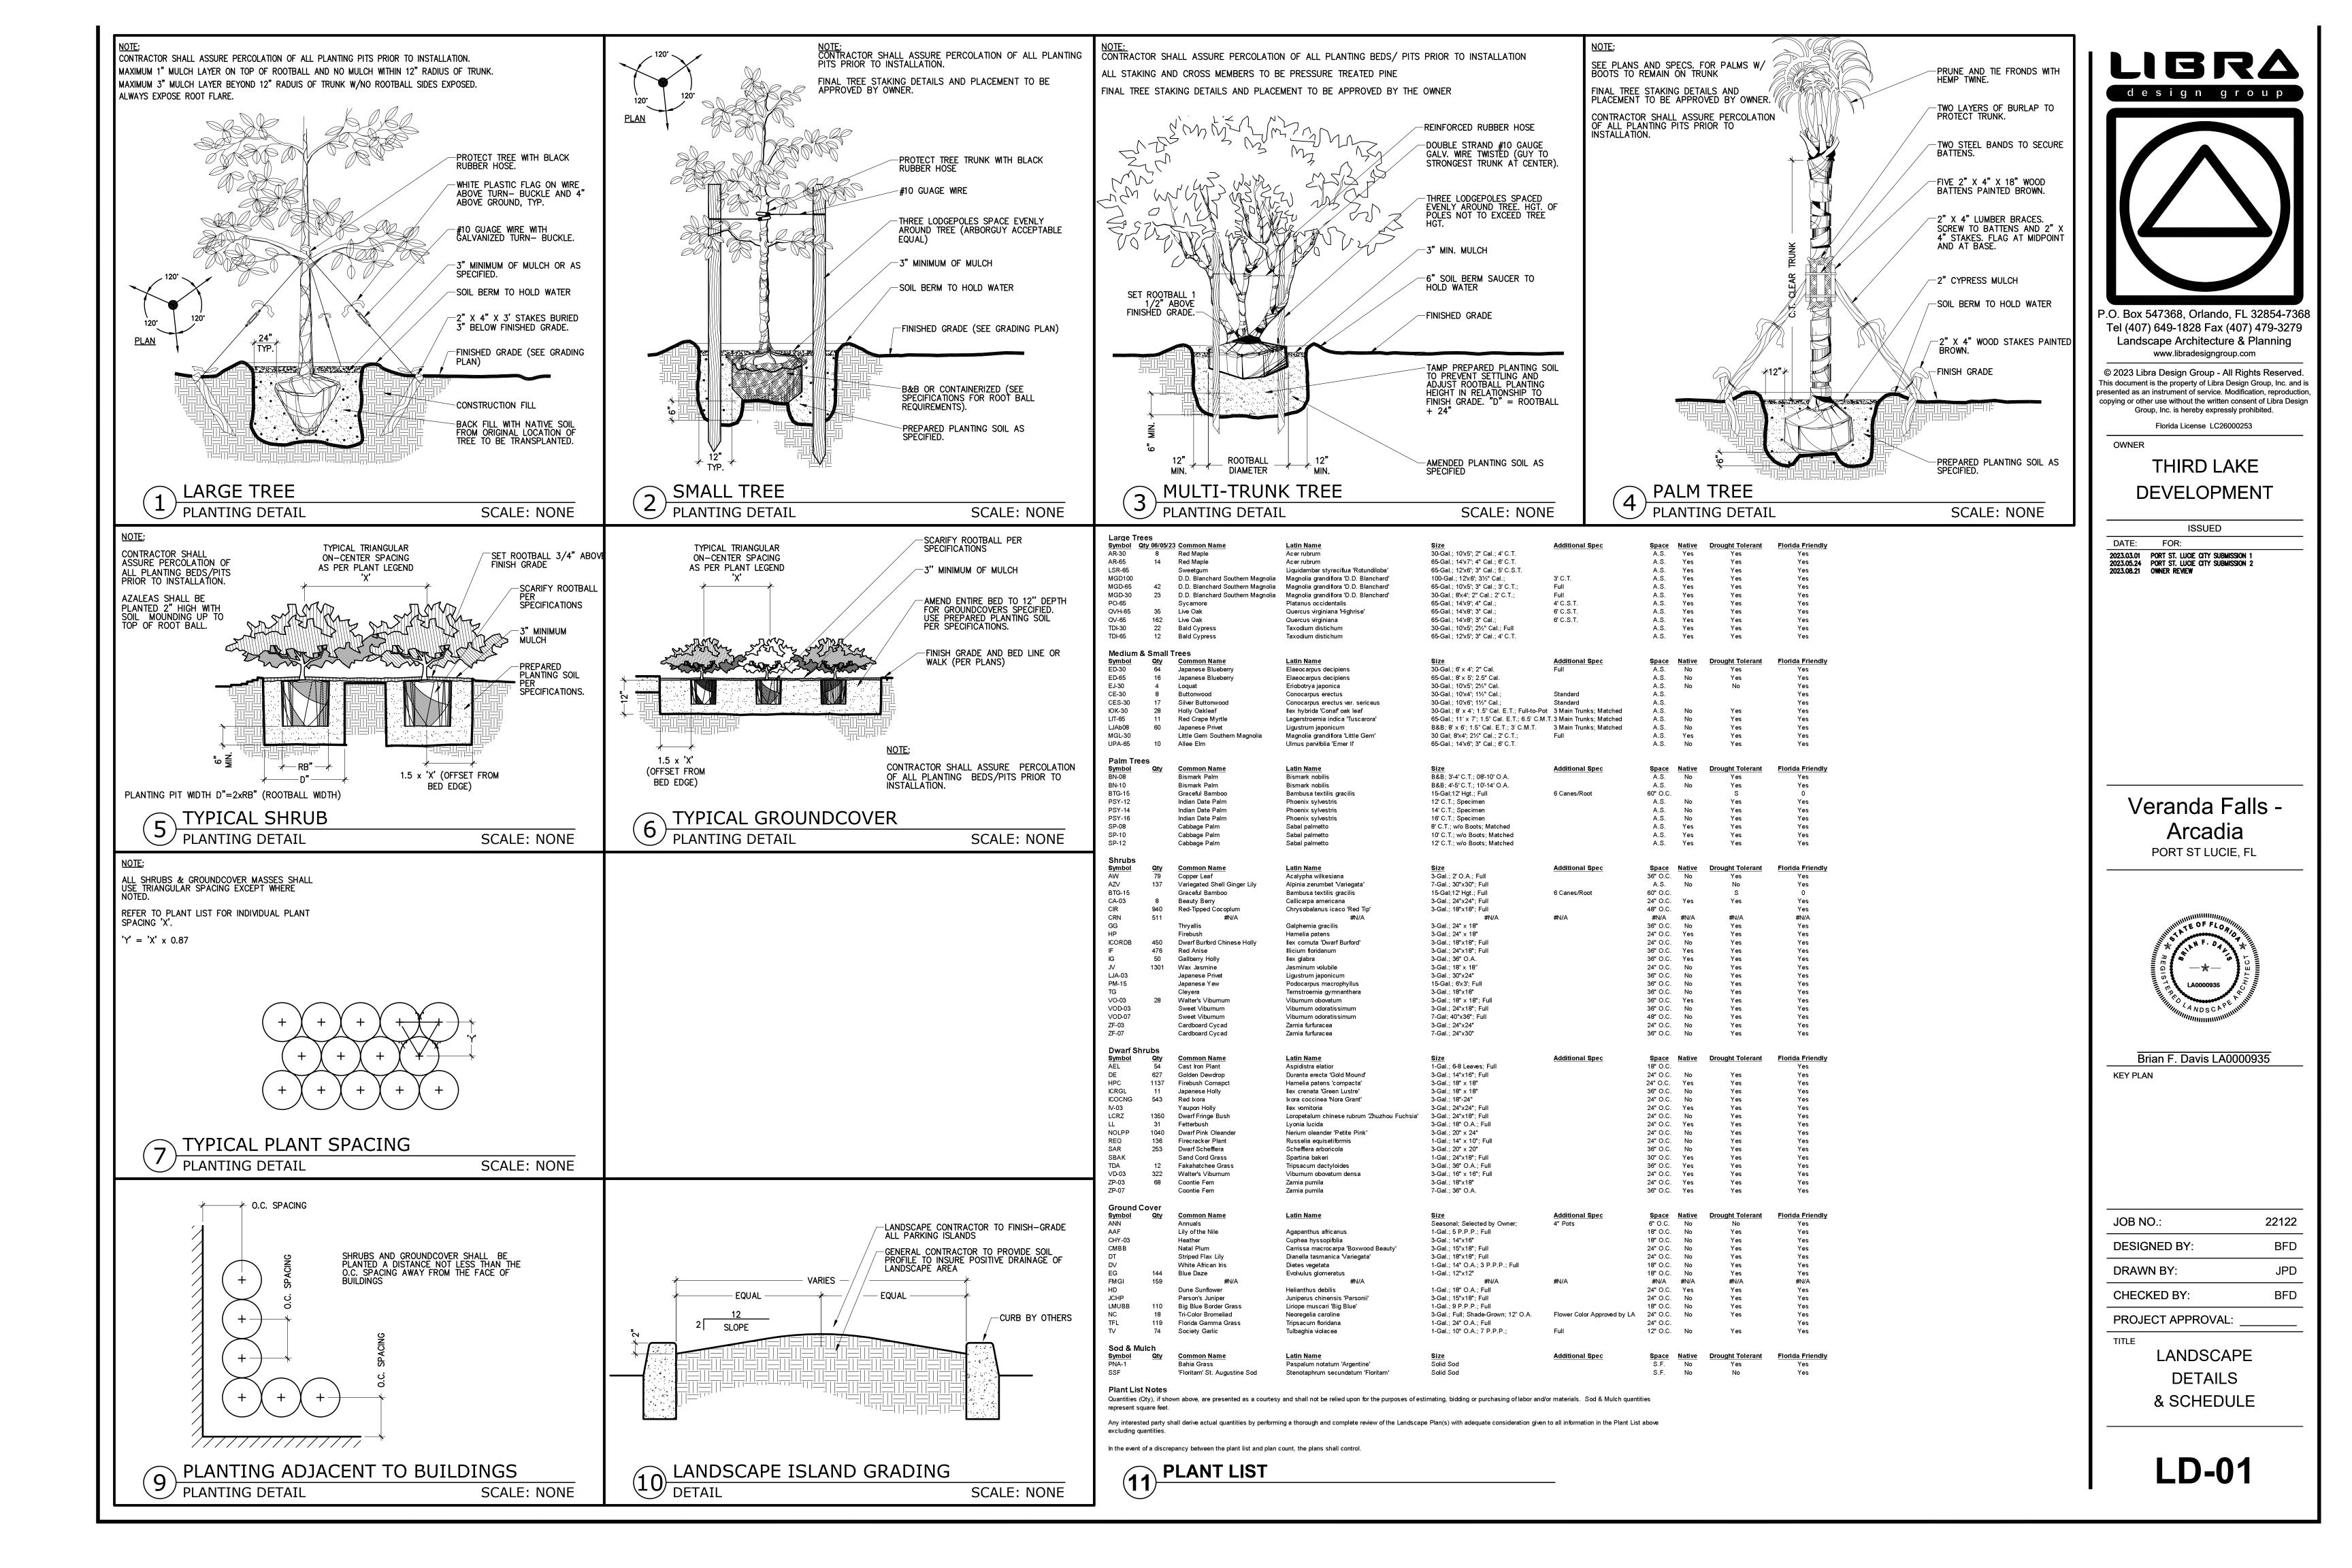

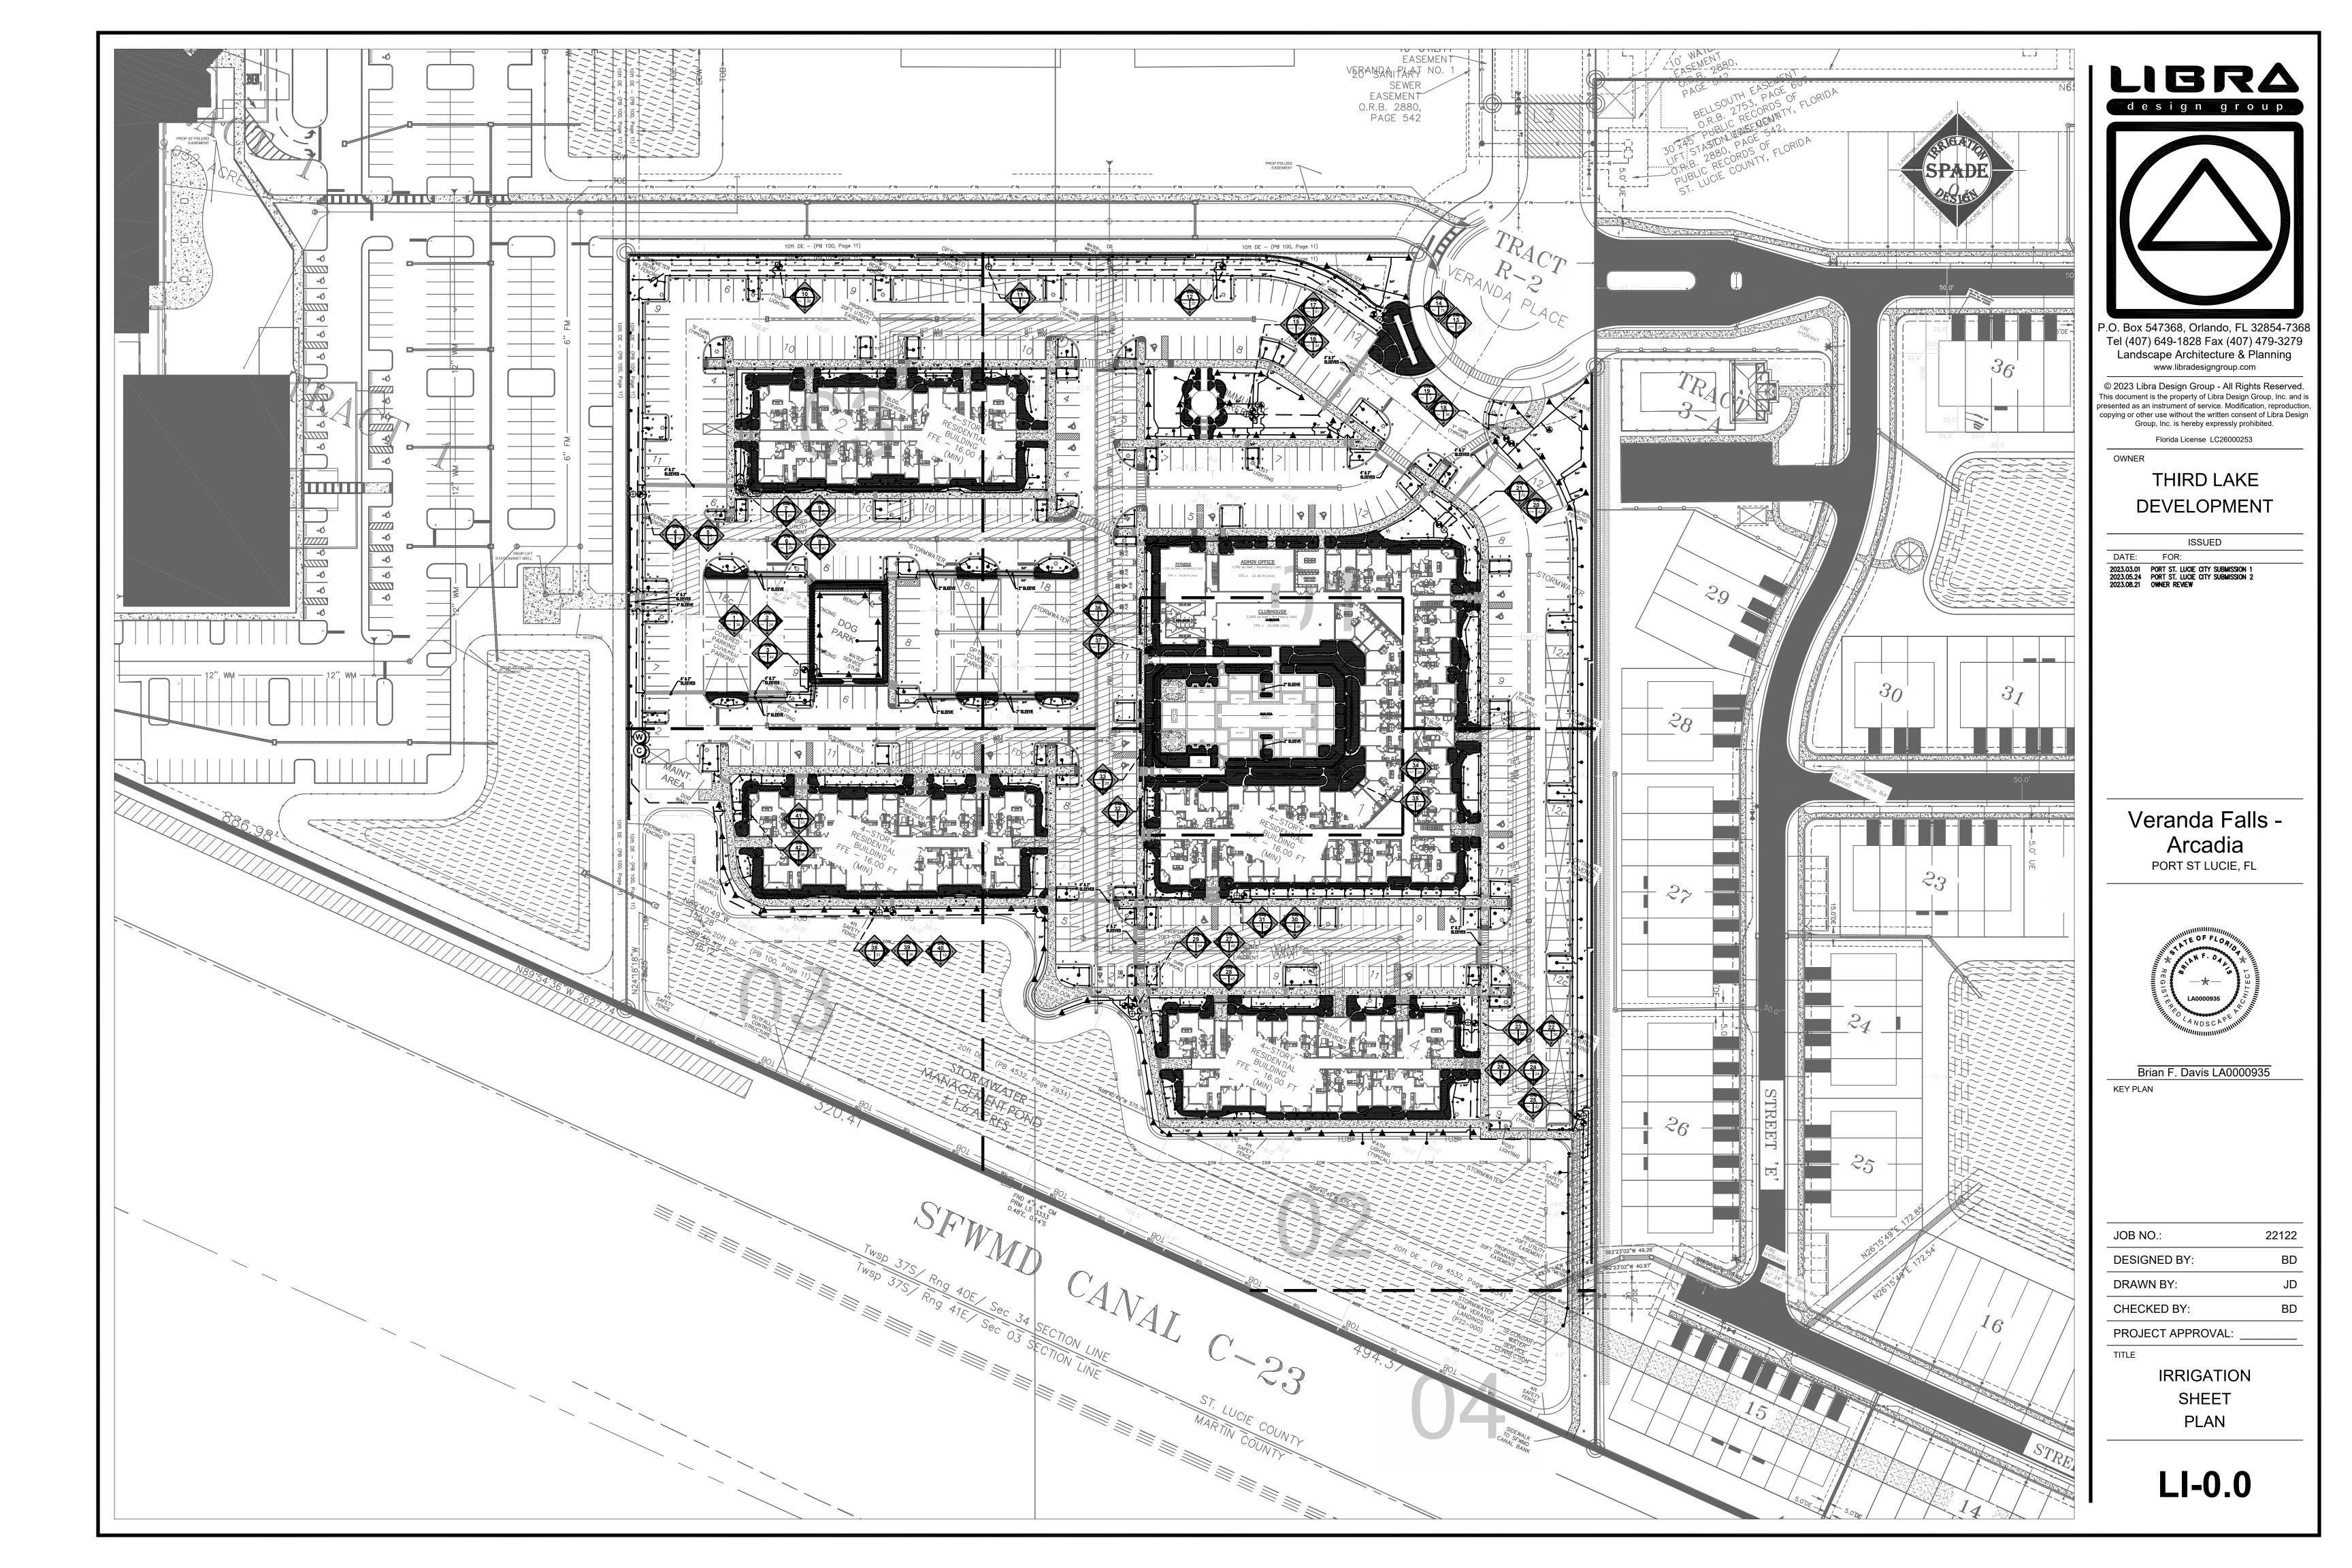

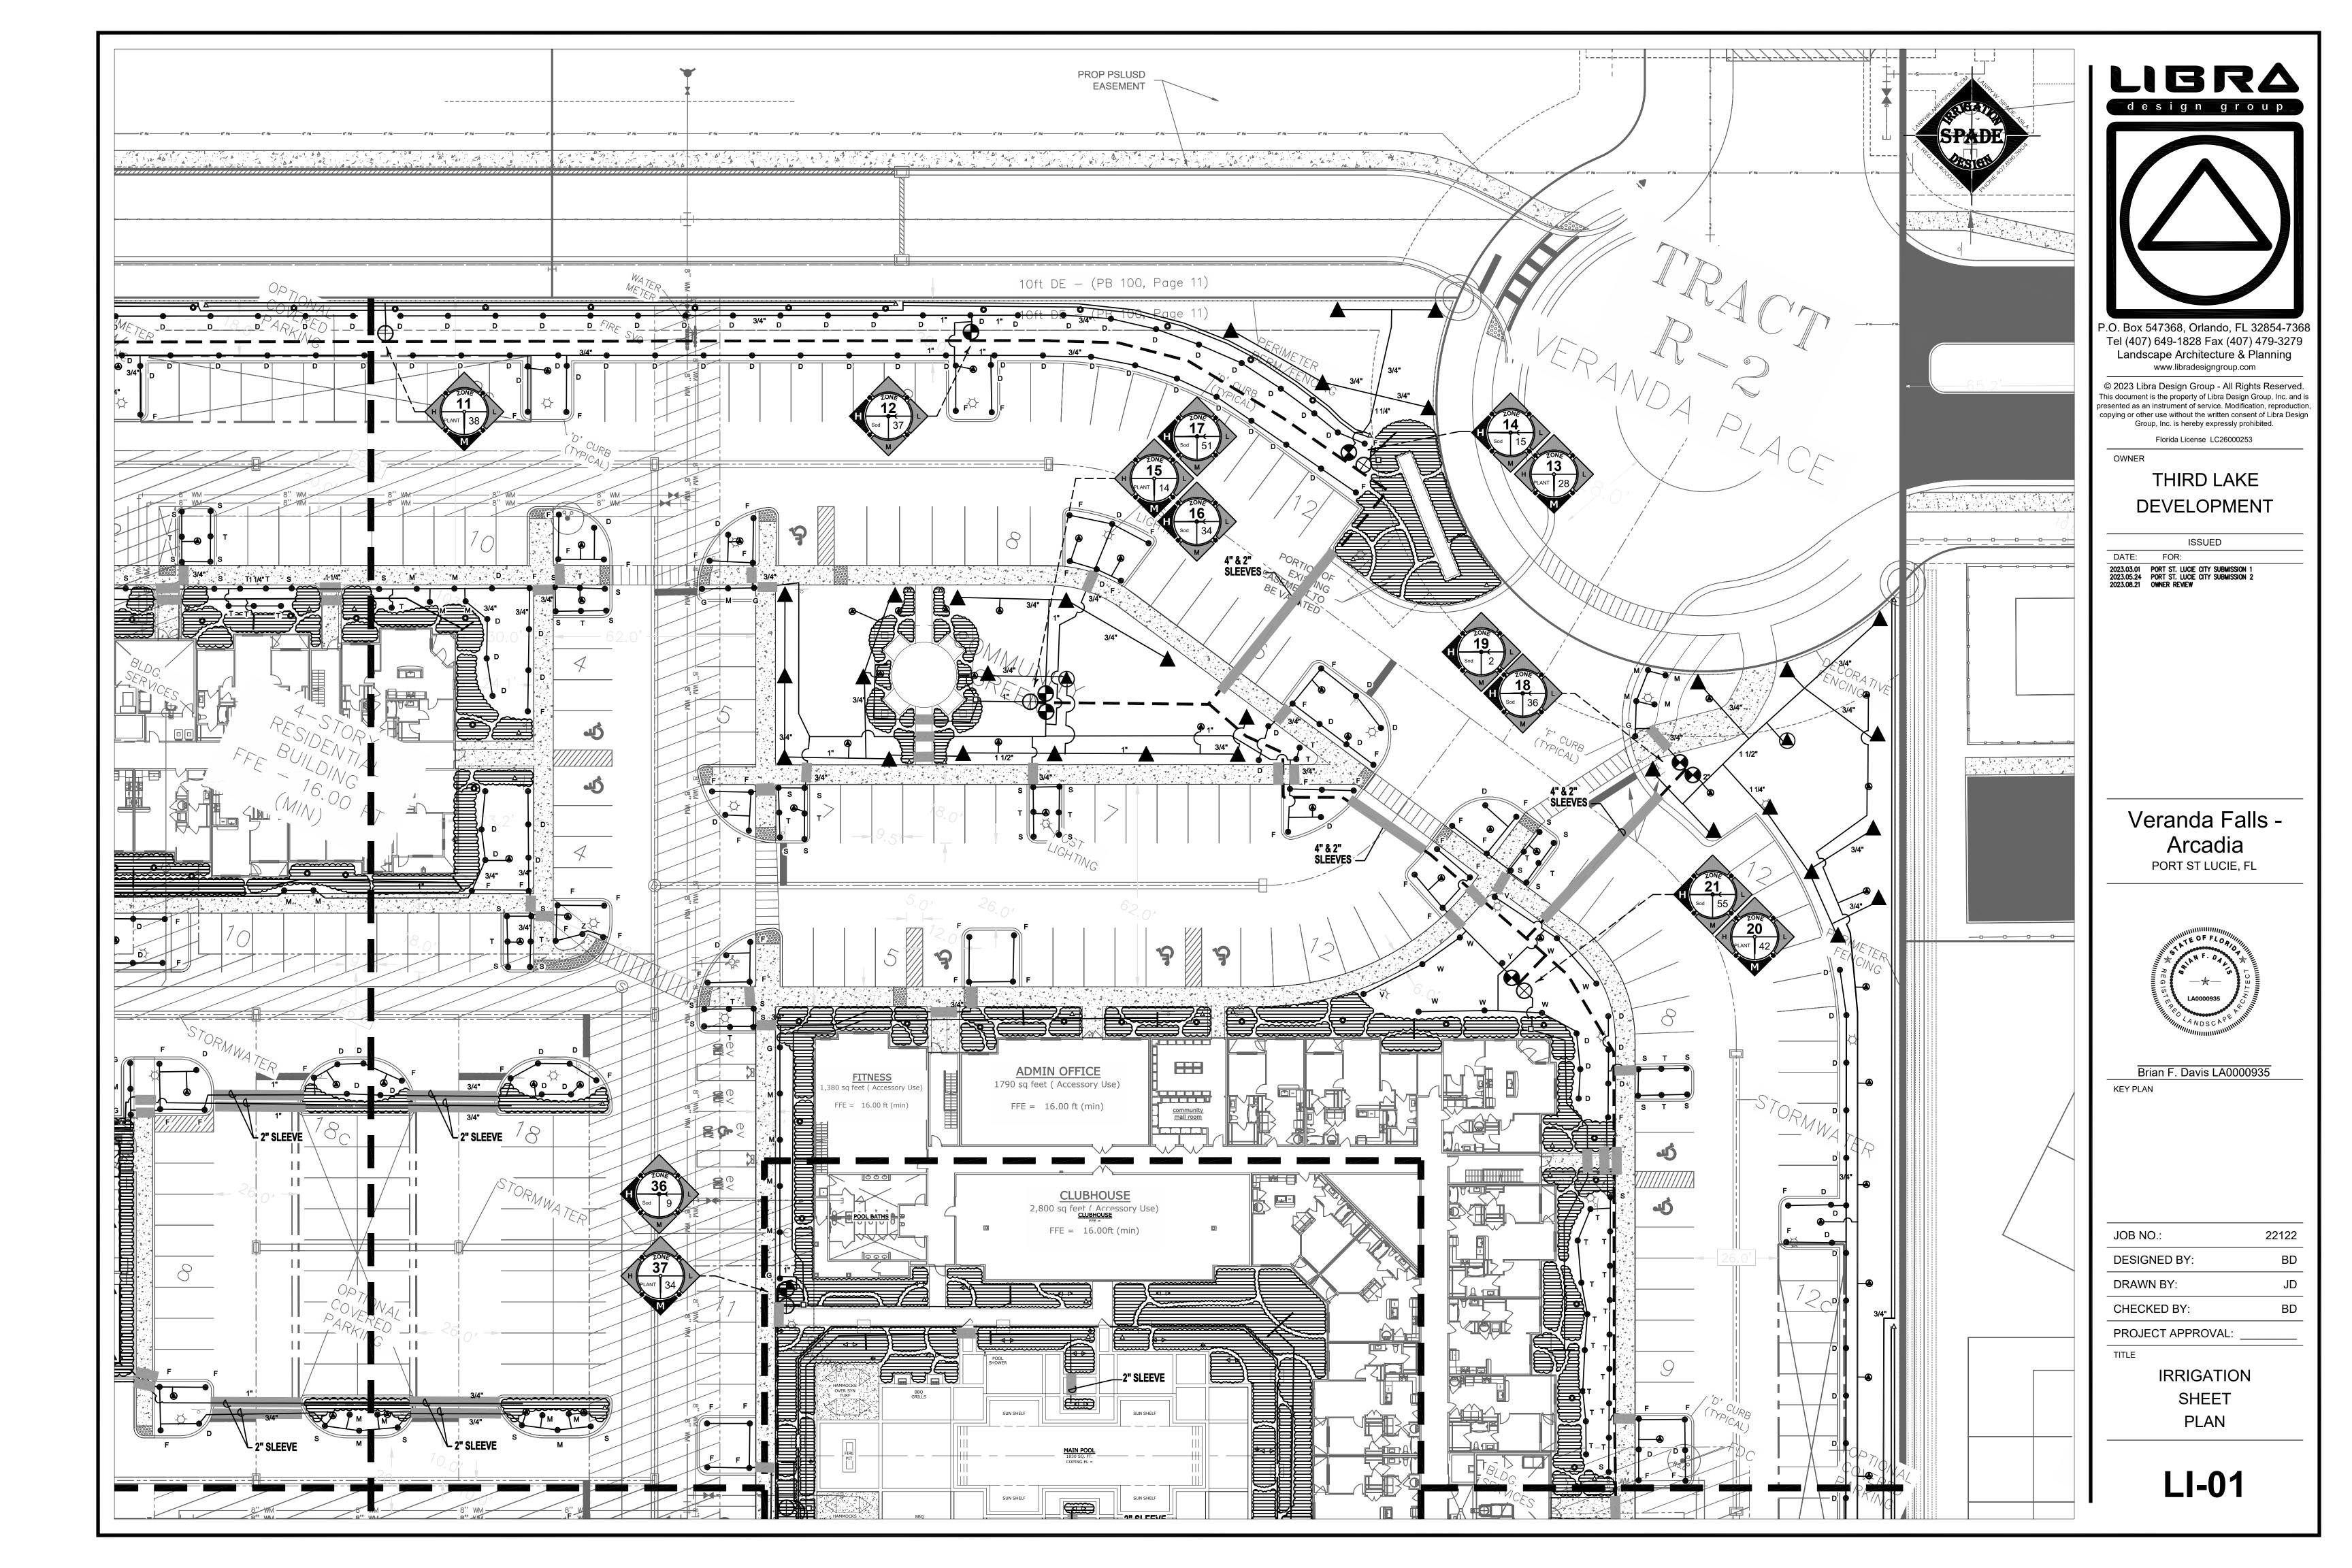

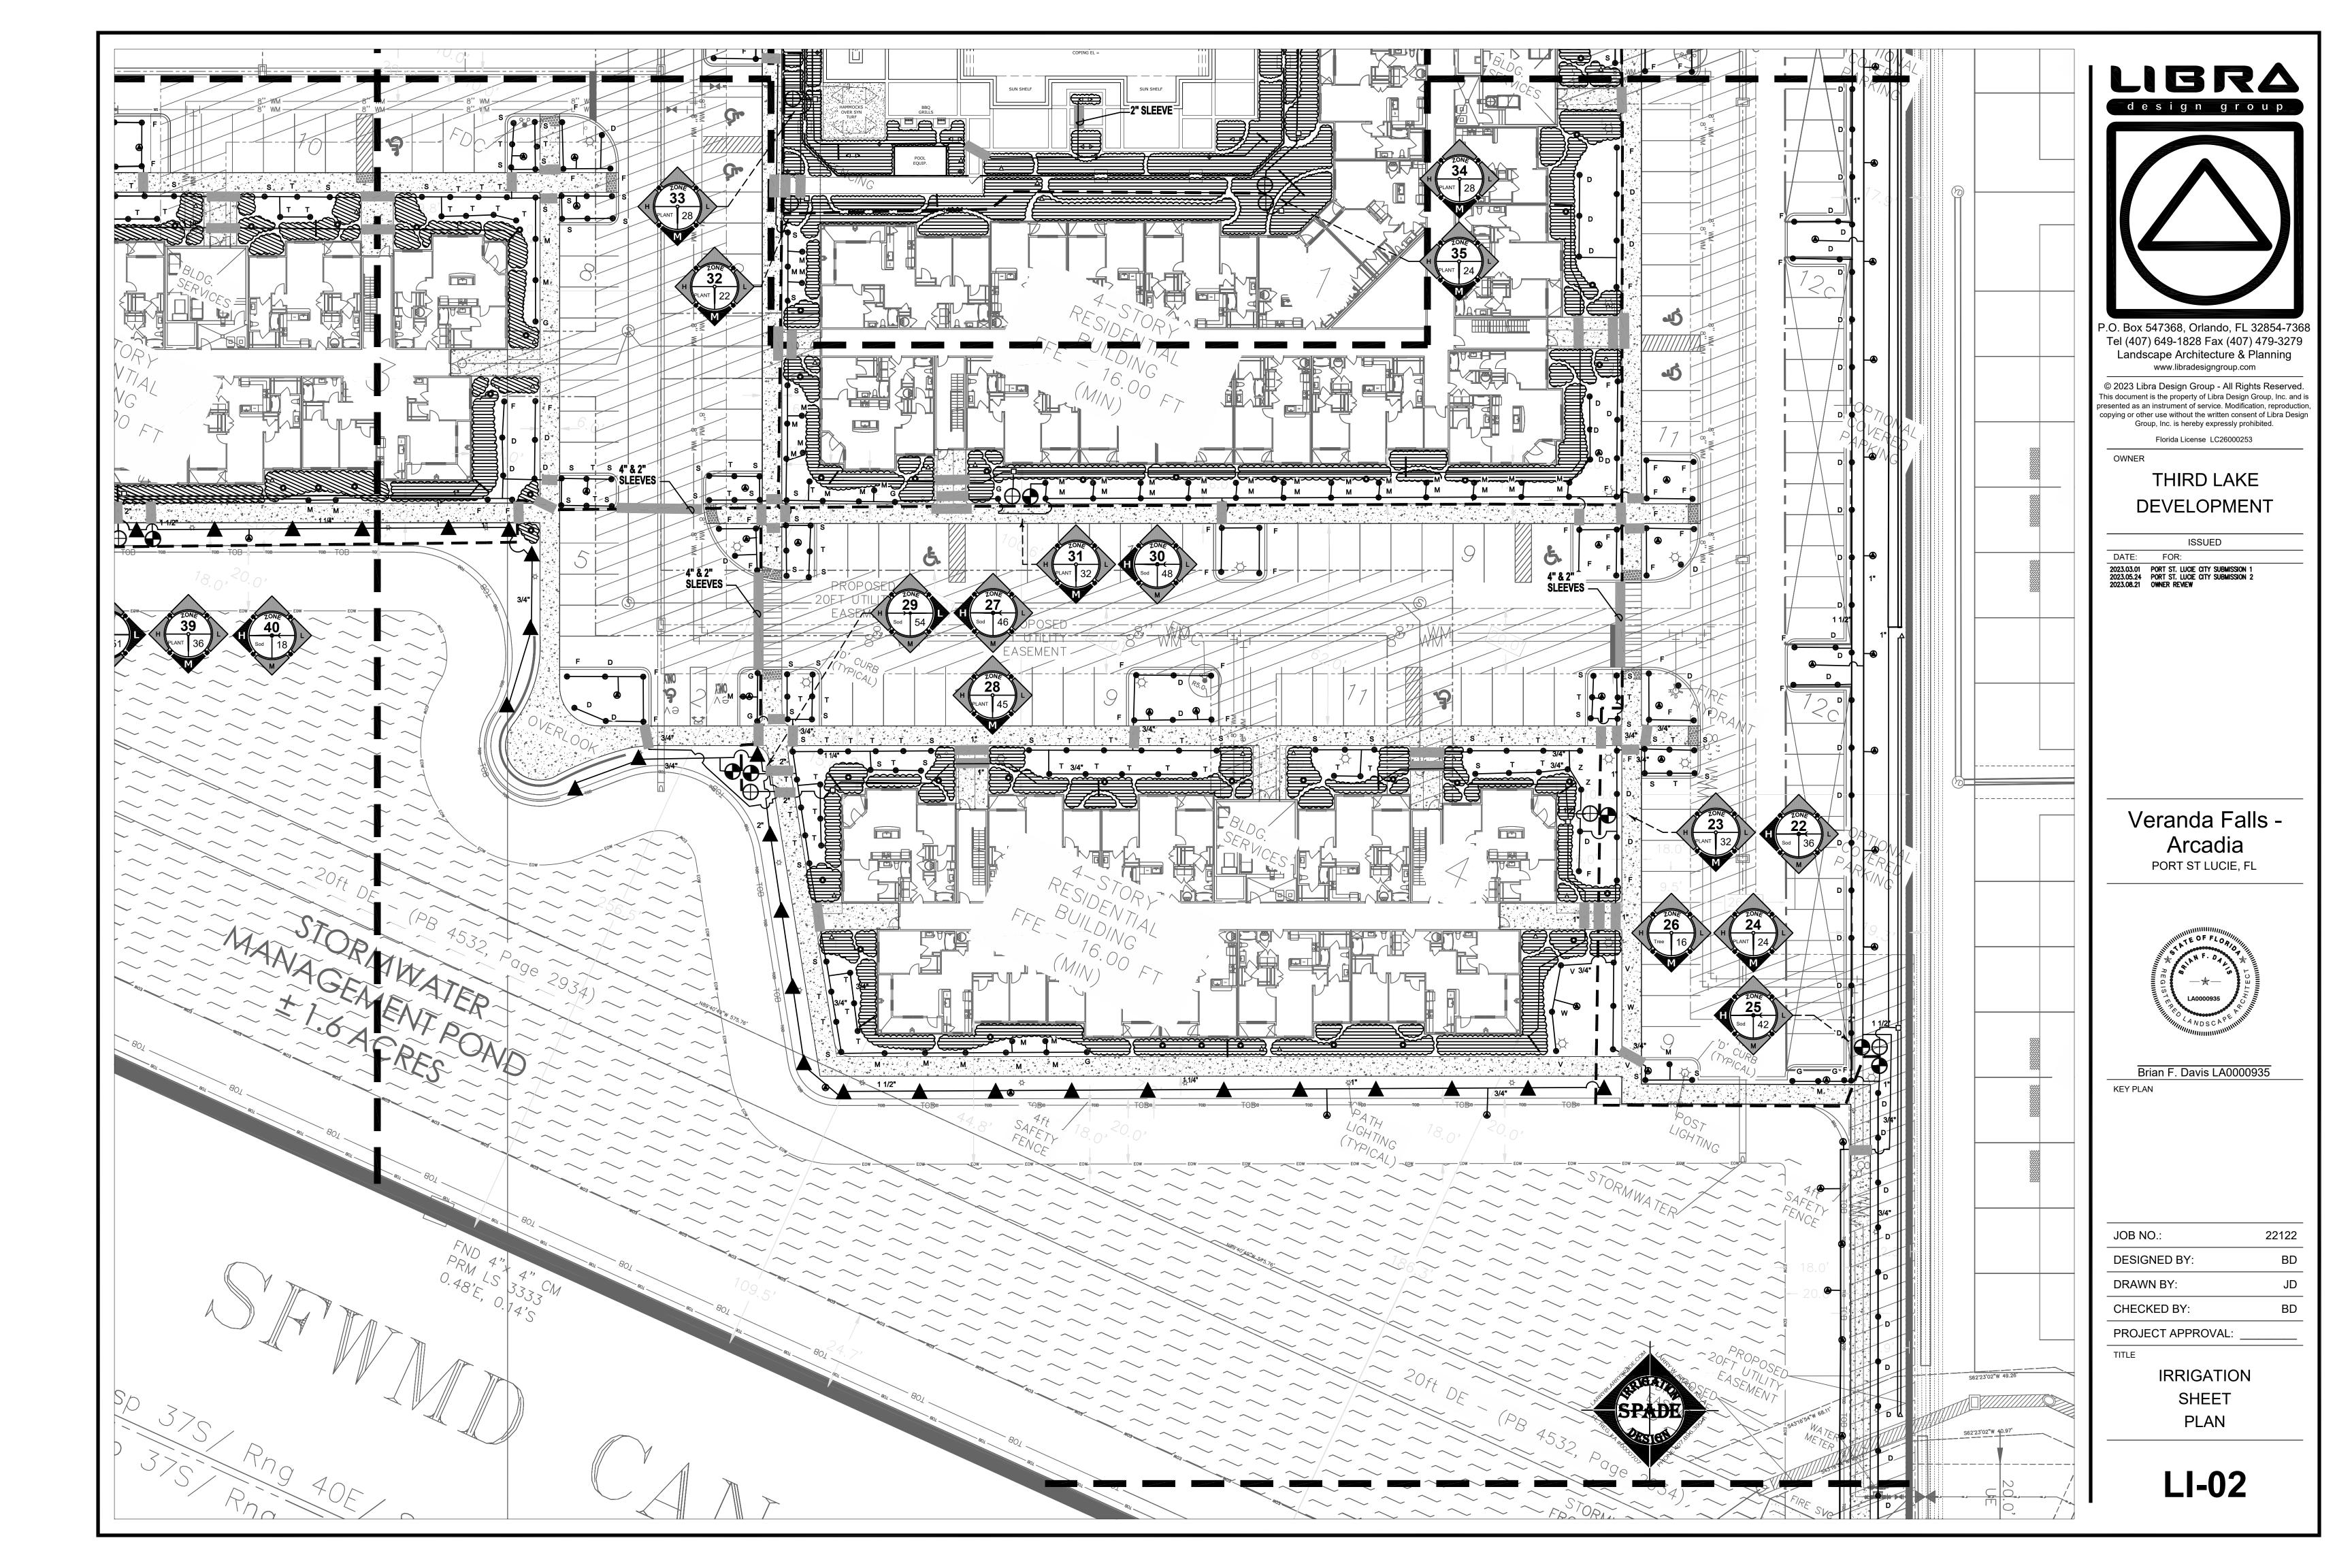


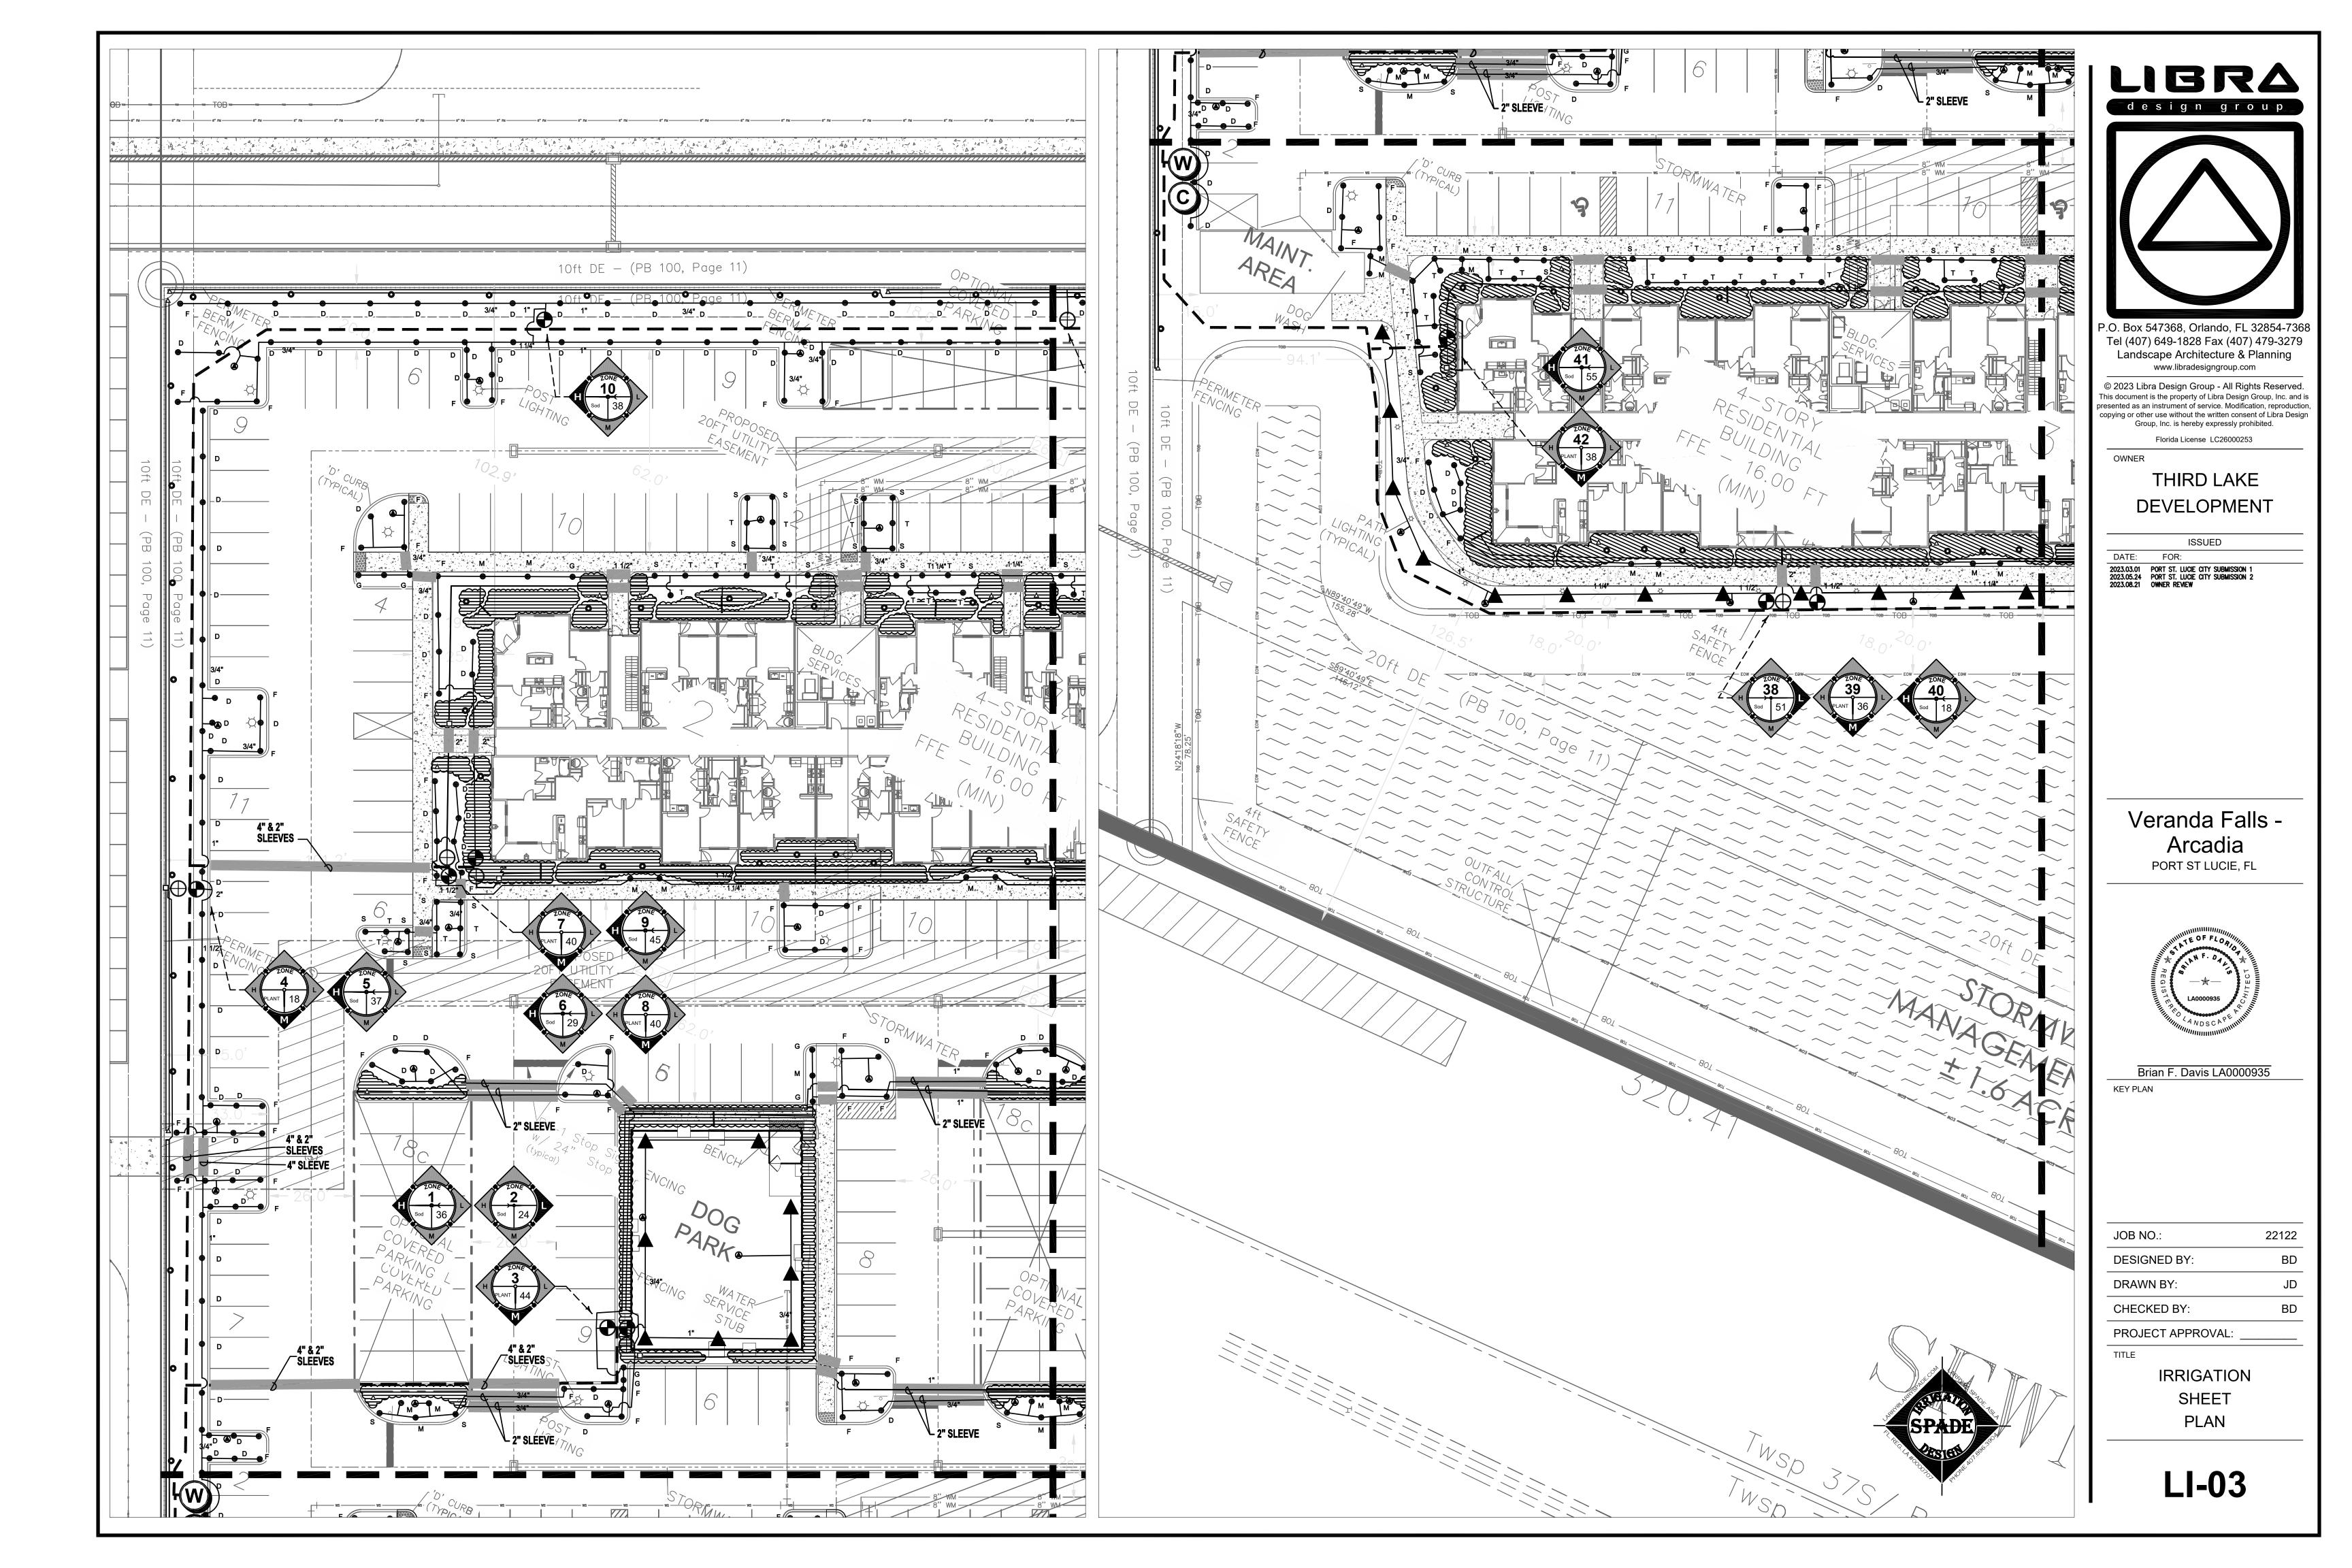



ZONE CHART


ZONE	PLANT	IRRIGATION	WATER	PRECIP		GPM	MINUTES	TOTAL
	(TYPE)	(TYPE)	(DEMAND)	(RATE)	(IN. PER WEEK REC	Q.) (GPM)	(PER CYCLE)	(GALLONS)
1	SOD	SPRAY	HIGH	0.5	1.5	36	90	3,240
2	SOD	ROTOR	LOW	0.5	0.5	24	30	720
3	PLANT	DRIP	MEDIUM	1.5	1.0	44	20	880
4	PLANT	DRIP	MEDIUM	1.5	1.0	18	20	360
5	SOD	SPRAY	HIGH	0.5	1.5	37	90	3,330
6	SOD	SPRAY	HIGH	0.5	1.5	29	90	2,610
7	PLANT	DRIP	MEDIUM	1.5	1.0	40	20	800
8	PLANT	DRIP	MEDIUM	1.5	1.0	40	20	800
9	SOD	SPRAY	HIGH	0.5	1.5	45	90	4,050
10	SOD	SPRAY	HIGH	0.5	1.5	38	90	3,420
11	PLANT	DRIP	MEDIUM	1.5	1.0	38	20	760
12	SOD	SPRAY	HIGH	0.5	1.5	37	90	3,330
13	PLANT	DRIP	MEDIUM	1.5	1.0	28	20	560
14	SOD	ROTOR	HIGH	0.5	1.5	15	90	1,350
15	PLANT	DRIP	MEDIUM	1.5	1.0	14	20	280
16	SOD	SPRAY	HIGH	0.5	1.5	34	90	3,060
17	SOD	ROTOR	HIGH	0.5	1.5	51	90	4,590
18	SOD	ROTOR	HIGH	0.5	1.5	36	90	3,240
19	SOD	SPRAY	HIGH	0.5	1.5	2	90	180
20	PLANT	DRIP	MEDIUM	1.5	1.0	42	20	840
21	SOD	SPRAY	HIGH	0.5	1.5	55	90	4,950
22	SOD	SPRAY	HIGH	0.5	1.5	36	90	3,240
23	PLANT	DRIP	MEDIUM	1.5	1.0	32	20	640
24	PLANT	DRIP	MEDIUM	1.5	1.0	24	20	480
25	SOD	SPRAY	HIGH	0.5	1.5	42	90	3,780
26	TREE	BUBBLER	MEDIUM	1.5	1.0	16	20	320
27	SOD	SPRAY	HIGH	0.5	1.5	46	90	4,140
28	PLANT	DRIP	MEDIUM	1.5	1.0	45	20	900
29	SOD	ROTOR	LOW	0.5	0.5	54	30	1,620
30	SOD	SPRAY	HIGH	0.5	1.5	48	90	4,320
31	PLANT	DRIP	MEDIUM	1.5	1.0	32	20	640
32	PLANT	DRIP	MEDIUM	1.5	1.0	22	20	440
33	PLANT	DRIP	MEDIUM	1.5	1.0	28	20	560
34	PLANT	DRIP	MEDIUM	1.5	1.0	28	20	560
35	PLANT	DRIP	MEDIUM	1.5	1.0	24	20	480
36	SOD	SPRAY	HIGH	0.5	1.5	9	90	810
37	PLANT	DRIP	MEDIUM	1.5	1.0	34	20	680
38	SOD	ROTOR	LOW	0.5	0.5	51	30	1,530
39	PLANT	DRIP	MEDIUM	1.5	1.0	36	20	720
40	SOD	SPRAY	HIGH	0.5	1.5	18	90	1,620
41	SOD	SPRAY	HIGH	0.5	1.5	55	90	4,950
42	PLANT	DRIP	MEDIUM	1.5	1.0	38	20	760
	_			-	-			
						1,421	2,200	76,540

THE RUN TIMES SHOWN FOR THE ZONE IS FOR ONE RUN CYCLE AND WILL PROVIDE HALF THE REQUIRED AMOUNT OF WATER NEEDED PER WEEK. TWO RUN CYCLES PER WEEK ARE REQUIRED TO PROVIDE THE TOTAL WEEKLY REQUIREMENT. ALL RUN TIMES SHALL BE SET TO FOLLOW THE CURRENT WATER MANAGEMENT DISTRICT REGULATIONS AND REDUCED TO ONLY ONE RUN TIME PER WEEK WHEN RESTRICTED BY DAYLIGHT SAVINGS TIME OR WATER RESTRICTIONS. THE ZONE CHART IS PROVIDED AS A GENERAL OUTLINE ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE TO SET THE RUN TIMES BASED ON THE SPECIFIC SITE CONDITIONS AND PLANT REQUIREMENTS. THIS SHALL INCLUDE, BUT NOT LIMITED TO, SOIL TYPE, DRAINAGE, SLOPES, SUN EXPOSURE AND THE ESTABLISHMENT PERIOD. THE TOTAL GPM REQUIRED PER YEAR WILL BE LESS THAN THE PEAK DEMAND PER WEEK TIMES 52 WEEKS, BASED ON THE RUN TIMES BEING REDUCED BY SENSORS AND A REDUCED WATER DEMAND IN THE WINTER MONTHS.

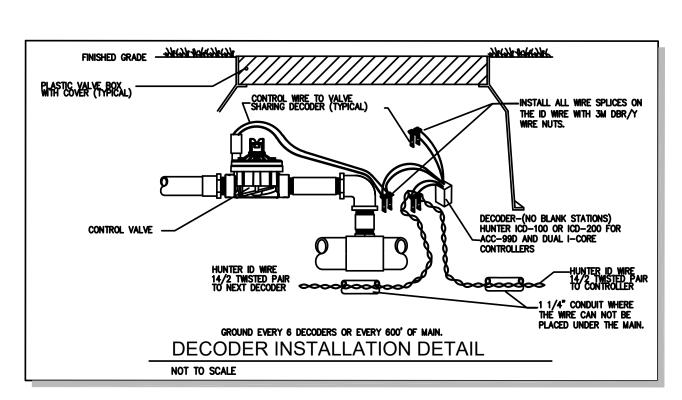

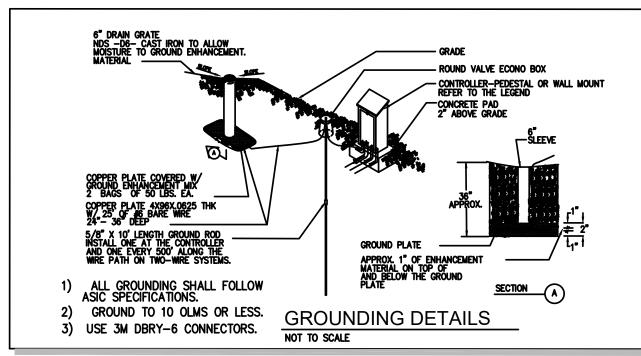

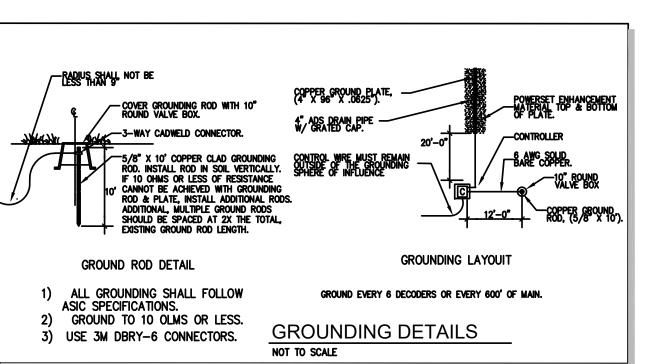

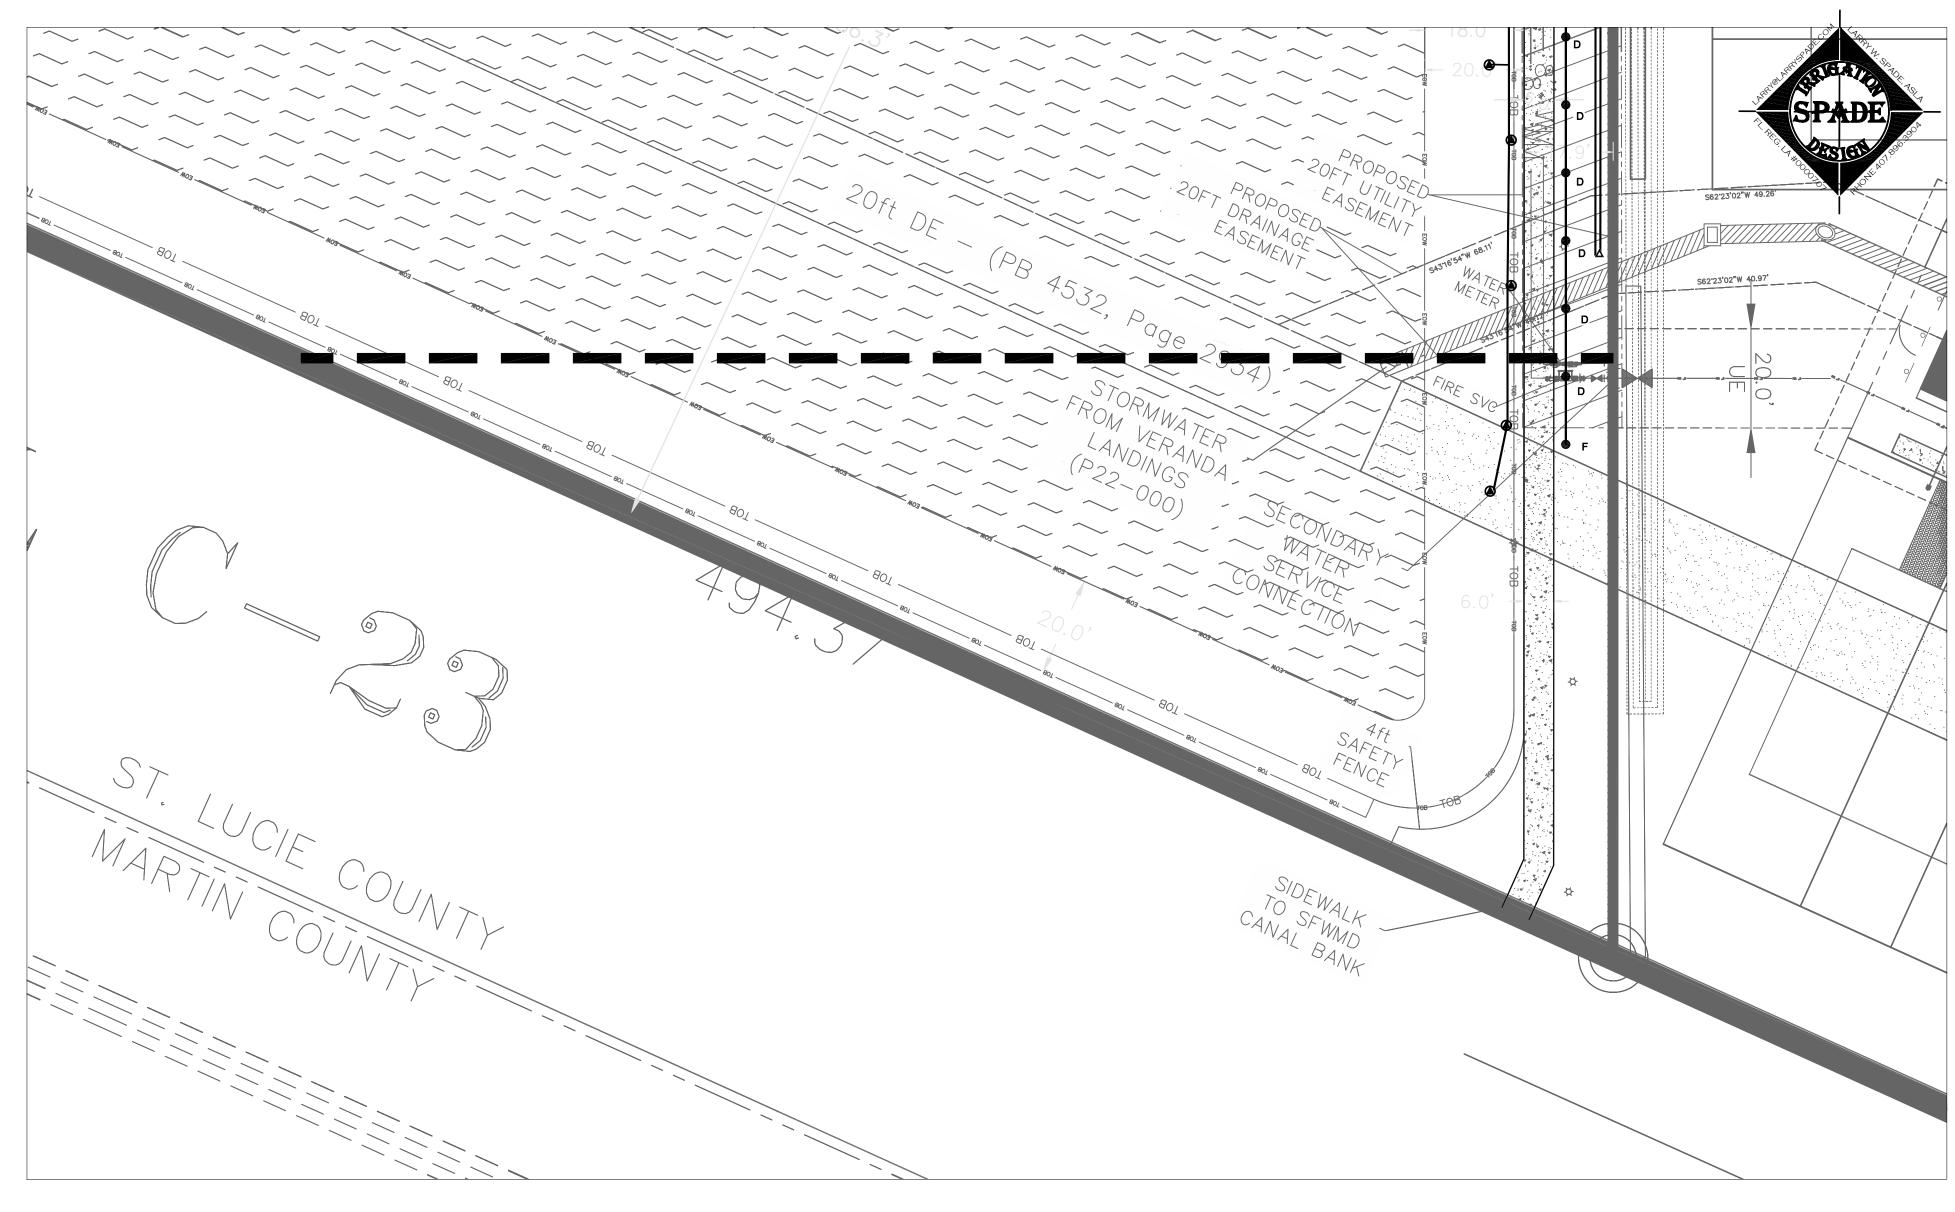



WELL SPECIFICATIONS

1.1 THE CONTRACTOR SHALL DRIVE OR DRILL ONE 4" DIAMETER DEEP WELL WITH STEEL CASING FOR THE OPERATION OF THE IRRIGATION SYSTEM. THE WELL SHALL PRODUCE 60 GALLONS PER MINUTE WITH NOT MORE THEN A 5 FT. PUMPING DRAWDOWN 1.2 ALL EQUIPMENT AND INSTALLATION SHALL BE AS PER STATE AND LOCAL CODE REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FEES AND PERMITS REQUIRED TO DRILL THE WELL OR WELLS.

2.1 THE CONTRACTOR SHALL FURNISH AND INSTALL ONE 5 H.P. SUBMERSIBLE PUMP IN THE WELL. THE PUMP SHALL BE CAPABLE OF PRODUCING 60 GALLONS PER MINUTE AT 140 T.D.H. (TOTAL DYNAMIC HEAD) THE T.D.H. IS AT GROUND LEVEL. THE PUMP OR PUMPS SHALL BE INSTALLED USING THE FOLLOWING EQUIPMENT AND MATERIALS. REFER TO THE DETAIL. ALL EQUIPMENT MAY NOT BE LISTED. THE CONTRACTOR SHALL BE RESPONSIBLE TO FURNISH AND INSTALL ALL NECESSARY EQUIPMENT FOR THE OPERATION OF THE WELL PUMP AND ITS CONNECTION TO THE IRRIGATION SYSTEM.

A) SANITARY WELL SEAL

B) GALVANIZED DROP PIPE C) SUBMERSIBLE PUMP CABLE, SIZE AS REQUIRED

THE GENERAL CONTRACTOR BEFORE PURCHASE OF THE PUMP.

- D) ALL NECESSARY GALVANIZED FITTINGS THAT ARE REQUIRED FOR THE CONNECTION OF THE SYSTEM. ALL ABOVE GROUND PIPE SHALL BE SCH. 40 PVC (PAINT BLACK). SAME SIZE AS THE MAINLINE. E) ALL NECESSARY ELECTRICAL WIRE, SWITCHES AND CONDUIT

THE FULL INTENT OF THESE SPECIFICATIONS.

G) SILENT CHECK VALVE H) ABOVE GROUND CHECK VALVE

I) CYCLE STOP VALVE CSV3B

- 3.1 THE PRESSURE TANK PRE-CHARGE SHALL BE 5-10 PSI LOWER THAN THE PRESSURE SWITCH START POINT. A WATER LINE AT LEAST 8" OR LONGER AND NO LARGER THAN THE TANK INLET SIZE SHALL BE CONNECTED TO THE TANK AT A 90% ANGLE. THE PRESSURE SWITCH SHALL BE INSTALL ON THE PIPE TO THE TANK, AS CLOSE TO THE TANK AS POSSIBLE.REFER TO CYCLE STOP VALVES WEBPAGE FOR MORE DETAILED INFORMATION. ALL INSTALLATION SHALL BE AS PER MANUFACTURERS SPECIFICATIONS.
- 3.2 THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE INSTALLATION AND CONNECTION OF ALL THE ABOVE EQUIPMENT AND THE CONNECTION TO THE IRRIGATION SYSTEM. 3.3 POWER FOR THE OPERATION OF THE WELL PUMP SHALL BE SUPPLIED TO A JUNCTION BOX AT THE WELL LOCATION AS PART OF THE ELECTRICAL PLANS OR BY OWNER. COORDINATE ALL POWER REQUIREMENTS WITH THE OWNER OR
- 4.1 THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING WATER SAMPLES FROM THE WELL. AT THE LANDSCAPE CONTRACTOR'S EXPENSE, HE SHALL HAVE A CERTIFIED LAB ANALYZE THE WATER QUALITY. THE LANDSCAPE CONTRACTOR SHALL REPORT TO THE LANDSCAPE ARCHITECT OR OWNER'S PROJECT MANAGER, ANY POTENTIAL ISSUES THAT MAY AFFECT THE HEALTH OF THE PLANT MATERIAL OR POTENTIAL STAINING TO SIDEWALKS AND BUILDINGS. REPORTING SHALL OCCUR BEFORE THE SYSTEM IS IN OPERATION. FAILURE TO REPORT SHALL PLACE LIABILITY ON THE CONTRACTOR.
- 4.2 BEFORE SETTING THE PUMP THE CONTRACTOR SHALL NOTIFY THE LANDSCAPE ARCHITECT OF THE STATIC WATER LEVEL TO DETERMINE IF THE PUMP CAN PROVIDE THE PROPER GPM AND PSI FOR THE OPERATION OF THE IRRIGATION
- 5.1 THE CONTRACTOR SHALL BE RESPONSIBLE TO VISIT THE SITE AND BECOME FAMILIAR WITH THE ON SITE LOCATION OF THE WELL. IT SHALL BE HIS RESPONSIBILITY TO NOTIFY THE OWNER IF HE FEELS THE LOCATION SHOULD BE MOVED. THE OWNER SHALL NOT BE RESPONSIBLE TO PAY FOR ANY WELL OR PART OF A WELL THAT DOES NOT MEET





LIBRA

design group

P.O. Box 547368, Orlando, FL 32854-7368 Tel (407) 649-1828 Fax (407) 479-3279 Landscape Architecture & Planning www.libradesigngroup.com

© 2023 Libra Design Group - All Rights Reserved. This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction, copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited. Florida License LC26000253

THIRD LAKE

DEVELOPMENT

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1 2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2 2023.08.21 OWNER REVIEW

DATE: FOR:



Brian F. Davis LA0000935


KEY PLAN


JOB NO.:	22122
DESIGNED BY:	BD
DRAWN BY:	JD

PROJECT APPROVAL:

CHECKED BY:

IRRIGATION SHEET PLAN

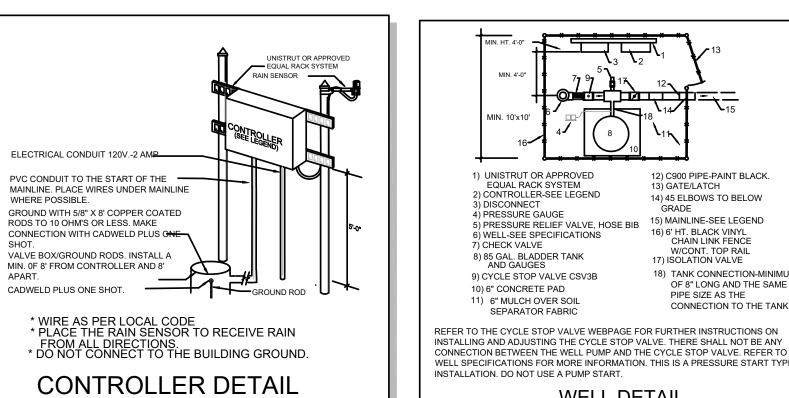

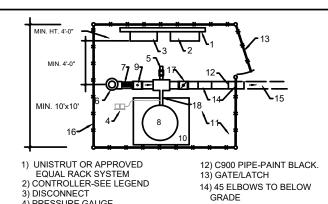

5) PRESSURE RELIEF VALVE, HOSE BIB

15) MAINLINE-SEE LEGEND

16) 6' HT. BLACK VINYL CHAIN LINK FENCE W/CONT. TOP RAIL 18) TANK CONNECTION-MINIMUM OF 8" LONG AND THE SAME PIPE SIZE AS THE CONNECTION TO THE TANK.

CONNECTION BETWEEN THE WELL PUMP AND THE CYCLE STOP VALVE. REFER TO THE WELL SPECIFICATIONS FOR MORE INFORMATION. THIS IS A PRESSURE START TYPE INSTALLATION. DO NOT USE A PUMP START.

WELL DETAIL



GENERAL NOTES

1) REFER TO THE LANDSCAPE PLANS WHEN TRENCHING TO AVOID TREES AND SHRUBS, HAND DIG AROUND ANY EXISTING TREES. DO NOT CUT ANY ROOTS OVER 2" IN DIAMETER. 2) ALL MAINLINE PIPING SHALL BE BURIED TO A MINIMUM DEPTH OF 18" OF COVER. ALL LATERAL

PIPING SHALL BE BURIED TO A MINIMUM DEPTH OF 12" OF COVER. 3) ALL POP-UP ROTORS AND SPRAYS SHALL BE INSTALLED USING AN 18" PVC FLEX PIPE CONNECTION. DO NOT USE POLYETHYLENE PIPE. USE WELDON 737 WITH A PURPLE PRIMER OR RED HOT CHRISTY'S BLUE GLUE ON ALL CONNECTIONS.

4) ADJUST ALL NOZZLES TO REDUCE WATER WASTE ON HARD SURFACES, WINDOWS AND BLDG. WALLS. THROTTLE ALL VALVES ON SHRUB LINES AS REQUIRED TO PREVENT FOGGING. USE ADJUSTABLE NOZZLES WHERE REQUIRED TO AVOID ANY WATER ON BUILDING WINDOWS.

5) ALL RISERS SHALL BE PAINTED BLACK OR A COLOR CHOSEN BY THE OWNER'S REPRESENTATIVE AND SHALL BE STAKED WITH A STEEL ANGLE AND SECURED WITH STAINLESS STEEL CLAMPS. LEAVE THE BOTTOM 12' OF THE PIPE PURPLE ON

BY SHOWING EXACT MEASUREMENTS FROM HARD SURFACES. MEASUREMENTS SHALL BE MARKED ON THE PLAN EVEN

RECLAIMED SYSTEMS.
6) ALL CONTROL WIRE CONNECTIONS SHALL BE MADE IN VALVE BOXES USING 3M DBR-Y WIRE CONNECTORS AND SEALANT WITH WIRE NUTS. 7) THE CONTRACTOR SHALL PREPARE AN AS-BUILT DRAWING SHOWING ALL IRRIGATION INSTALLATION. THE CONTRACTOR SHALL NEATLY MARK IN RED INK ON A WHITE BOND PAPER COPY OF THE IRRIGATION PLAN ANY INSTALLATION THAT DEVIATES FROM THE PLAN. THE AS-BUILT DRAWING SHALL ALSO LOCATE ALL MAINLINE AND VALVES

WHEN THE EQUIPMENT IS INSTALLED IN THE EXACT LOCATION AS THE PLAN. PROVIDE THE OWNER A PDF OF THE AS-BUILT 8) ALL VALVES, GATE VALVES AND QUICK COUPLERS SHALL BE INSTALLED IN VALVE BOXES. THE

VALVE BOXES SHALL BE PURPLE WHEN USING RECLAIMED WATER. 9) ANY PIPING SHOWN OUTSIDE THE PROPERTY LINE OR RUNNING OUTSIDE A LANDSCAPE AREA IS SHOWN THERE FOR CLARITY ONLY. ALL LINES SHALL BE INSTALLED ON THE PROPERTY AND INSIDE THE

LANDSCAPE AREAS OR INSIDE A SCH. 40 SLEEVE. 10) ALL HEADS SHALL BE INSTALLED A MINIMUM OF 24" FROM ANY WALL AND A MINIMUM OF 6" FROM ANY SIDEWALK, PATIO OR ROAD. (MINIMUM OF 2'-0" WHERE THERE ARE NO BUMPER STOPS) THE EXACT HEIGHT OF ANY 12" POP-UP THAT IS SHOWN IN A SHRUB BED SHALL BE DETERMINED BY THE OWNER'S REPRESENTATIVE IN THE FIELD. INSTALL THE 12" POP-UP HIGHER WHERE BLOCKED BY TALL SHRUBS.

11) THE CONTRACTOR SHALL EXERCISE CARE SO AS NOT TO DAMAGE ANY EXISTING UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE IMMEDIATE REPAIRS AND COST OF ANY DAMAGE CAUSED BY THEIR WORK.

12) ALL WORK SHALL BE GUARANTEED FOR ONE YEAR FROM THE DATE OF FINAL ACCEPTANCE AGAINST ALL DEFECTS IN EQUIPMENT AND WORKMANSHIP OR AS OUTLINED IN THE WRITTEN SPECIFICATIONS.

13) ELECTRICAL SERVICE TO LOCATION OF THE CONTROLLER WELL OR PLIMP SHALL BE PROVIDED TO A JUNCTION BOX OR DISCONNECT AT THE EQUIPMENT LOCATION BY THE ELECTRICAL CONTRACTOR OR BY OWNER WHEN IT IS NOT PART OF THE BID PACKAGE. CONFIRM THE LOCATION OF THE CONTROLLER WITH THE OWNER OF GENERAL CONTRACTOR BEFORE ANY INSTALLATION.

14) IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO SCALE THE PLAN AND CHECK NOZZLE TYPES TO DETERMINE THE CORRECT SPACING OF THE HEADS. THE CONTRACTOR SHALL NOT SPACE THE HEADS FURTHER APART OR USE LESS HEADS THAN SHOWN ON THE PLAN. ANY CHANGES TO THE HEAD SPACING OR LAYOUT, WITHOUT THE CONSENT OF THE LANDSCAPE ARCHITECT OR OWNER, SHALL HOLD THE IRRIGATION CONTRACTOR RESPONSIBLE FOR WARRANTY OF THE PLANTS AND OR SOD IN

THESE AREAS. 15) 48 HOURS BEFORE DIGGING, CALL 1-800-432-4770 (SUNSHINE STATE ONE CALL CENTER) 16) INSTALL THREE EXTRA CONTROL WIRES TO EACH TERMINATION OF THE MAIN. ALL CONTROL WIRES SHALL BE INSTALLED INSIDE OF SCH. 40 GRAY PVC CONDUIT WHERE THEY CANNOT BE UNDER THE MAIN.

DRIP TUBING NOTES

AND NOT BENT OVER OR TAPED.

INSTALL ALL DRIP TUBING AT GROUND LEVEL AFTER PLANT INSTALLATION. INSTALL NETAFIM TLS6 U SHAPED WIRE STABILIZERS A MIN. OF 4' O.C. TO HOLD THE LINES IN PLACE. 2) KEEP ALL DRIP LINE CLEAN AT ALL TIMES BEFORE THE FINAL CONNECTION. ALL TUBE ENDS SHALL BE INTERCONNECTED TO ALL OTHER DRIP TUBES. DO NOT DEAD END TUBING. SINGLE ROWS SHALL HAVE A END CAP

3) AVOID SHARP BENDS IN THE TUBING. DO NOT BEND THE TUBING WITH LESS THEN A 12" RADIUS. THERE SHALL NOT BE ANY KINKS IN THE TURING 4) ALL DRIP TUBING SHALL HAVE UNIFORM SPACING AND BURIAL DEPTH. THE PLAN DOES NOT ALWAYS REFLECT THE EXACT SPACING OR LAYOUT OF THE TUBING, LAYOUT THE TUBING DOWN THE LONGEST WIDTH WHEN POSSIBLE, ADAPT THE TUBING TO CURVED BEDS OR PLANTERS AS REQUIRED. ADJUST AND ADAPT THE TUBING FOR ALL TREES. REFER TO

5) INSTALL DRIP TUBING TO ALL AREAS THAT SHALL RECEIVE PLANT MATERIAL. SEE THE LANDSCAPE PLAN FOR THE EXACT LOCATIONS. THERE SHALL BE A MINIMUM OF TWO ROWS OF TUBING ON A SINGLE ROW OF PLANTS.

6) SPACE TUBING AS NOTED ON THE PLAN. DO NOT SNAKE TUBING BACK AND FORTH EXCEPT WHERE SHOWN ON THE PLAN. ALWAYS INSTALL A HEADER PIPE UNLESS THE TOTAL GALLONAGE OF AN AREA IS 3 GPM OR LESS.

7) REFER TO THE MANUFACTURERS DRIP INSTALLATION MANUAL FOR INSTALLATION INSTRUCTIONS. ALL FITTINGS SHALL BE THE SAME TYPE AND MANUFACTURER AS THE DRIP TUBING.

8) ALWAYS FLUSH ALL LINES BEFORE FINAL CONNECTION. 9) INSTALL A A "SYSTEM ON" INDICATOR FLAG ON EVERY ZONE WHERE IT IS SEEN FROM THE CONTROL VALVE.

10) INSTALL FLUSH VALVES WHERE SHOWN AT THE ENDS OF EACH RUN OF DRIP TUBING AND ONE FOR EVERY 15 GPM OF TUBING.

11) CLEARLY AND NEATLY MARK THE TOP OF EACH VALVE BOX WITH THE TYPE OF EQUIPMENT THAT IT CONTAINS. 12) THE DRIP ZONE VALVE ASSEMBLY SHALL BE PLACED INSIDE AN ARMOR JUMBO VALVE BOX. THE VALVE SHALL BE


INSTALLED AS PER THE DETAIL ON THE PLANS. 13) THE DRIP TUBING SHALL HAVE EMITTERS EVERY 12" AND SHALL BE SPACED 12" APART IN GROUND COVER BEDS AND A MINIMUM OF TWO RUNS FOR EACH ROW OF SHRUBS WHEN THE SHRUBS ARE SPACED FARTHER THAN 2' ON CENTER.


14) REFER TO THE ZONE CONTROL KIT DETAIL FOR FILTER SIZES. 15) THE IRRIGATION CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE HIS/HER WORK WITH THE LANDSCAPE CONTRACTOR.

NOZZLE CHART

LETTER	R SPEC.	COLOR	G.P.M. 40 PSI	DISTANCE		RADIUS	ZONE LABELS
Α	MP2000	RED	1.47	19'	FULL	360°	
В	MP CORNER	TURQUOISE	.45	14'	CORNER	105°	
С	MP CORNER	TURQUOISE	.19	14'	CORNER	45°	
D	MP2000	BLACK	.74	19'	HALF	180°	☐ GPM
F	MP2000	BLACK	.40	19'	QUARTER	90°	ZONE
G	MP END STRIP	COPPER	.22	5' X 15'	END STRIF)	
Н	RAIN. XPCN	BLACK	.23	4.5'	HALF PATT	ERN	
K	MP815	OLIVE	1.87	8'-16'	FULL	360°	PLANT
М	MP SIDE S	BROWN	.44	5' X 30'	SIDE STRIF	•	SOD PLANTS
S	MP815	MAROON	.49	8'-16'	90 ° - 180	٥	TREES
Т	MP815	MAROON	.93	8'-16'	90 ° - 180	۰	
V	MP3000	BLUE	.86	30'	QUARTER	90 °	HIGH
W	MP3000	BLUE	1.82	30'	HALF	180°	←WATER USE MEDIUM
Χ	MP3000	YELLOW	2.73	30'	THREE QT	R. 270°	LOW
Υ	MP3000	GRAY	3.64	30'	FULL	360°	
Z	MP2000	GREEN	1.10	19'	THREE QT	R. 270°	

THE NOZZLES LISTED SHOW THE TYPE OF MP ROTATOR NOZZLE THAT SHOULD BE USED. THE CONTRACTOR SHOULD INSTALL CORRECT NOZZLE IN EACH HEAD AS SHOWN BY THE LETTER BESIDE THE HEAD ON THE PLAN. DO NOT USE MP1000 SERIES NOZZLES. THE GPM. DISTANCE AND ANGLE ON THE NOZZLE CHART ARE APPROXIMATE. THE CONTRACTOR SHALL ADJUST ALL NOZZLES TO PROVIDE THE 100% COVERAGE, BUT LIMIT OVERTHROW ON TO BUILDINGS WALLS PAVEMENT ETC. THE HEADS SHALL BE SPACED AS PER THE PLAN SCALE THE PLAN FOR DISTANCE. DO NOT ASSUME THAT ALL HEADS ARE SPACED AS PER CONVENTIONAL SPRAY HEADS. THE PRECIPITATION RATE FOR THESE NOZZLES IS LESS THAN A CONVENTIONAL SPRAY NOZZLE FOLLOW THE ZONE CHART FOR AN APPROXIMATE RUN TIME FOR EACH ZONE, BUT SET THE RUN TIME ON THE CONTROLLER BASED ON THE SPECIFIC SITE CONDITIONS. DO NOT SUBSTITUTE WITH STANDARD NOZZLES.

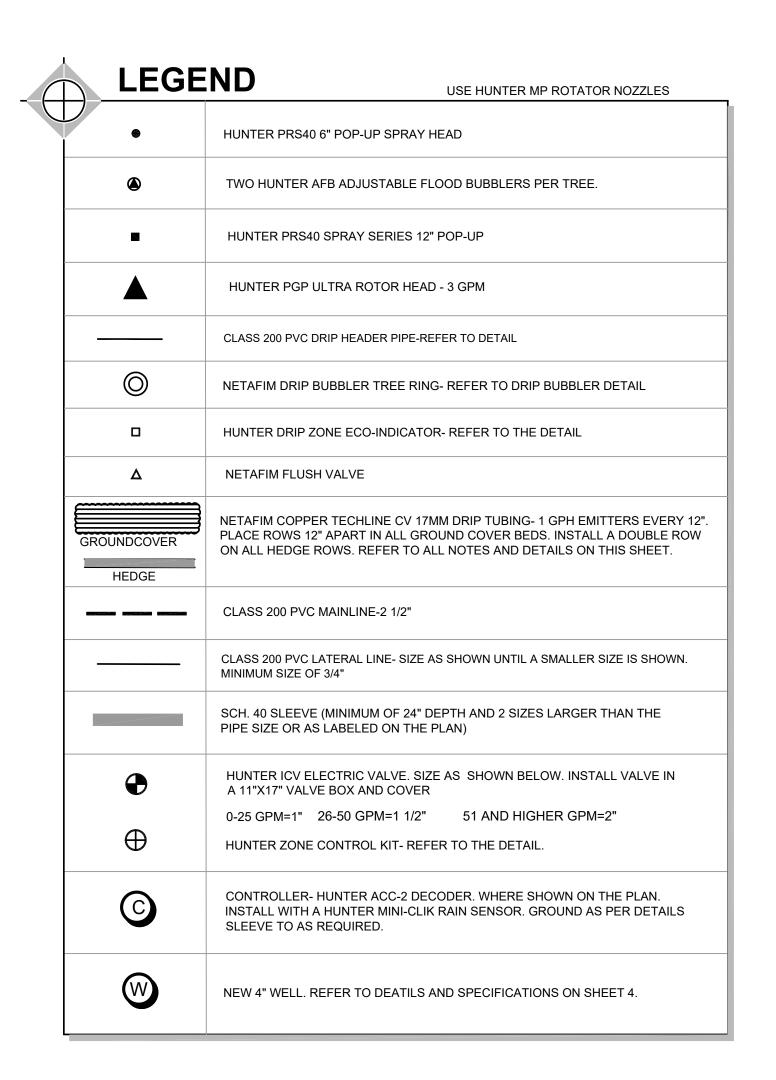



* ALL HEADS SHALL BE INSTALLED A MINIMUM OF 24" AWAY

HEAD DETAIL

SPRINKLER NOZZLE

BODY ASSEMBLY

▶ PVC STREET ELL

FROM ANY BUILDING.

VARTEK PIPE

USE 1/2" ON SPRAY HEADS

PVC TEE SXSXS

LATERAL LINE

OR ELBOW



P.O. Box 547368, Orlando, FL 32854-7368 Tel (407) 649-1828 Fax (407) 479-3279 Landscape Architecture & Planning www.libradesigngroup.com

© 2023 Libra Design Group - All Rights Reserved. This document is the property of Libra Design Group, Inc. and is presented as an instrument of service. Modification, reproduction, copying or other use without the written consent of Libra Design Group, Inc. is hereby expressly prohibited.

Florida License LC26000253

THIRD LAKE DEVELOPMENT

ISSUED DATE: FOR:

2023.03.01 PORT ST. LUCIE CITY SUBMISSION 1 2023.05.24 PORT ST. LUCIE CITY SUBMISSION 2 2023.08.21 OWNER REVIEW

> Veranda Falls -Arcadia PORT ST LUCIE, FL




Brian F. Davis LA0000935


KEY PLAN

JOB NO.:	22122
DESIGNED BY:	LWS
DRAWN BY:	LWS
CHECKED BY:	ВГ

PROJECT APPROVAL:

IRRIGATION DETAILS PLAN

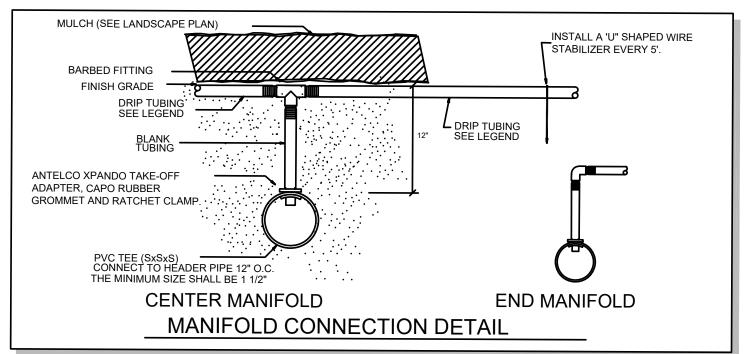

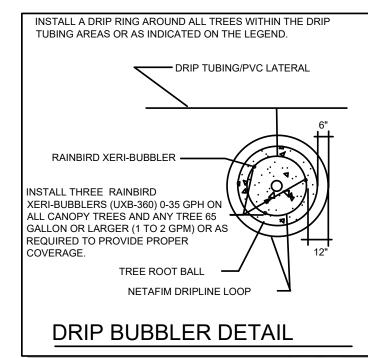



BRAND F-VALVE INTO LID FOR FLUSH 🖚


FLUSH VALVE


AUTO FLUSH VALVE


MULCH

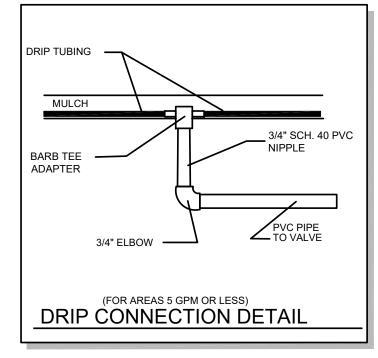


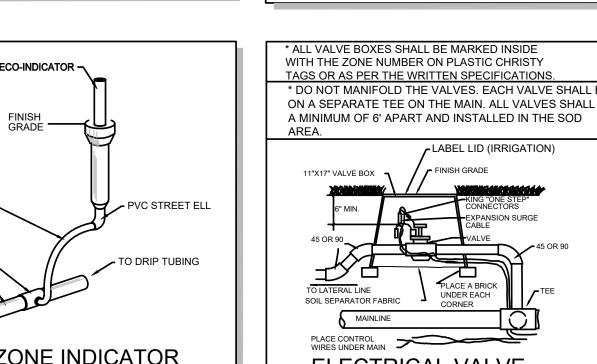


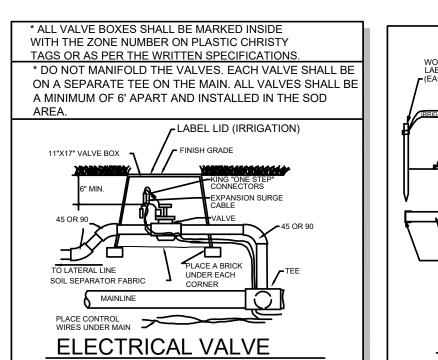

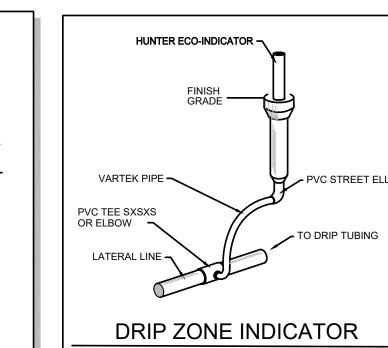

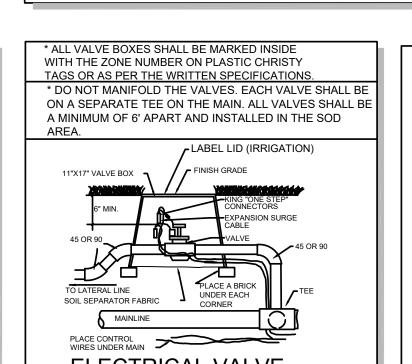

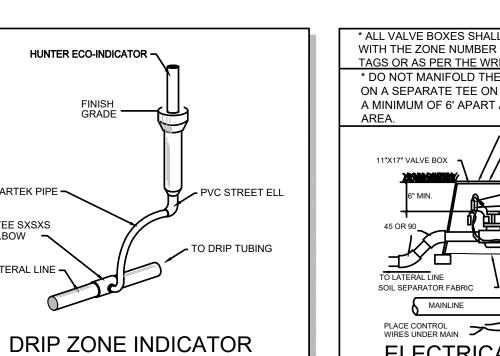

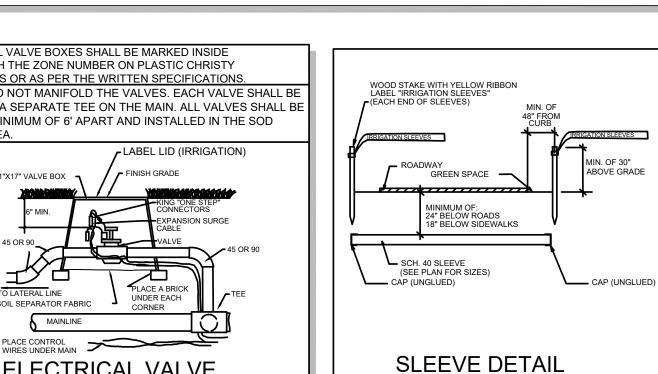

ZONE CONTROL KIT DETAIL

LEGEND

1. A. HUNTER ICZ-101 1" CONTROL ZONE KIT. (0-20 GPM)

HUNTER ICZ-151 1 1/2' CONTROL ZONE KIT. (21-60 GPM)

PVC UNION FOR SERVICING ASSEMBLY.

JUMBO PLASTIC VALVE BOX.

PVC PIPE TO IRRIGATION ZONE.

). FINISHED GRADE.

CONTINUE 14 GAUGE WIRE TO THE CONTROLLER. INSTALL THE

WIRE UNDER THE MAIN. INSTALL IN CONDUIT WHERE THE MAIN

DOES NOT CONTINUE. (EXCEPT TWO-WIRE SYSTEMS)

WATERPROOF CONNECTORS (DBY ON TWO-WIRE SYS.)

PVC PIPE FROM POINT OF CONNECTION. (45 OR 90 DEG.)

SOIL SEPARATOR FABRIC W/ BRICK UNDER EACH CORNER

REFER TO THE DECODER DETAILS FOR TWO-WIRE SYSTEMS

FOR DECODERS, WIRE SPECIFICATIONS AND WIRE NUTS.

