


EXISTING DRAINAGE

(now what's **below**. Call before you dig

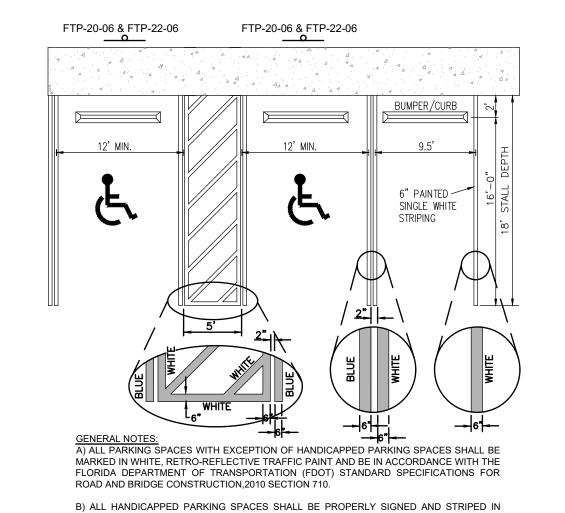

C) ALL COMPACT SPACES SHALL BE MARKED "COMPACT" ON THE STALL OR TIRE STOP. HANDICAPPED SPACE DETAIL 18' PARKING STALL DETAIL

ACCORDANCE WITH THE FDOT STANDARD INDEX 17346, FY 2017-18.






1. FTP 20-06: TOP PORTION SHALL HAVE REFLECTIVE BLUE BACKGROUND WITH WHITE REFLECTIVE SYMBOL AND BORDER. BOTTOM PORTION SHALL HAVE A REFLECTIVE WHITE BACKGROUND WITH BLACK OPAQUE LEGEND AND BORDER. 2. FTP 21-06: TOP PORTION SHALL HAVE REFLECTIVE BLUE BACKGROUND
WITH WHITE REFLECTIVE SYMBOL AND BORDER. BOTTOM PORTION SHALL

HAVE A REFLECTIVE WHITE BACKGROUND WITH BLACK OPAQUE LEGEND 3. FTP 20-06 IS FOR USE IN AREAS WHERE SPACE IS LIMITED. 4. FTP 22-06 IS SUPPLEMENTAL PANEL FOR THE FTP 20-06 & FTP 21-06 SIGNS.
5. HEIGHT SHALL BE 7 FEET MEASURED FROM THE GROUND OR SIDEWALK TO THE BOTTOM OF "PERMIT ONLY" SIGN OR 6 FEET TO THE BOTTOM OF "\$250

FINE" SIGN. 6. REFER TO FDOT INDEX No. 711-001 FOR PAVEMENT MARKING DETAILS & FDOT INDEX No. 700-102 SIGN DETAILS PER THE LATEST FDOT DESIGN

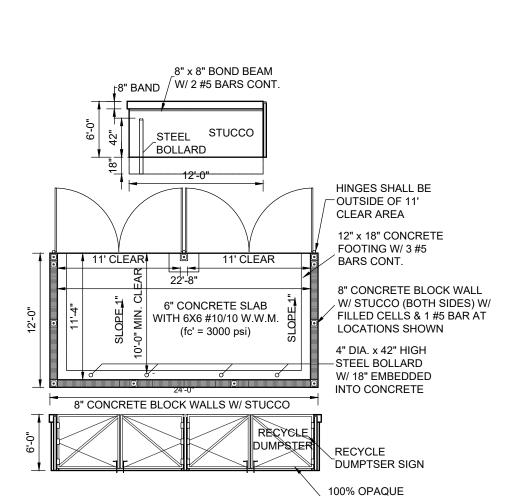


GATES (SOLID

SHEETING)

WOOD OR METAL

24' x 12' DUMPSTER DETAIL

NOTE:
OPENING MUST BE PERPENDICULAR TO LINE OF FLIGHT OF SERVICE VEHICLE.

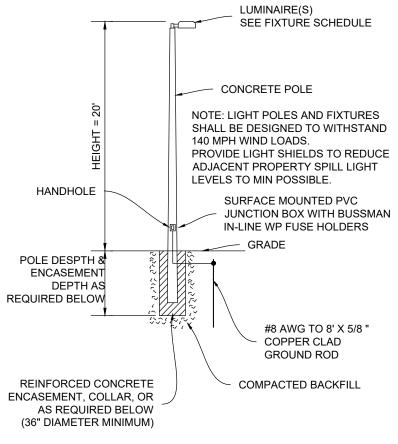

POLE MOUNTING DETAIL NOT TO SCALE

SEE PLANS

USE 3,000 P.S.I. CONCRETE AT 28 DAYS FOR

2. SIDEWALK THICKNESS TO BE INCREASED TO 6"

3. ALL REPAIRS REQUIRED DURING CONSTRUCTION

SHALL BE REMOVED AND REPLACED 10' MINIMUM

4. ALL SIDEWALK WITHIN FDOT RIGHT-OF-WAY TO BE

CONSTRUCTED PER STANDARD PLANS 522-001.

4" THICK SIDEWALK DETAIL

NOT TO SCALE

SIDEWALK CONSTRUCTION.

TO NEXT FULL JOINT.


THICK AT DRIVEWAY LOCATIONS.

Provide 1/8" to 1/4" contraction


Compact Subgrade to 98% of the Maximum Density as

Determined by AASHTO T-99

joints at 10' centers (max).

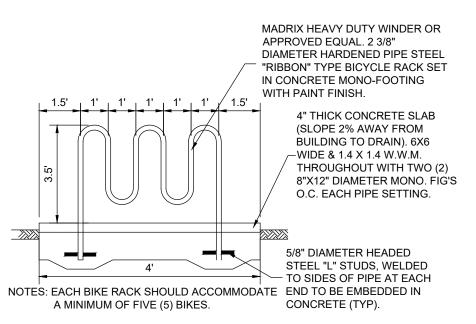

TYPICAL BIKE RACK DETAIL

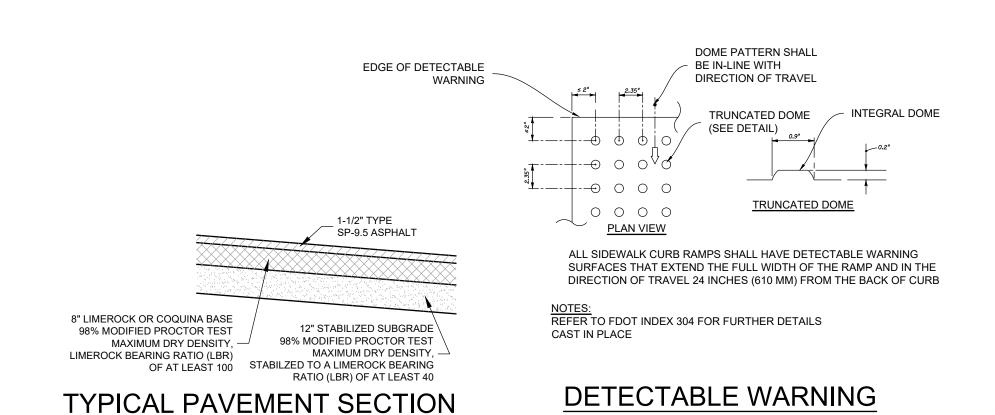


N.T.S.

width varies Provide 1/2" expansion joints between surfaces Provide 1/8" to 1/4" contraction joints at 10' centers (max). 1% Compact Subgrade to 98% of the Maximum Density as Determined by AASHTO T-99.

1. USE 3,000 P.S.I. CONCRETE AT 28 DAYS FOR CONSTRUCTION. 2. SUBGRADE TO EXTEND AN ADDITIONAL 6" BEYOND TYPE "D" CURB.

TYPE "D" CURB & SIDEWALK COMBINATION NOT TO SCALE

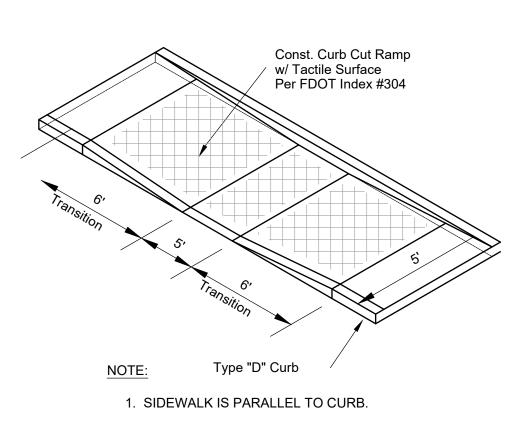

HANDICAP CURB CUT RAMP



ENGINEERS & SURVEYORS
ENVIRONMENTAL LAND PLANNERS 10250 SW VILLAGE PARKWAY - SUITE 201 PORT SAINT LUCIE, FL 34987 **772-462-2455** 20-373 H H H H H H H H H H H 2 OF 2

ENGINEERS SURVEYORS
ENVIRONMENTAL LAND PLANNERS

INTERIOR DESIGNERS

10250 VILLAGE PARKWAY

SUITE 201 PORT ST. LUCIE, FL 34987

> **772-462-2455** ¬
> ⊕ www.edc-inc.com

F.B.P.E. CERTIFICATE OF AUTHORIZATION 9935

L.B. CERTIFICATE OF AUTHORIZATION 8098

Ш

S

JOR